


Time, in minutes
100

1000

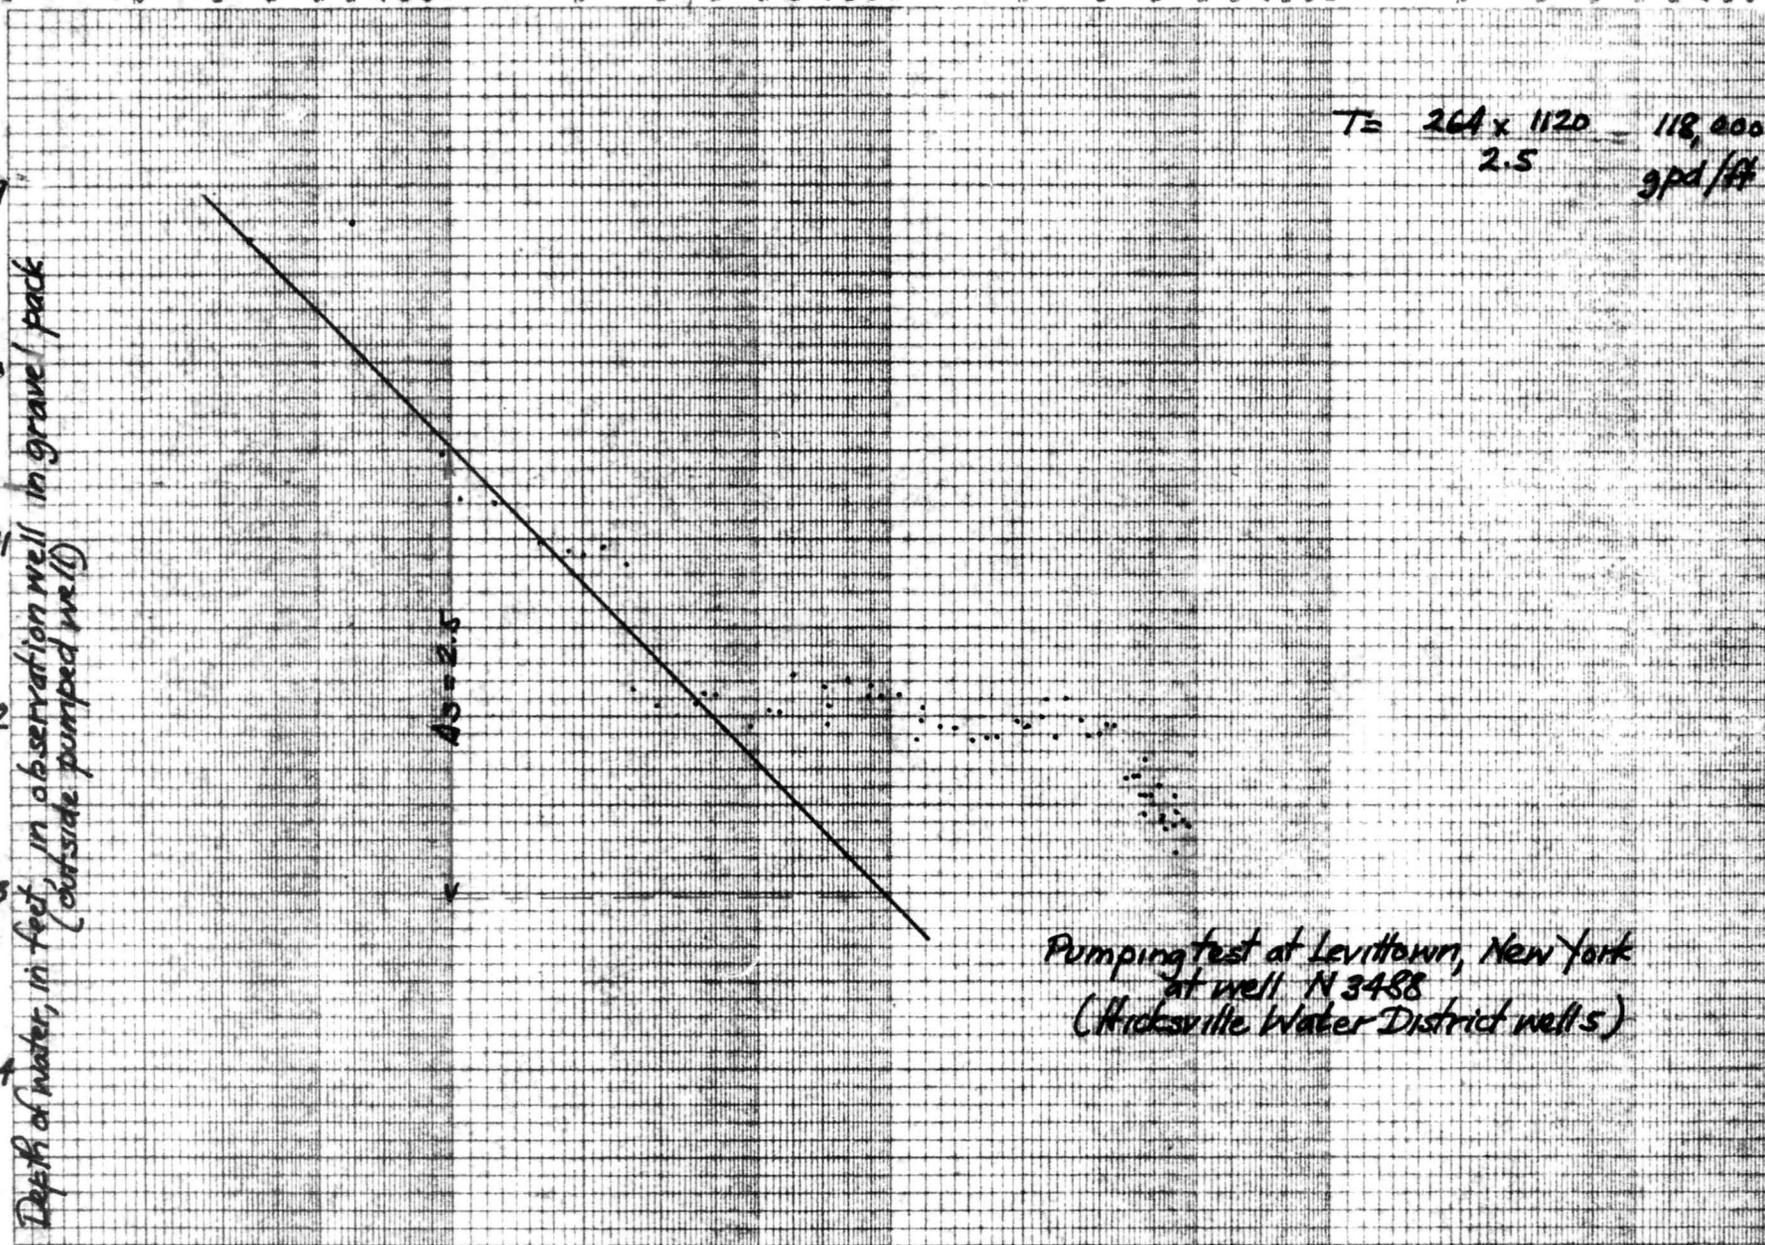

$$T = \frac{264 \times 1120}{2.5} = 118,000 \text{ gpd/ft}$$

Pumping test at Levittown, New York
at well N 3488
(Hicksville Water District wells)