


EXPLANATION
Title: COPPER-ZINC RATIO IN SOILS

- 24 Average copper-zinc ratio within
1000 foot square times 100
(100 times actual value)
- At least one member of a grid block
has a value less than detectable
- At least one member of a grid block
has a value greater than detectable
- 2
3
4
6
Contours defining areas where the
copper-zinc ratio is more than
.2, 3, 4, 6, 1, 2, or 3.
- 1
2
Dashed where inferred.

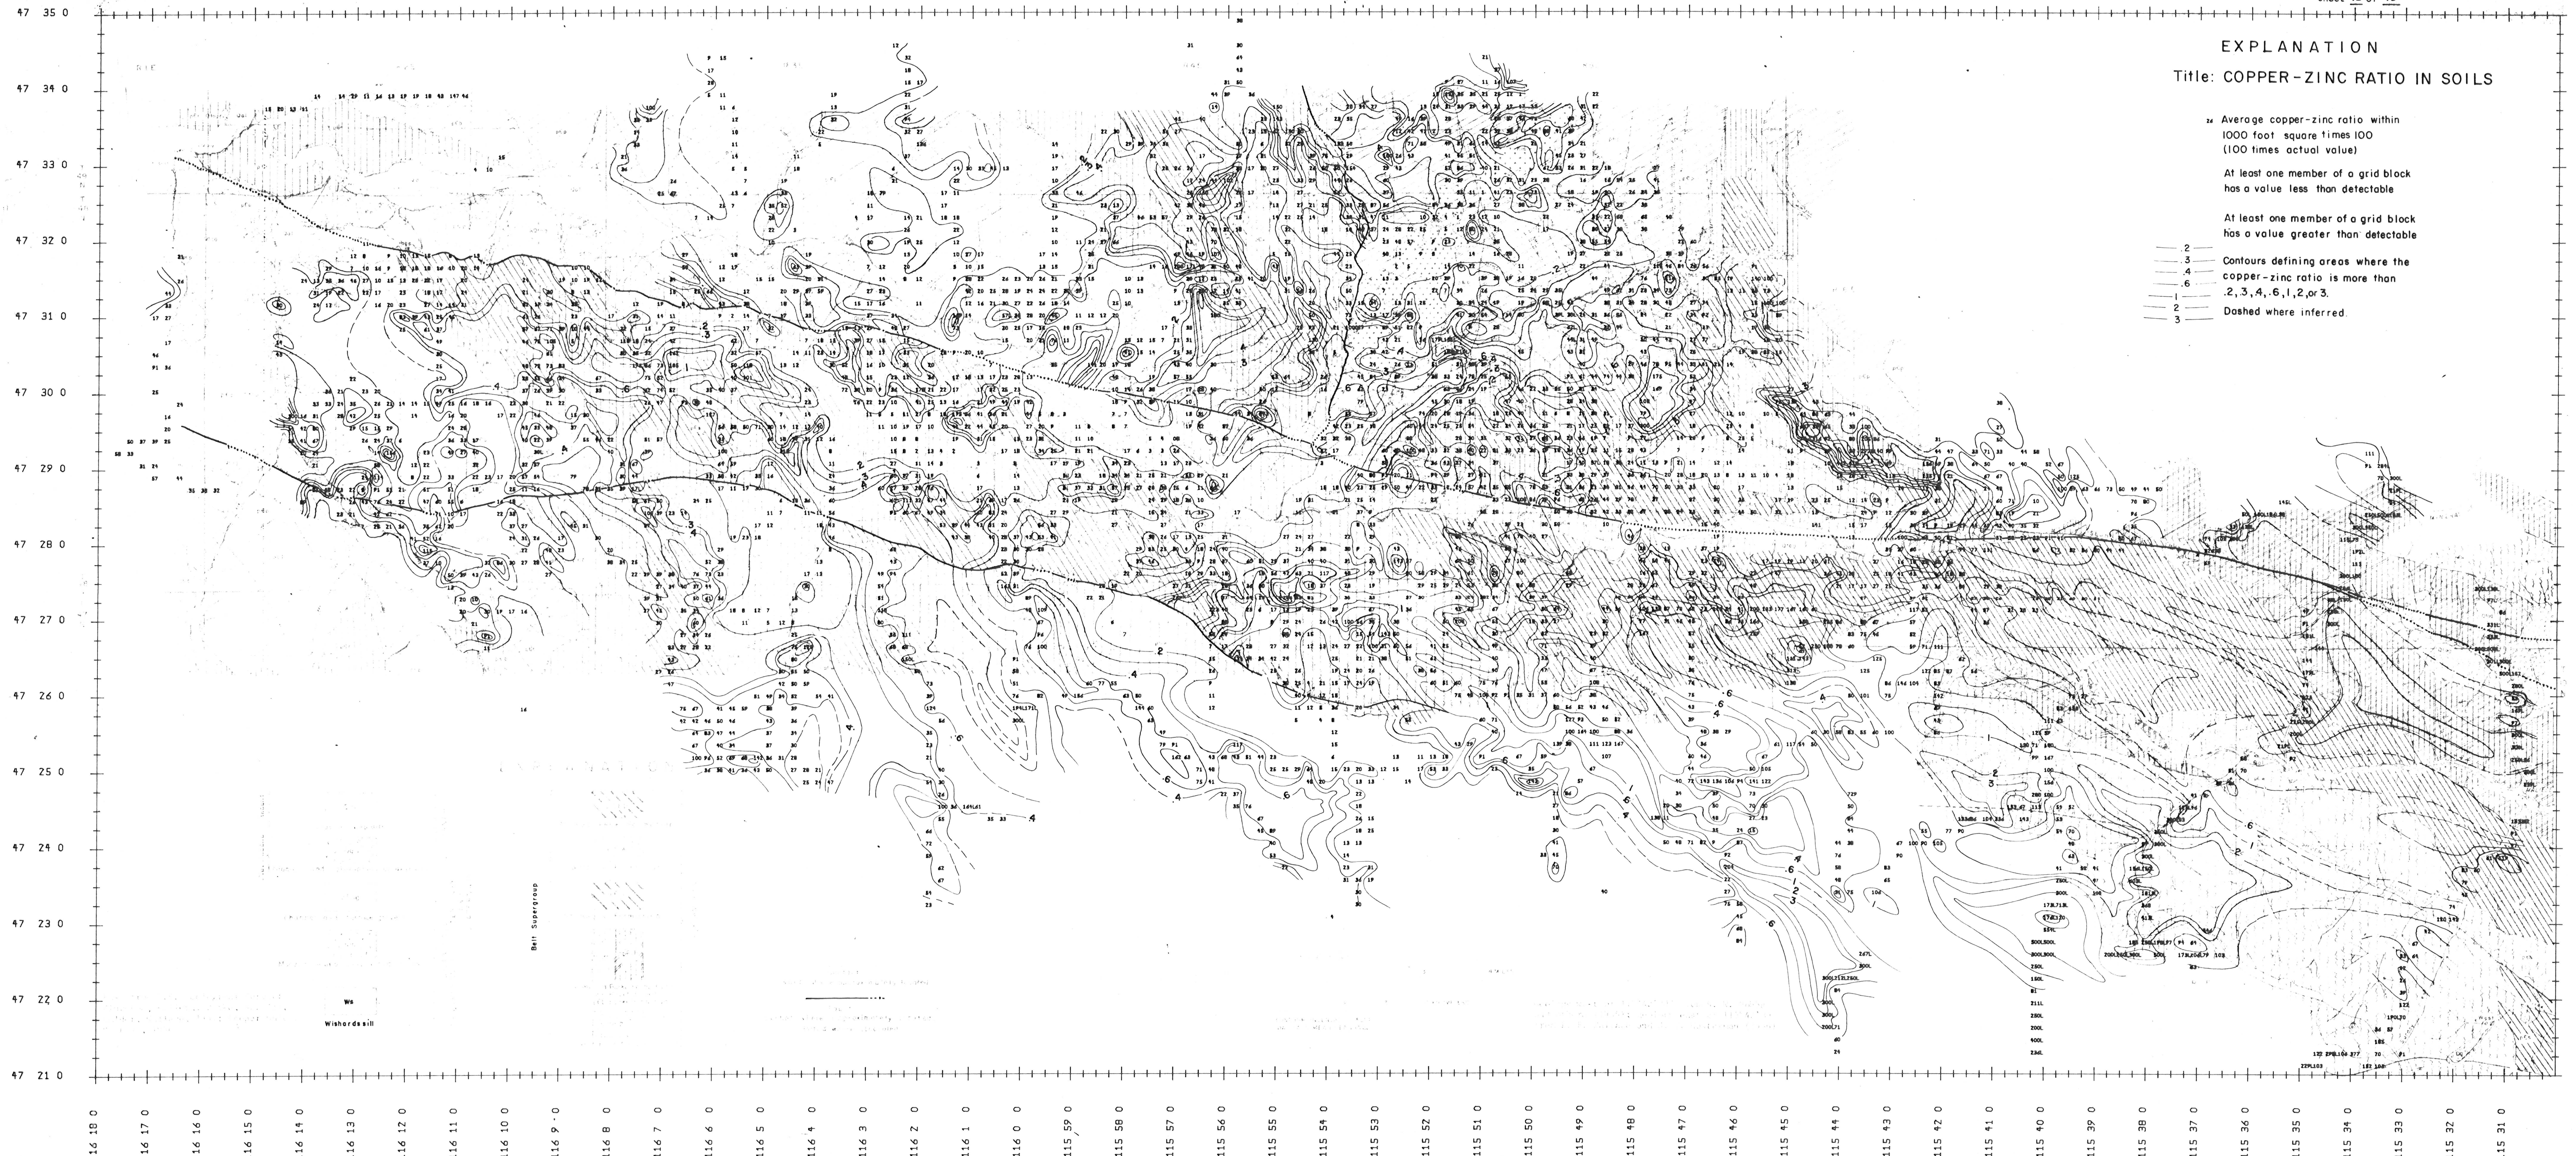

COEUR D'ALENE SOILS, CU/ZN (X100.0) 1/62500