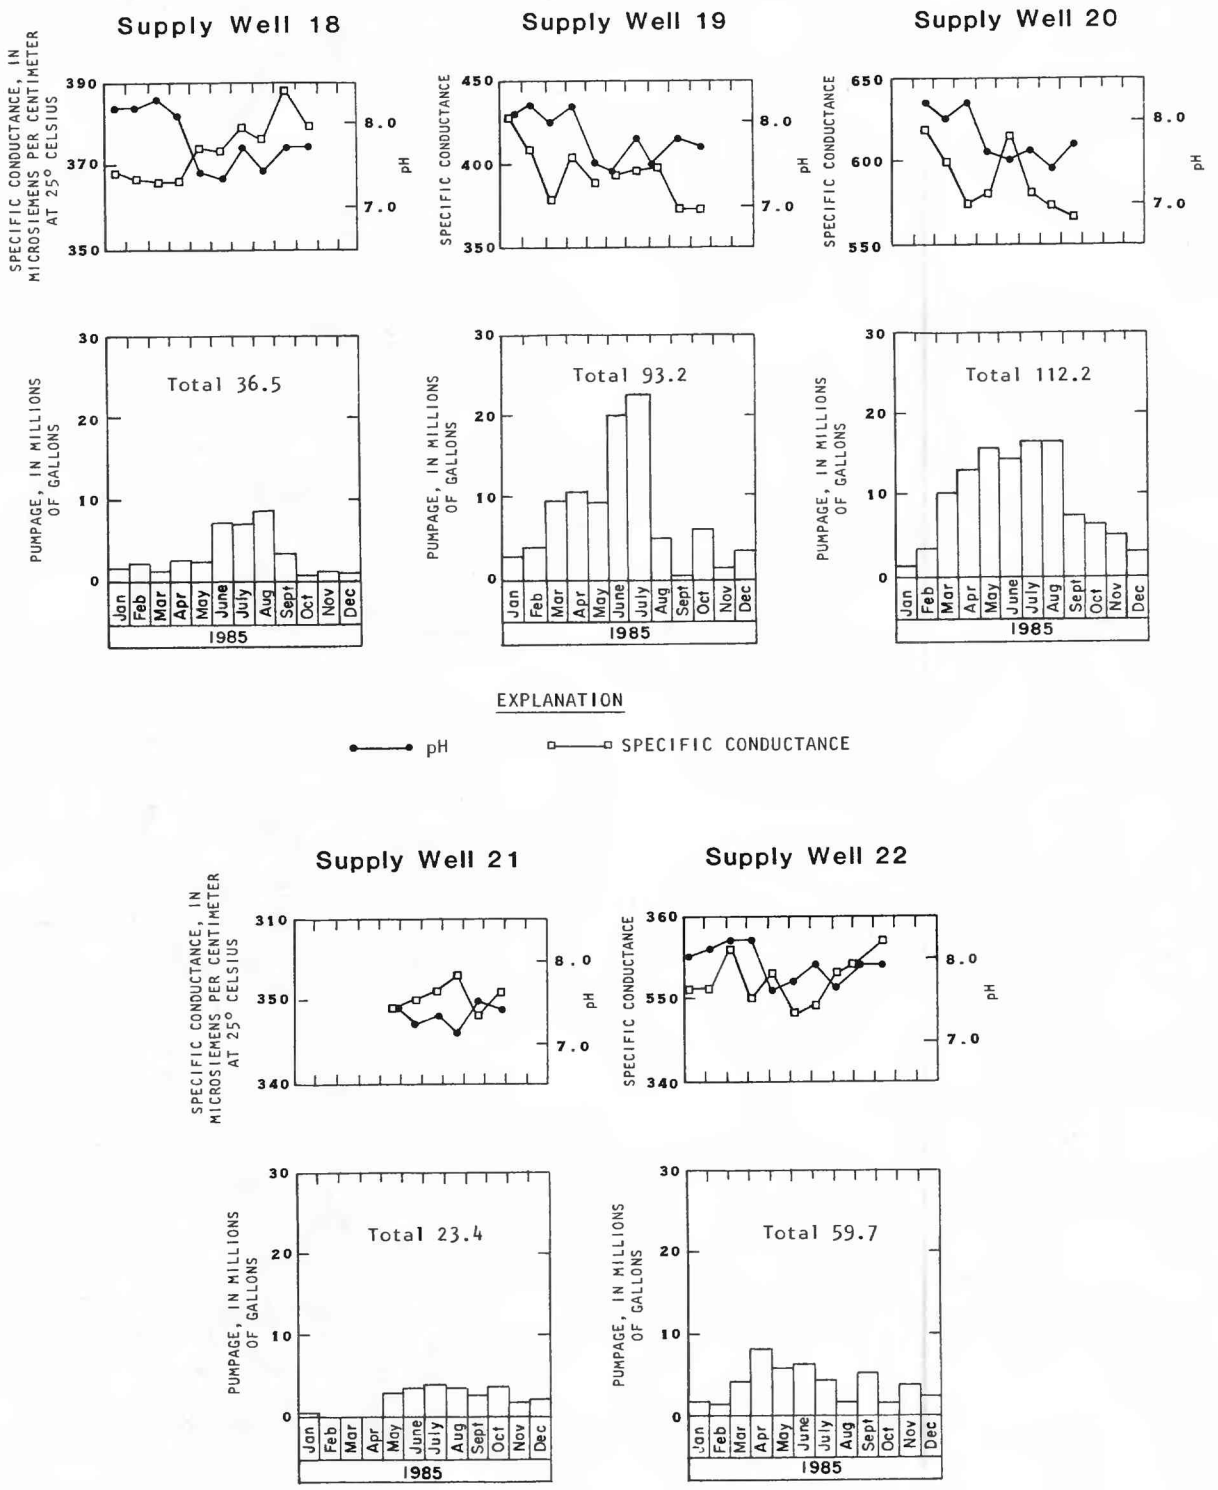

Figure 8.--Monthly specific conductance, pH, and pumpage for Post Headquarters supply wells - Concluded.