


10-87-690  
1989

EXPLANATION

- 0 LIMIT OF CONFINING UNIT SHOWN AS ZERO THICKNESS
- CONFINING UNIT MISSING IN STREAM VALLEY OR OTHER AREA
- 25 LINE OF EQUAL THICKNESS OF CASTLE HAYNE CONFINING UNIT -- Dashed where approximately located. Hachured to indicate where unit is thinner than surrounding area. Interval 25 feet
- 6. WELL AND WELL NUMBER

LIBRARY  
AUG 01 1989  
U.S. GEOLOGICAL SURVEY  
RESTON VA.

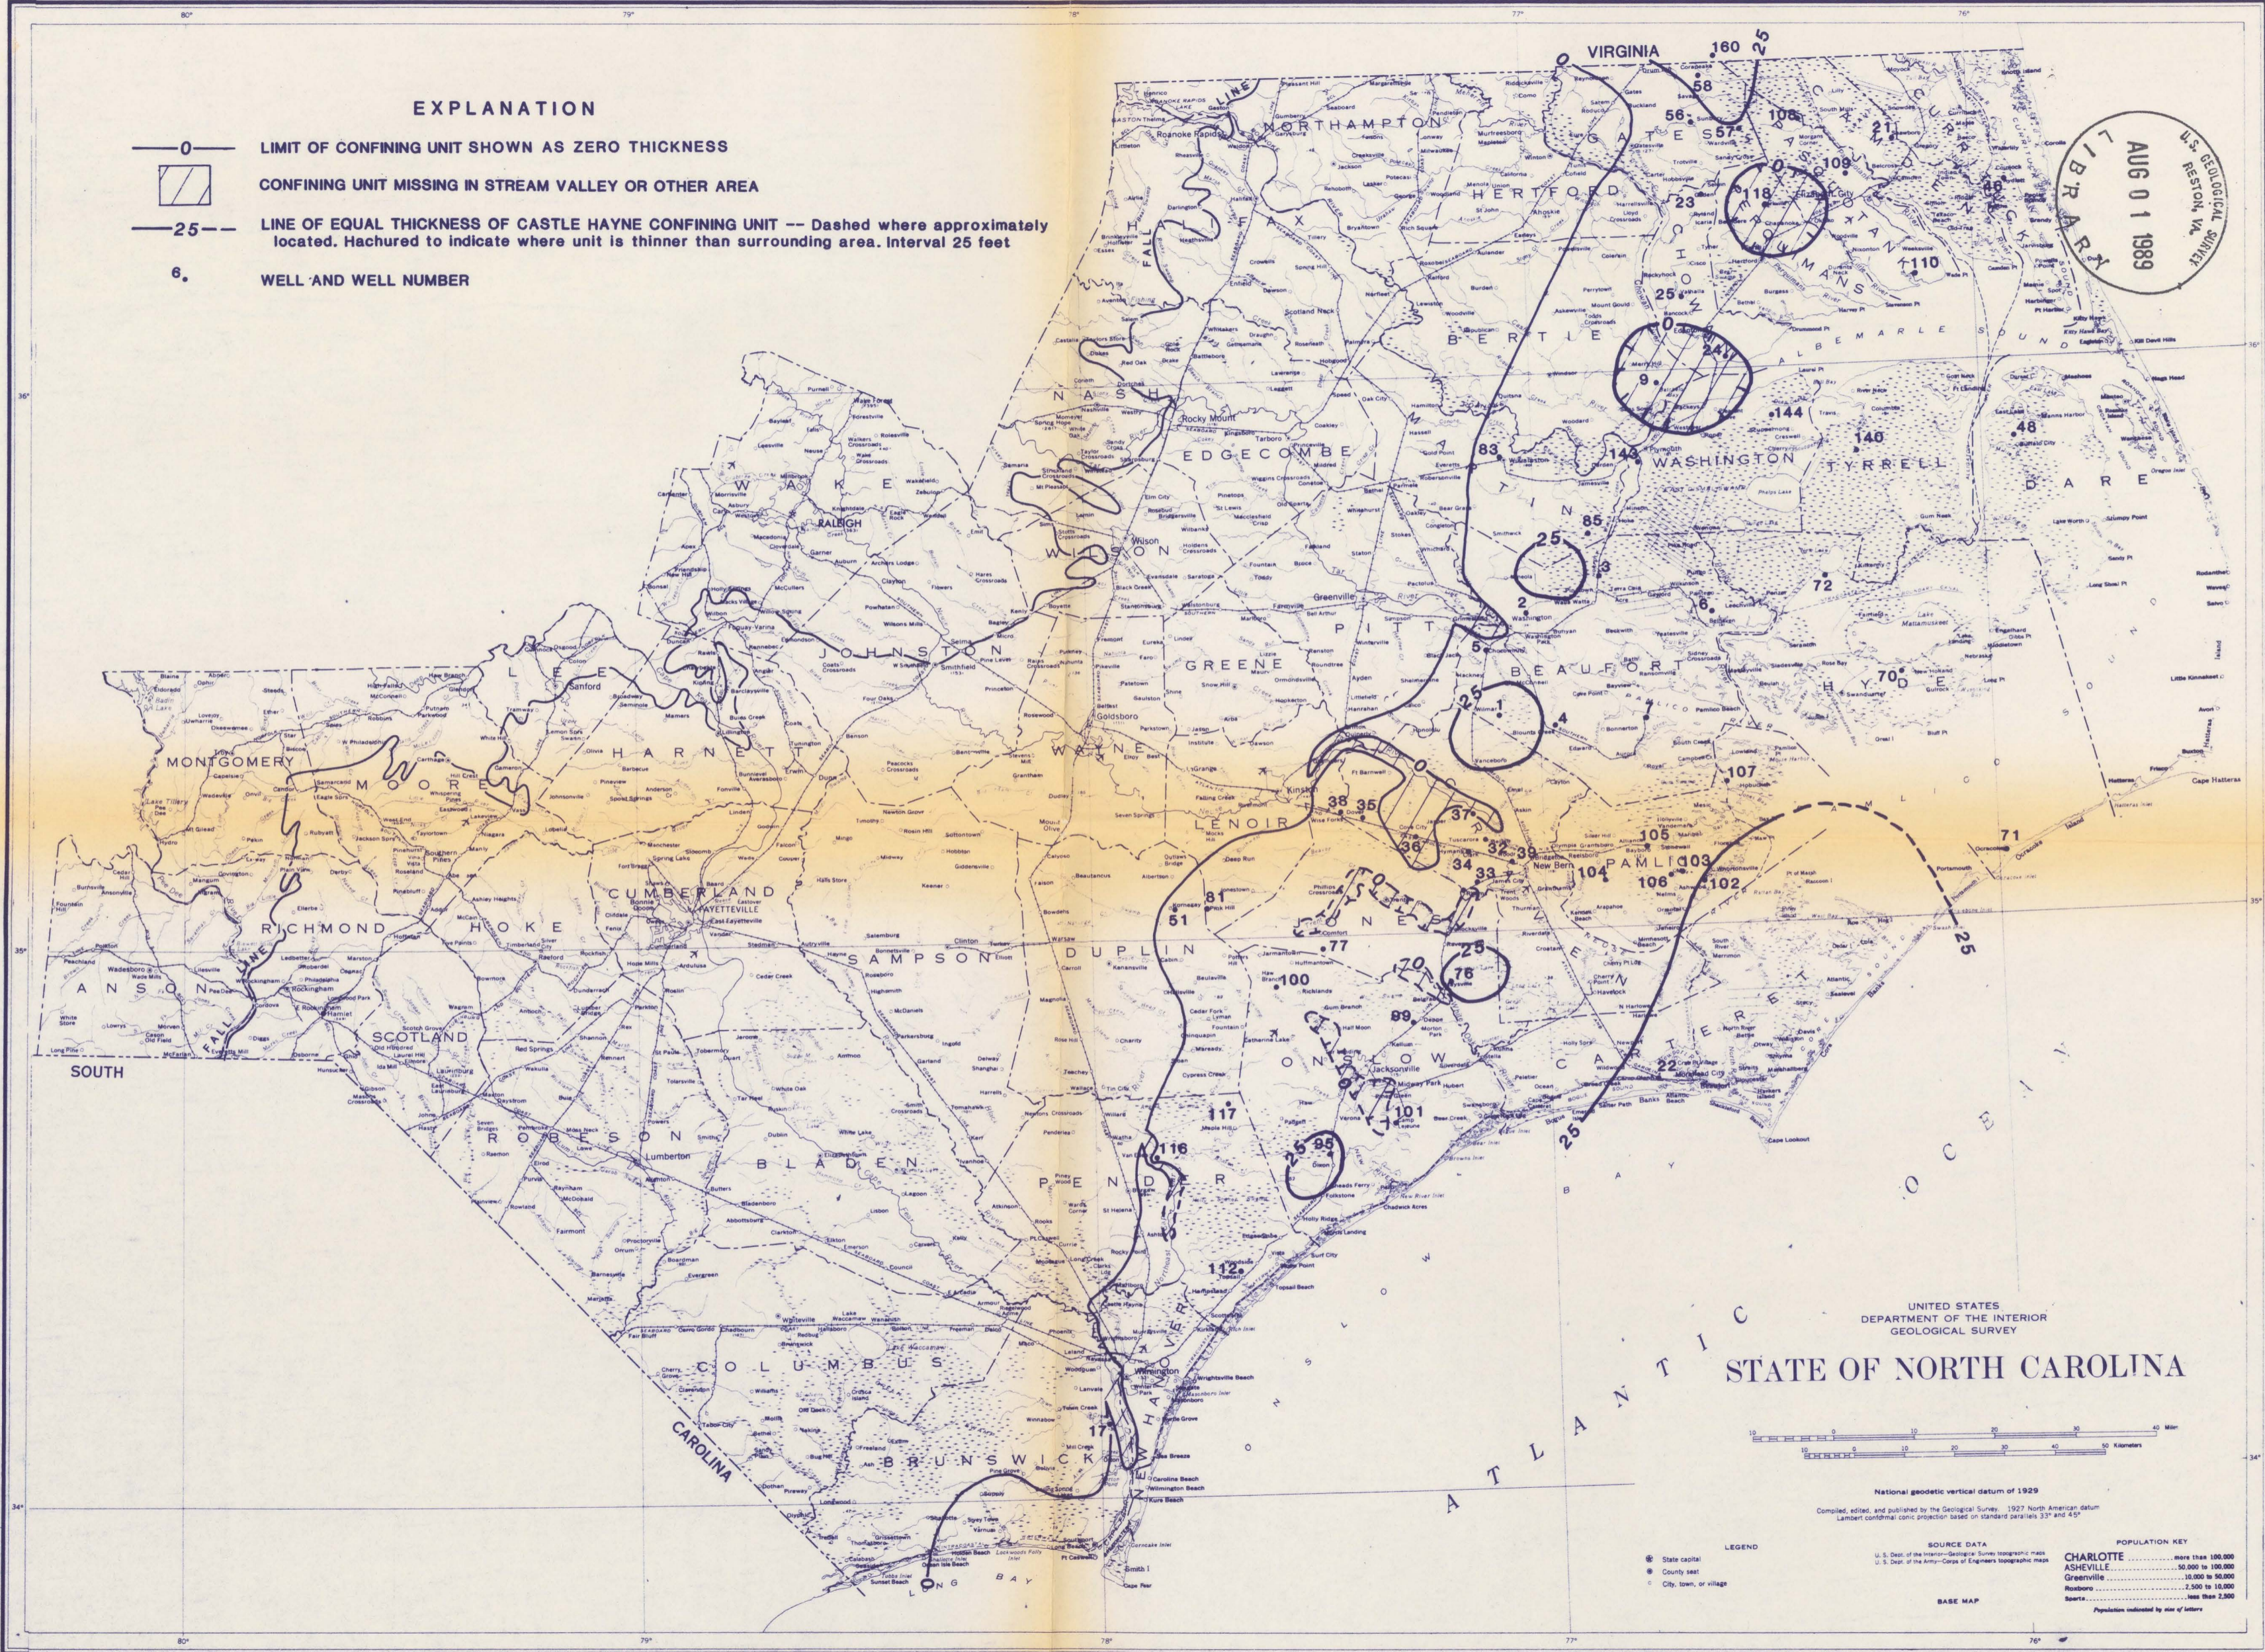

THICKNESS OF THE CASTLE HAYNE CONFINING UNIT