

**STATUS OF GROUND-WATER RESOURCES AT U.S.
NAVY SUPPORT FACILITY, DIEGO GARCIA:
SUMMARY OF HYDROLOGIC AND CLIMATIC
DATA, JANUARY 1993 THROUGH JUNE 1995**

U.S. GEOLOGICAL SURVEY
Open-File Report 95-722

Prepared in cooperation with the
U.S. DEPARTMENT OF THE NAVY
NAVY SUPPORT FACILITY, DIEGO GARCIA

**STATUS OF GROUND-WATER RESOURCES AT U.S.
NAVY SUPPORT FACILITY, DIEGO GARCIA:
SUMMARY OF HYDROLOGIC AND CLIMATIC
DATA, JANUARY 1993 THROUGH JUNE 1995**

by Jill D. Torikai

U.S. GEOLOGICAL SURVEY
Open-File Report 95-722

Prepared in cooperation with the
U.S. DEPARTMENT OF THE NAVY
NAVY SUPPORT FACILITY, DIEGO GARCIA

Honolulu, Hawaii
1995

U.S. DEPARTMENT OF THE INTERIOR
BRUCE BABBITT, Secretary

U.S. GEOLOGICAL SURVEY
Gordon P. Eaton, Director

Any use of trade, product, or firm names in this publication
is for descriptive purposes only and does not imply
endorsement by the U.S. Government.

For sale by the U.S. Geological Survey
Earth Science Information Center
Open-File Reports Section
Box 25286, MS 517
Denver Federal Center
Denver, CO 80225

For additional information write to:
District Chief
U.S. Geological Survey
677 Ala Moana Blvd., Suite 415
Honolulu, HI 96813

CONTENTS

| | Page |
|---|------|
| Executive Summary | 1 |
| Introduction | |
| Background | 2 |
| Organization of Report | 2 |
| Rainfall..... | 4 |
| Ground-Water Withdrawal | 6 |
| Chloride Concentration of Pumped Ground Water | 8 |
| Chloride Concentration of Ground Water in Monitoring Wells..... | 11 |
| Fuel-Diversion Program at Air Operations..... | 14 |
| Hydrologic-Data Section A. Maps of Production and Monitoring Wells at Cantonment and Air Operations | 17 |
| Hydrologic-Data Section B. Graphs of Monthly Mean Ground-Water Withdrawal, January 1993 through June 1995 | 22 |
| Hydrologic-Data Section C. Graphs of Chloride Concentration of Pumped Water, January 1993 through June 1995..... | 33 |
| References Cited | 42 |

FIGURES

| | Page |
|---|------|
| 1. Map showing areas of ground-water production, Diego Garcia..... | 3 |
| 2. Graphs of monthly rainfall and monthly departure from mean monthly rainfall at Air Operations, Diego Garcia, January 1993 through June 1995 | 5 |
| 3. Graphs of monthly mean ground-water withdrawal islandwide and in the ground-water production areas, Diego Garcia, January 1993 through June 1995 | 7 |
| 4. Graphs of chloride concentration of pumped water (sampled at weekly intervals) in the ground-water production areas, Diego Garcia, January 1993 through June 1995 | 9 |
| 5. Graphs of chloride concentration of ground water (sampled at monthly intervals) in monitoring wells at site AW16 at Cantonment, Diego Garcia, January 1993 through June 1995 | 12 |
| 6. Graphs of chloride concentration of ground water (sampled at monthly intervals) in monitoring wells at site BW09 at Air Operations, Diego Garcia, January 1993 through June 1995 | 13 |
| 7. Graphs of monthly mean ground-water withdrawal and injection at wells AO-10 through AO-15 at Air Operations, Diego Garcia, January 1993 through June 1995..... | 15 |

TABLE

| | Page |
|---|------|
| 1. Target and actual withdrawal and injection rates for hydraulic-diversion program | 14 |

CONVERSION FACTORS AND ABBREVIATION

| Multiply | By | To obtain |
|----------------------------------|---------|------------------------|
| foot (ft) | 0.3048 | meter |
| gallon (gal) | 3.785 | liter |
| gallon per day (gal/d) | 3.785 | liter per day |
| million gallons per day (Mgal/d) | 0.04381 | cubic meter per second |
| inch (in.) | 25.4 | millimeter |
| inch per year (in/yr) | 25.4 | millimeter per year |

Abbreviation used in water-quality descriptions

mg/L = milligram per liter

**STATUS OF GROUND-WATER RESOURCES AT
U.S. NAVY SUPPORT FACILITY, DIEGO GARCIA:
SUMMARY OF HYDROLOGIC AND CLIMATIC DATA,
JANUARY 1993 THROUGH JUNE 1995**

EXECUTIVE SUMMARY

This report contains hydrologic and climatic data that describe the status of ground-water resources at U.S. Navy Support Facility, Diego Garcia. Data presented are from January 1993 through June 1995, although the report focuses on hydrologic events from April through June 1995.

1. RAINFALL--Cumulative rainfall for April through June 1995 was about 14 inches which is 70 percent of the mean cumulative rainfall of about 20 inches for the same 3 months in a year. April through June is within the annual dry season. Rainfall for each month was below average from the respective mean monthly rainfall. All mean rainfall values are calculated for the fixed base period 1951-90.
2. GROUND-WATER WITHDRAWAL--Ground-water withdrawal during April through June 1995 averaged 833,700 gallons per day. Withdrawal for the same 3 months in 1994 averaged 950,000 gallons per day.
3. CHLORIDE CONCENTRATION OF PUMPED GROUND WATER--At the end of June 1995, the chloride concentration of the composite water supply was 57 milligrams per liter, well below the 250 milligrams per liter secondary drinking-water standard established by the U.S. Environmental Protection Agency. Chloride concentrations of the composite water supply from April through June 1995 ranged between 26 and 62 milligrams per liter.
4. CHLORIDE CONCENTRATION OF GROUND WATER IN MONITORING WELLS--Chloride concentration of ground water in monitoring wells at Cantonment and Air Operations increased since April 1995, with water from the deepest monitoring wells increasing in chloride concentration by about 1000 milligrams per liter.
5. FUEL-DIVERSION PROGRAM AT AIR OPERATIONS--A fuel leak at Air Operations caused the shutdown of ten wells in May 1991. Four of the wells resumed pumping for water-supply purposes in April 1992. The remaining six wells are being used to hydraulically contain and divert fuel migration away from water-supply wells by recirculating about 150,000 gallons of water each day.

**STATUS OF GROUND-WATER RESOURCES AT
U.S. NAVY SUPPORT FACILITY, DIEGO GARCIA:
SUMMARY OF HYDROLOGIC AND CLIMATIC DATA,
JANUARY 1993 THROUGH JUNE 1995**

By Jill D. Torikai

INTRODUCTION

Background

Diego Garcia Atoll is a British Indian Ocean Territory and the site of a U.S. Navy Support Facility. The island's drinking-water supply is derived from ground water by a system of more than 100 shallow wells in five production areas (fig. 1). Water from the Cantonment and Air Operations areas combined account for about 99 percent of total island pumpage. The remainder is pumped for local use at Industrial Site South, Transmitter Site, and GEODSS Site. The system has been in operation since 1978 and has provided about 1 Mgal/d since 1984.

Long-term ground-water management has been facilitated by a cooperative agreement between the Navy Support Facility and the U.S. Geological Survey (USGS) since 1984. The Diego Garcia Long-Term Ground-Water Management Program involves data collection and analysis of daily rainfall, daily pumpage from individual wells, and chloride concentrations of water from all production and monitoring wells. The data are provided to the USGS by the Navy Support Facility, Public Works Department on Diego Garcia. The data are analyzed for hydrologic responses to pumping and climatic variability, and recent trends in the data are identified. This report is part of a series of quarterly data reports regarding Diego Garcia.

Organization of Report

This data summary contains hydrologic and climatic data that describe the status of ground-water resources at Navy Support Facility, Diego Garcia. Data presented are from January 1993 through June 1995. Data of primary relevance to the water supply are:

1. Rainfall
2. Volume of ground water withdrawn at production wells
3. Chloride concentration of pumped ground water
4. Chloride concentration of ground water sampled from monitoring wells
5. Volume of ground water injected at Air Operations

The following narrative highlights trends in the data for April through June 1995. Ground-water withdrawal and chloride concentrations of water from individual wells are presented in the "Hydrologic-Data Section." The data section contains the following:

- A. Maps of production and monitoring wells at Cantonment and Air Operations
- B. Graphs of monthly mean ground-water withdrawal, January 1993 through June 1995
- C. Graphs of chloride concentration of pumped water, January 1993 through June 1995

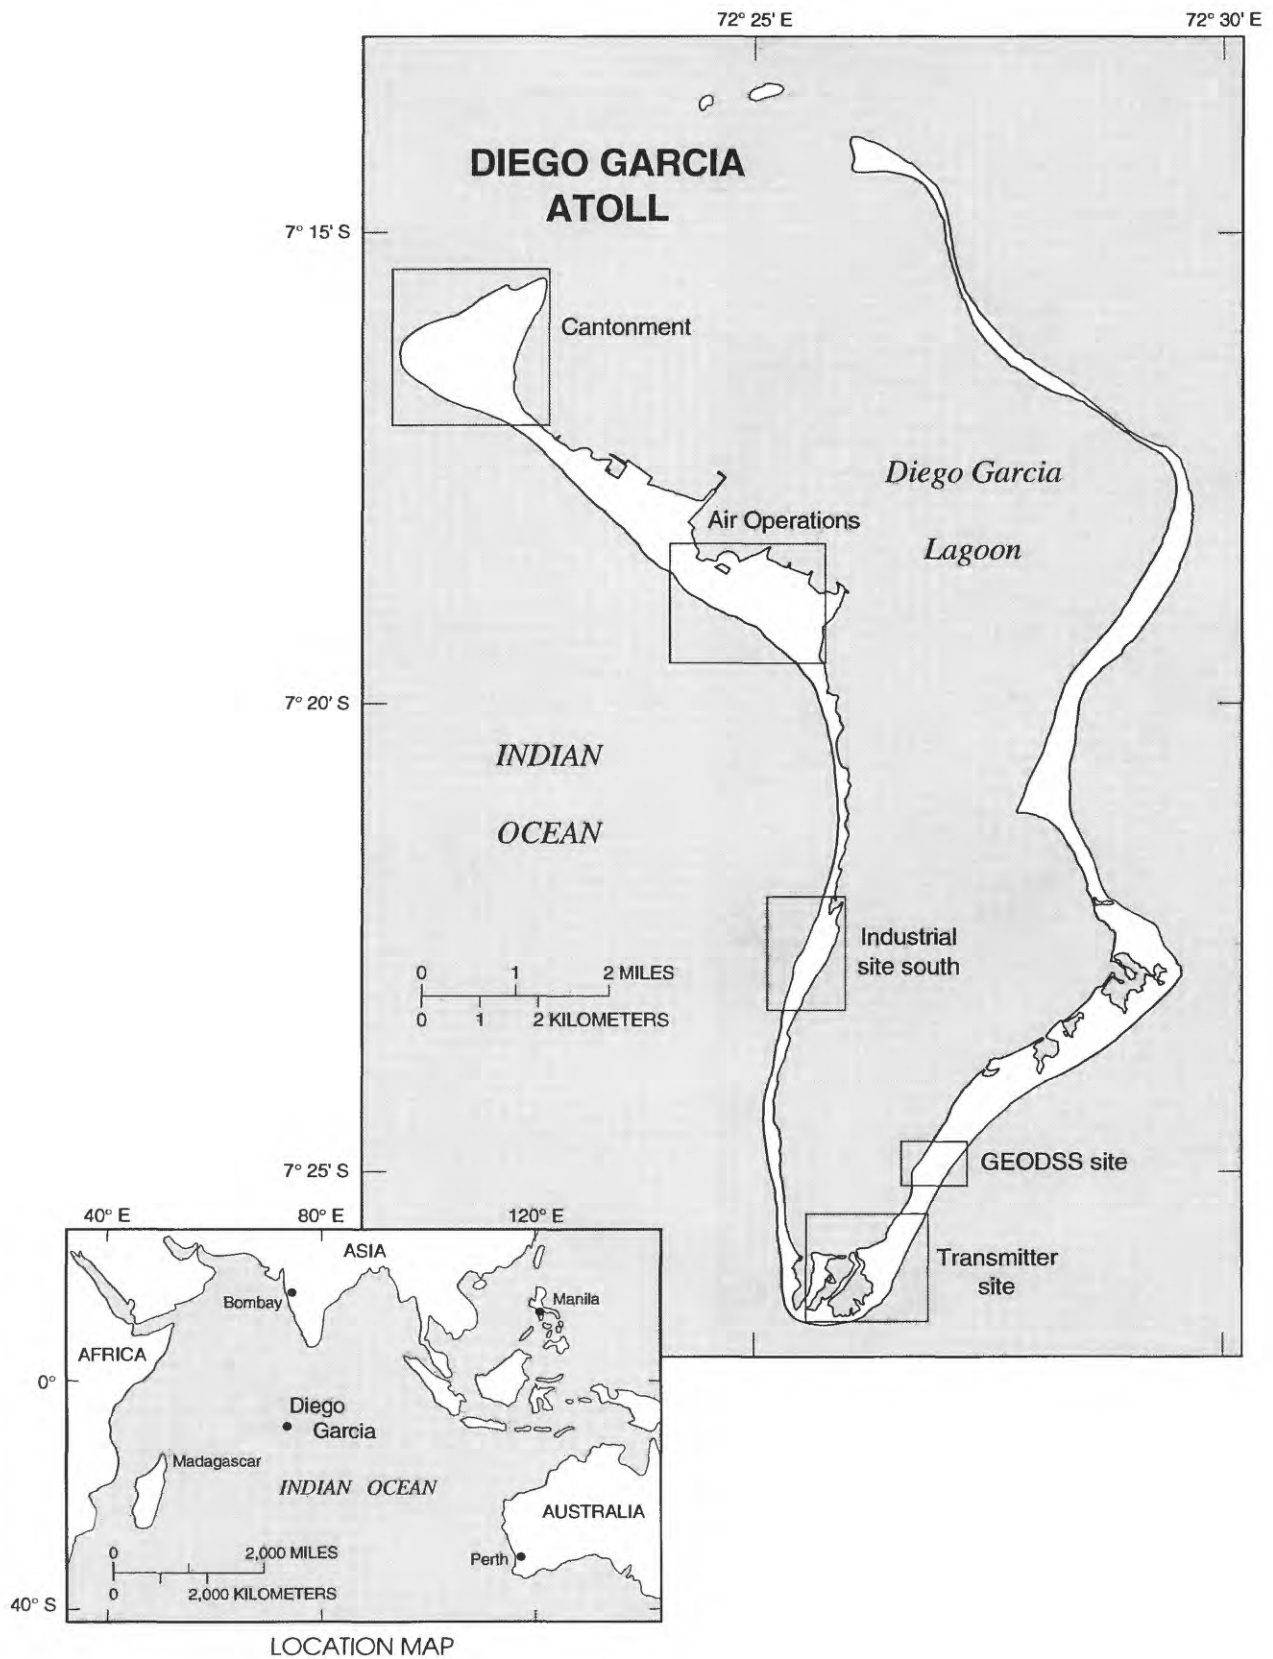


Figure 1. Areas of ground-water production, Diego Garcia.


RAINFALL

Background.--Rainfall data are available since 1951, and all mean rainfall values are calculated for the fixed base period 1951-90. The mean annual rainfall at Diego Garcia is 105.78 in/yr. Rainfall varies considerably from month to month and from year to year. A wet season occurs from about September through February, and a dry season occurs from about March through August.

Recent trends.--Cumulative rainfall for April through June 1995 was 13.67 inches which is less than the mean cumulative rainfall of 20.21 inches for the same 3 months of a year. For the same 3 months in 1993 and 1994, the cumulative rainfall was 28.93 inches and 13.27 inches, respectively. In 1993, the total rainfall of 94.77 inches was 10 percent below the mean annual rainfall, while in 1994 the total rainfall of 131.17 inches was 24 percent above the mean.

Figure 2 shows graphs of recorded rainfall amounts and rainfall departures from mean monthly rainfall values that were averaged for the base period 1951-90. Periods of below average rainfall can be inferred from the graph when the departure from the mean monthly rainfall is less than zero. Monthly rainfall for April through June 1995 was less than the mean monthly rainfall for each month.

RAINFALL, IN INCHES

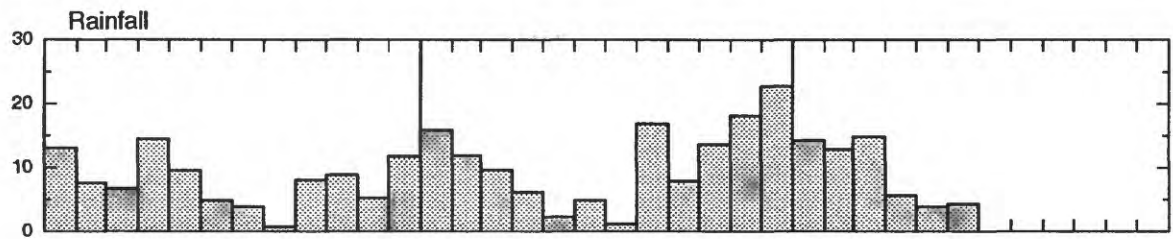

DEPARTURE, IN INCHES

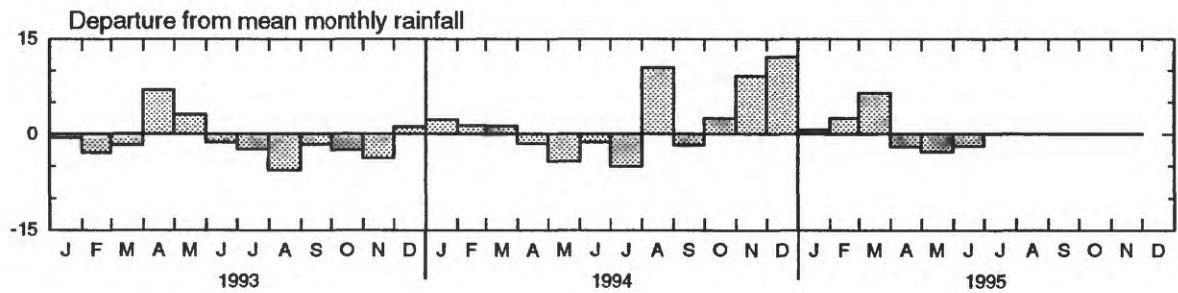


Figure 2. Monthly rainfall and monthly departure from mean monthly rainfall at Air Operations, Diego Garcia, January 1993 through June 1995.

GROUND-WATER WITHDRAWAL

Background.--Withdrawal is measured by flow meters at all production wells and storage tanks in the water system, and is recorded daily. There are 102 production wells that are situated in five ground-water production areas, of which 80 wells are in the Cantonment area and 18 are in the Air Operations area (figs. A1, A2). The wells in the Cantonment area are further divided into sub-groups, and the measured ground-water withdrawals are reported as such in this summary.

Recent trends.--Figure 3 shows time-series graphs of monthly mean withdrawal islandwide and in each ground-water production area from January 1993 through June 1995. Patterns of withdrawal during the second quarter of 1995 have not changed significantly since 1993 in all areas. Small increases in withdrawal have occurred at Transmitter Site and GEODSS Site, but water from these two areas are for localized use only. Total islandwide withdrawal decreased from 950,000 gal/d during April through June 1994 to 833,700 gal/d during April through June 1995.

Pumpage from the Cantonment area increased in 1991 when the area began supplying an extra demand due to decreased pumpage at Air Operations (Torikai, 1995). Ten wells at Air Operations were temporarily closed from May 1991 through April 1992 due to an underground fuel pipeline leak near those wells. Pumping has since resumed at four wells in the water-supply system, but six Air Operations wells still do not pump to the water supply because of the close proximity to the fuel leak. Ground-water withdrawals from the other ground-water production areas have been held at fairly regular rates since 1992.

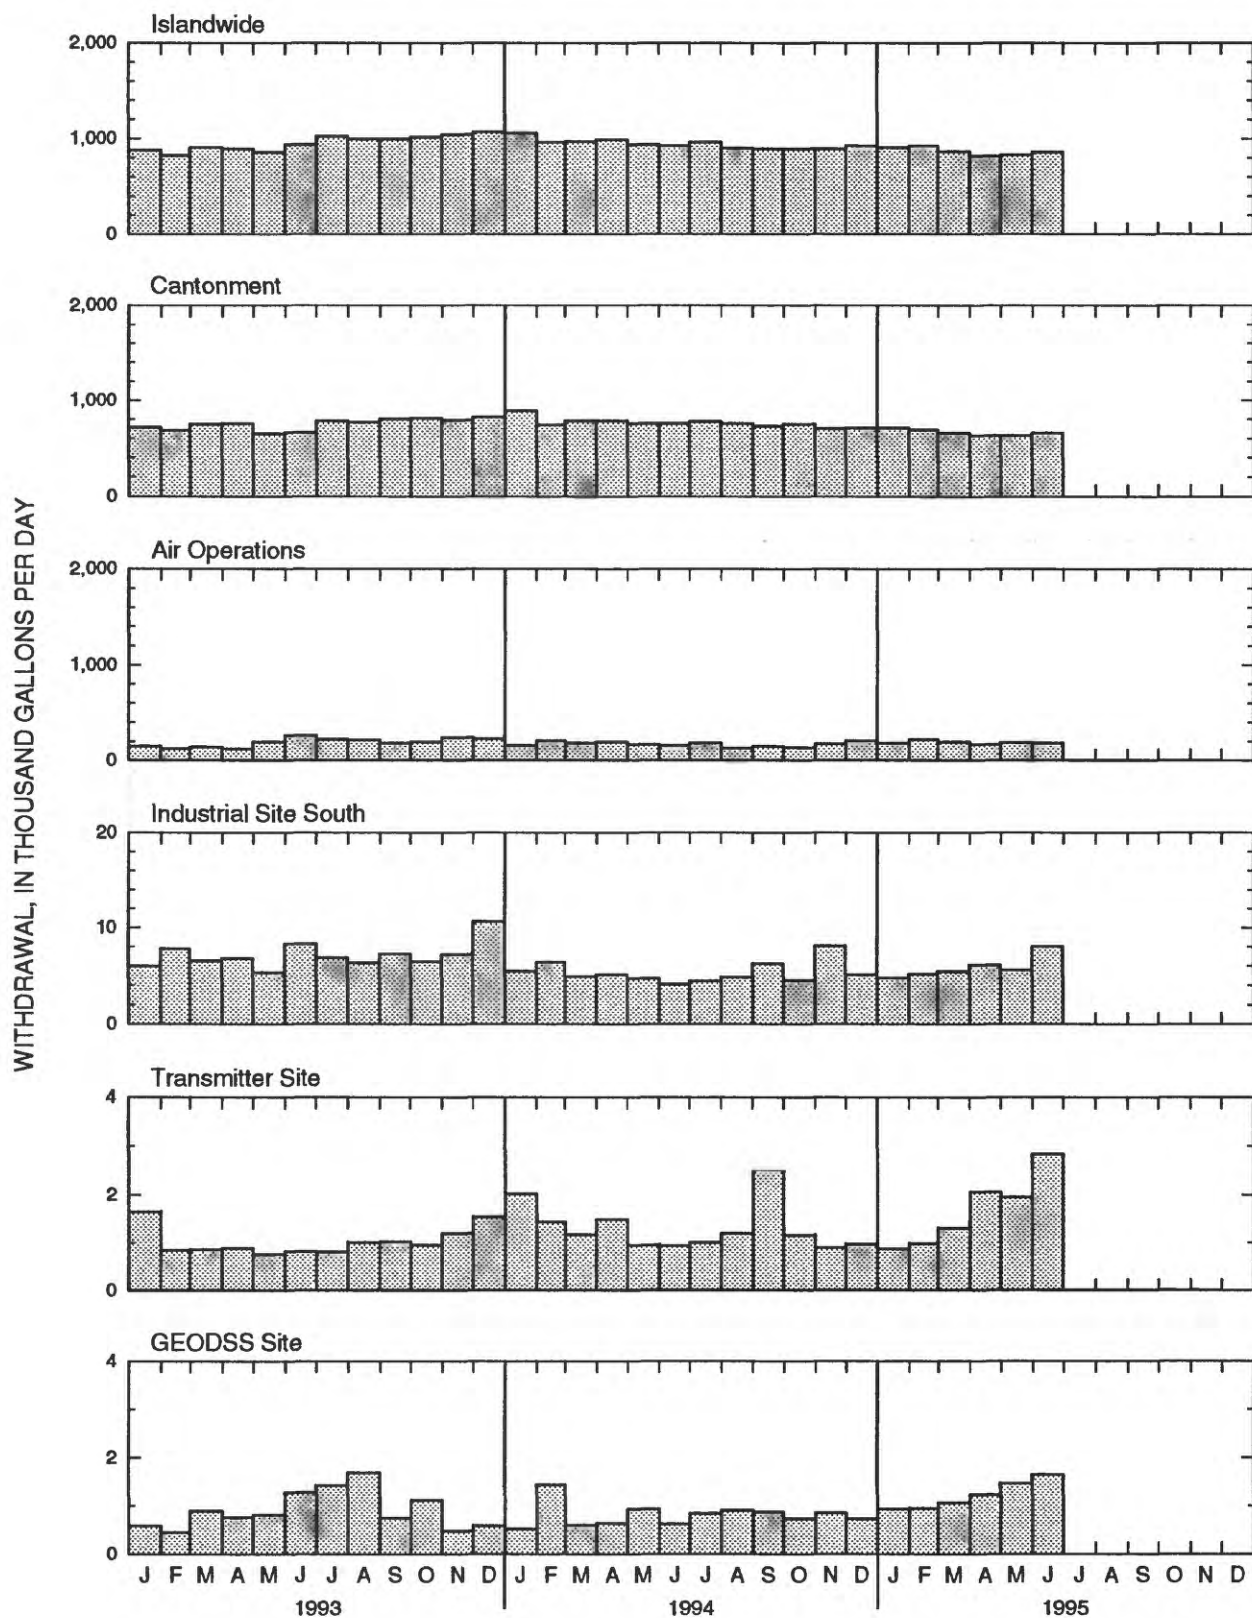


Figure 3. Monthly mean ground-water withdrawal islandwide and in the ground-water production areas, Diego Garcia, January 1993 through June 1995.

CHLORIDE CONCENTRATION OF PUMPED GROUND WATER


Background.--Chloride concentration is used as a quantitative measure of salinity in this report. Chloride concentration in seawater at Diego Garcia is about 19,500 mg/L whereas a concentration of 250 mg/L is the maximum contaminant level (MCL) under secondary drinking-water standards (U.S. Environmental Protection Agency, 1991). Secondary standards are not enforceable limits, but instead establish goals for constituents that may affect the aesthetic qualities of drinking water, such as taste or color.

Water is sampled at weekly intervals at all wells and storage tanks in the production system. Water in the Air Operations tank is a blend of ground water withdrawn from wells in the Air Operations area only, whereas the Cantonment tank water is a mixture of ground water from wells in both the Air Operations and Cantonment areas. This composite tank transmits about 99 percent of total island pumpage. Thus, the chloride concentration of water sampled from the Cantonment tank is considered representative of the overall water supply.

Recent trends.--The chloride concentration of the composite water supply at the end of June 1995 was 57 mg/L, well below the 250 mg/L secondary drinking-water standard. The range of chloride concentrations for the composite water supply ranged from 26 to 62 mg/L from April through June 1995 (fig. 4). Chloride concentrations of the composite water in the Cantonment tank has remained at less than 100 mg/L since 1990, whereas the chloride concentration of water sampled from the Air Operations tank has fluctuated between about 50 to 200 mg/L since 1992 (Torikai, 1995). During the second quarter of 1995, which occurs during the dry season, chloride concentrations at the Air Operations tank has increased from about 50 mg/L during the first quarter to about 100 mg/L in June 1995. Chloride concentrations of water sampled from Industrial Site South, Transmitter Site, and GEODSS Site increased by as much as 100 mg/L during the second quarter.

Increases in chloride concentration of as much as 50 mg/L occurred in Modules A through L and in wells H1 through H5 and H7 at Cantonment during second quarter 1995 (figs. C1 and C2). Increases of several hundred mg/L occurred in well H6, and in Q1, Q2, Q4, and Q6 at Cantonment (figs. C2 and C3). Chloride concentrations in Air Operations wells also increased, with the largest increases occurring in wells AO-6 through AO-9 (fig. C4).

RAINFALL, IN INCHES

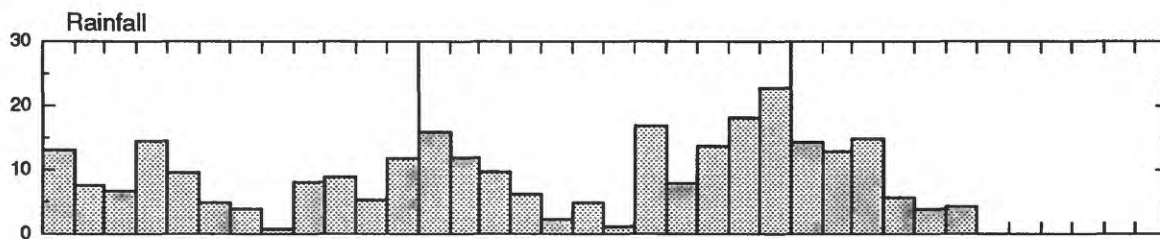

CHLORIDE CONCENTRATION, IN MILLIGRAMS PER LITER


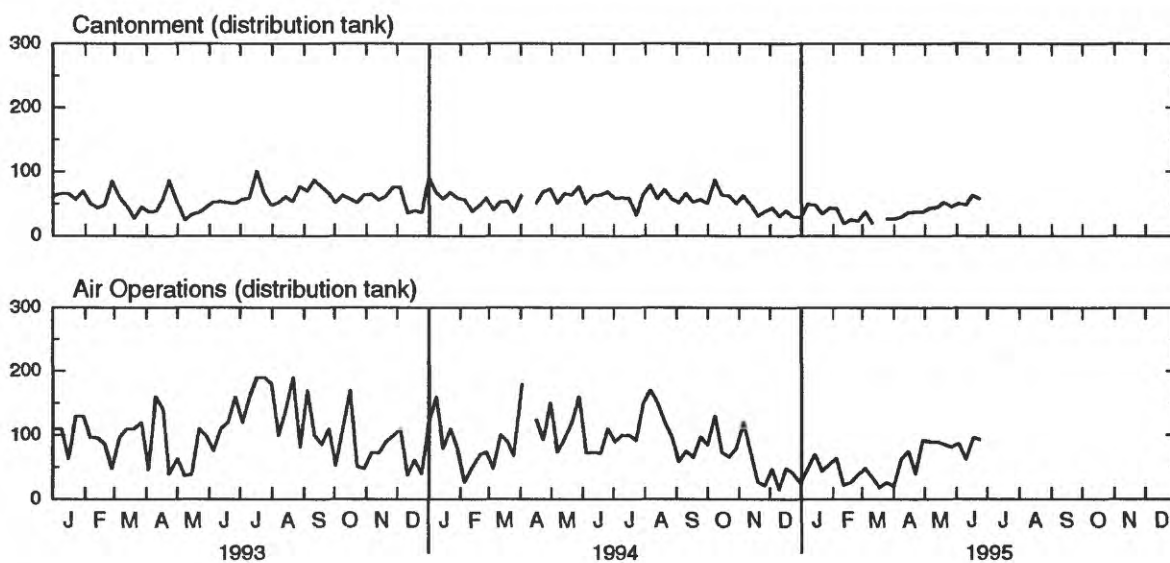


Figure 4. Chloride concentration of pumped water (sampled at weekly intervals) in the ground-water production areas, Diego Garcia, January 1993 through June 1995. Rainfall data are shown for comparison.

RAINFALL, IN INCHES

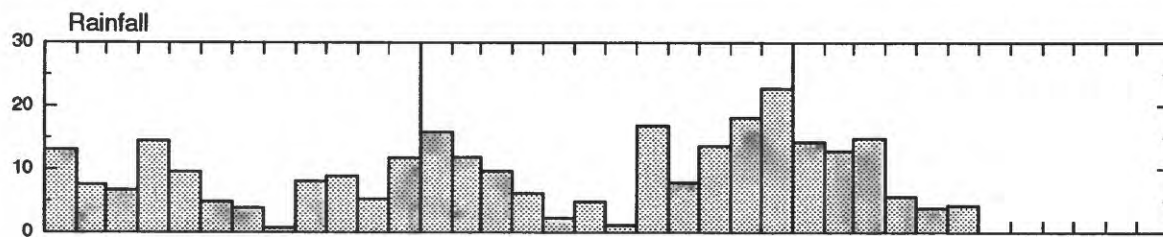

CHLORIDE CONCENTRATION, IN MILLIGRAMS PER LITER

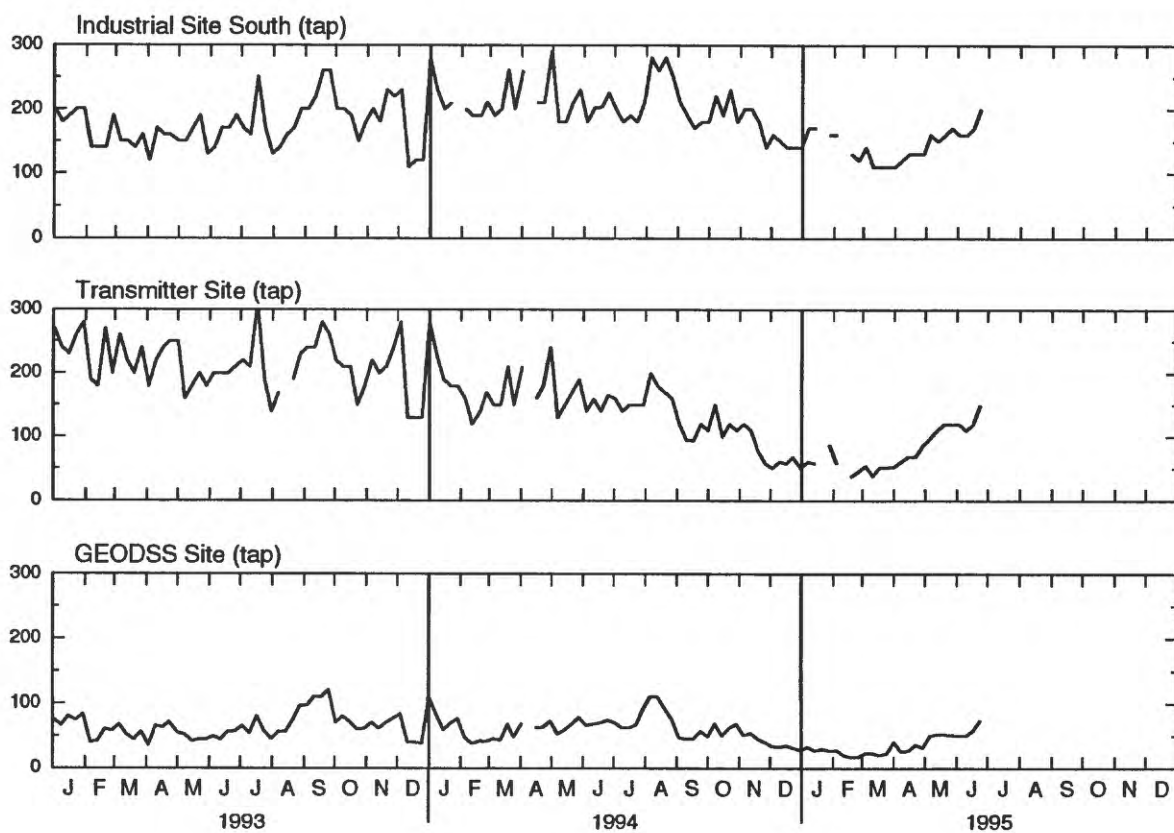


Figure 4 continued.--Chloride concentration of pumped water (sampled at weekly intervals) in the ground-water production areas, Diego Garcia, January 1993 through June 1995. Rainfall data are shown for comparison.

CHLORIDE CONCENTRATION OF GROUND WATER IN MONITORING WELLS

Background.--Ground-water chloride concentration is measured monthly at 35 monitoring-well sites to help estimate freshwater-lens thickness and indicate possible saltwater upconing due to above average pumping (figs. A3, A4). Each site comprises several wells, with each well having a short screened (open) interval that bottoms at a different depth. The deeper wells typically tap the freshwater-saltwater mixing zone that underlies the freshwater lenses.

Recent trends.--Monitoring sites AW16 and BW09 were selected to show trends in ground-water chloride concentration at Cantonment and Air Operations Areas, respectively. Figures 5 and 6 show time-series graphs of chloride concentration at different depths at these sites, with rainfall data included in the figures for climatic reference. Chloride concentrations of the water increased at both sites during April through June 1995, with the deepest monitoring wells showing increases of about 1000 mg/L. A general trend of increasing chloride concentrations was observed in the deepest monitoring wells since the 1992 dry season. However, during November 1994 through March 1995, these same wells showed declines in chloride concentrations by as much as 4000 mg/L from values recorded earlier in 1994.


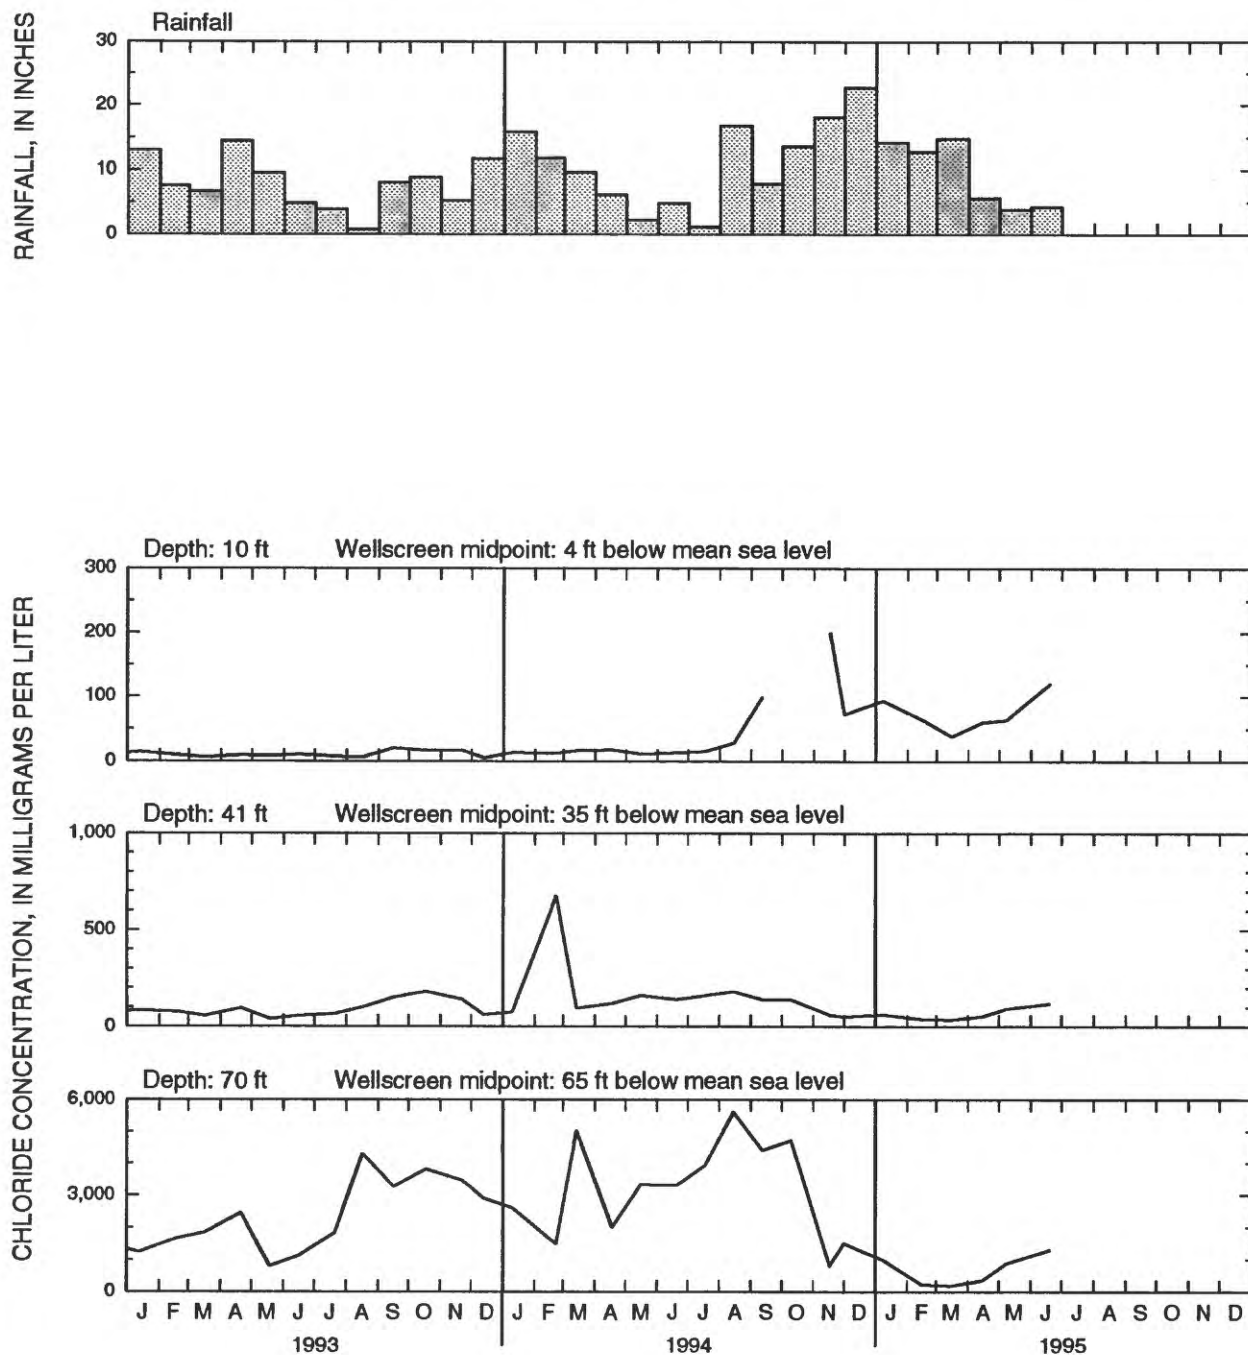


Figure 5. Chloride concentration of ground water (sampled at monthly intervals) in monitoring wells at site AW16 at Cantonment, Diego Garcia, January 1993 through June 1995. Rainfall data are shown for comparison.

RAINFALL, IN INCHES

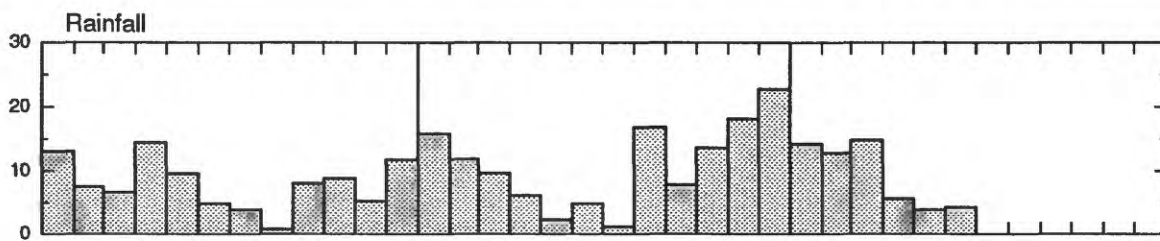

CHLORIDE CONCENTRATION, IN MILLIGRAMS PER LITER

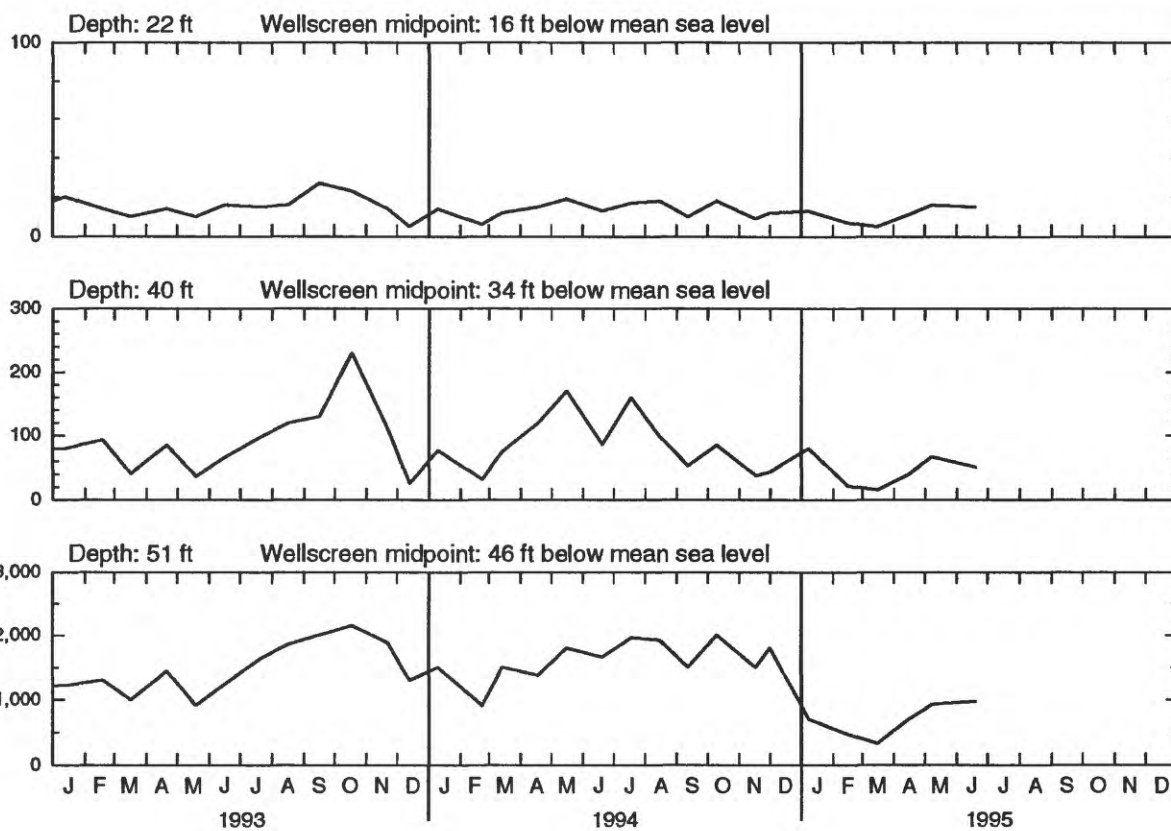


Figure 6. Chloride concentration of ground water (sampled at monthly intervals) in monitoring wells at site BW09 at Air Operations, Diego Garcia, January 1993 through June 1995. Rainfall data are shown for comparison.

FUEL-DIVERSION PROGRAM AT AIR OPERATIONS

Background.--The normal pattern of ground-water withdrawal at Air Operations has been disrupted since May 1991 by a jet-fuel leak at the South Ramp Parking Apron (fig. A2). In April 1992, a program was initiated to hydraulically divert fuel away from the production wells. The fuel-diversion program consists of pumping water from wells AO-14 and AO-15 and directing this water through the common collection main to the wells nearest the leak (AO-10, 11, 12), where it is injected back into the aquifer. Wells AO-10 through AO-15 were shut down from May 1991 to April 1992, but have since been used in the closed recirculation loop of withdrawal and injection.

Injection data for wells AO-10, 11, 12 from May 10, 1993 through September 1994 are actual water-meter readings. From April 1992 through early May 1993, meter readings of injection were not available, and daily injection at each of the three wells was estimated to be one-third of the total daily withdrawal from wells AO-13, 14, 15 which provided the injection-supply water. Monthly mean withdrawal and injection at wells AO-10 through AO-15 are shown in figure 7.

Recent trends.--Withdrawal and injection rates for the hydraulic-diversion program are based on target rates for wells AO-10 through AO-15, with total water recirculation of about 150,000 gal/d (table 1).

Table 1. Target and actual withdrawal and injection rates for hydraulic-diversion program.
[Injection is denoted by negative values; all values are in gallons per day.]

| Well | Target rates | Daily mean rates, April through June 1995 |
|-------|--------------|--|
| AO-10 | -30,000 | -27,800 |
| AO-11 | -50,000 | -52,200 |
| AO-12 | -70,000 | -63,400 |
| AO-13 | 0 | 0 |
| AO-14 | 70,000 | 72,100 |
| AO-15 | 80,000 | 82,500 |

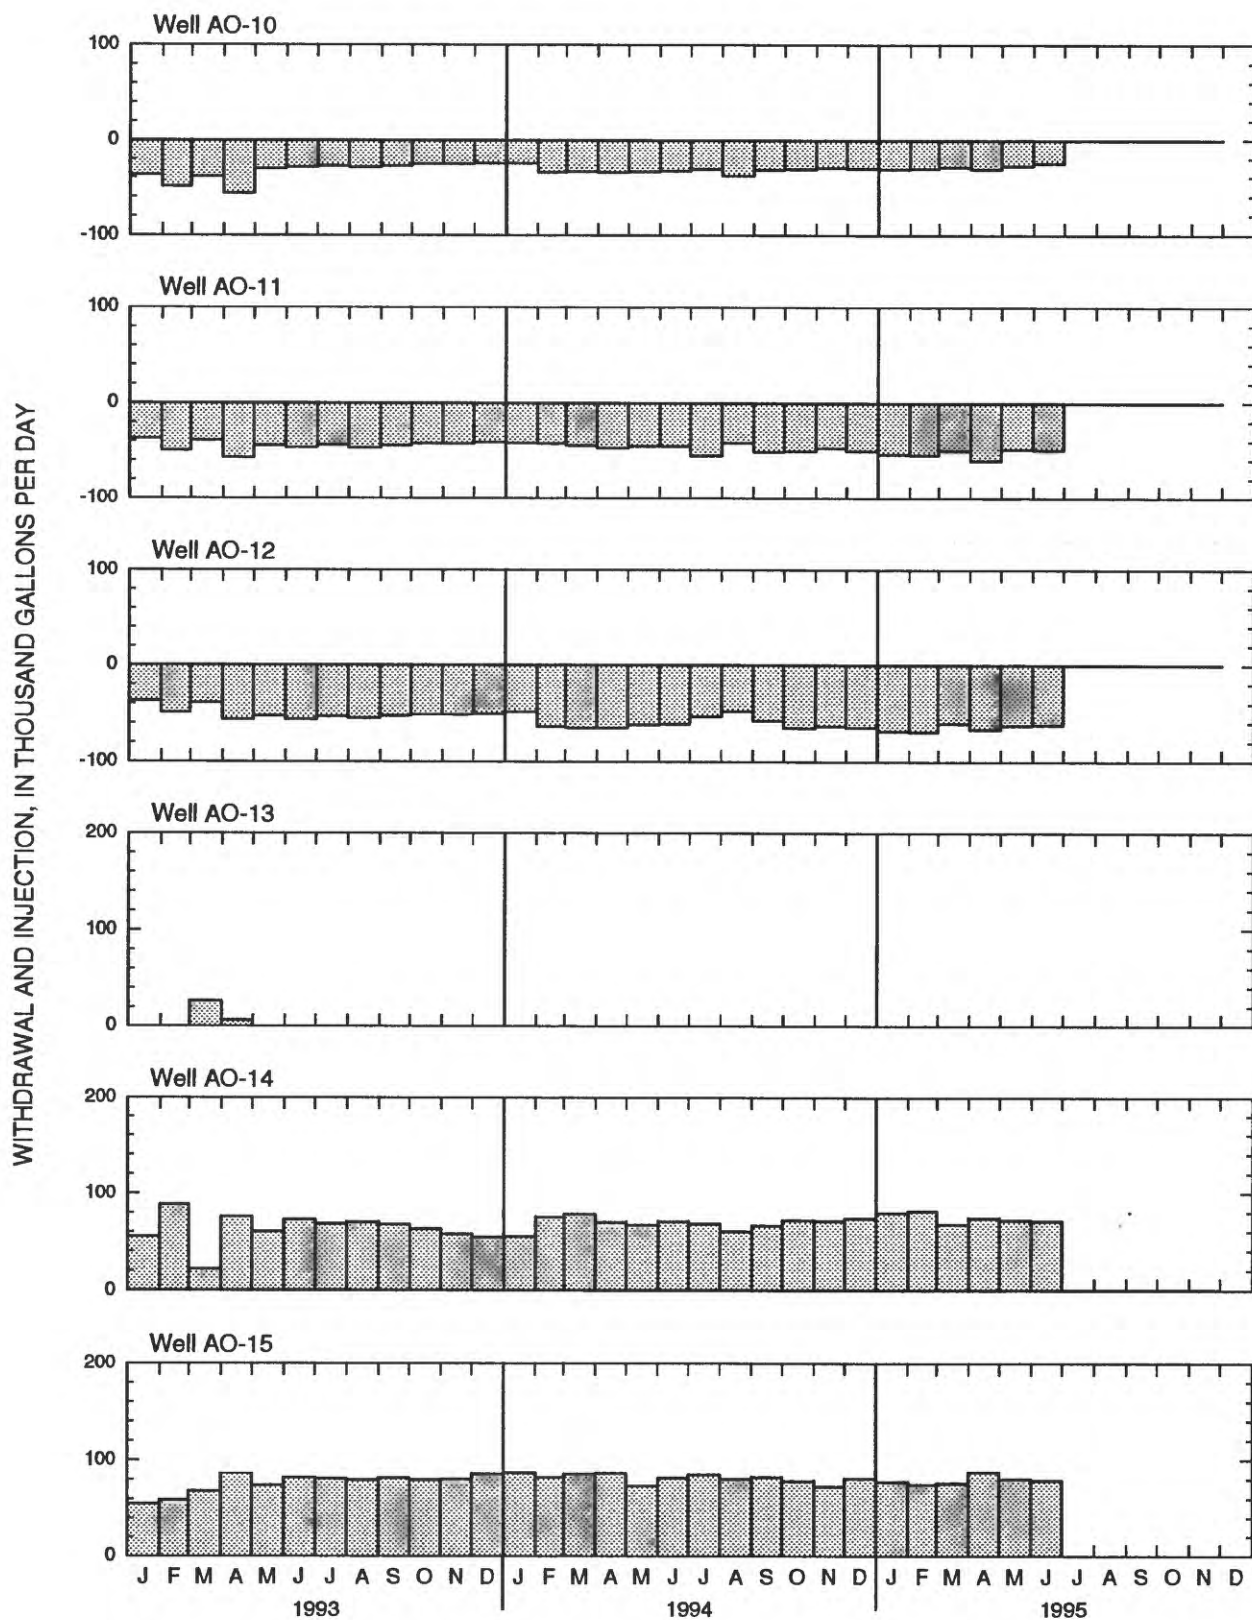


Figure 7. Monthly mean ground-water withdrawal and injection at wells AO-10 through AO-15 at Air Operations, Diego Garcia, January 1993 through June 1995. Injection is plotted as negative.

HYDROLOGIC-DATA SECTION

TYPES OF DATA INCLUDED

- A. Maps of production and monitoring wells at Cantonment and Air Operations
- B. Graphs of monthly mean ground-water withdrawal, January 1993 through June 1995
- C. Graphs of chloride concentration of pumped water, January 1993 through June 1995

DESCRIPTIONS OF PRINCIPAL PRODUCTION SOURCES AT CANTONMENT AND AIR OPERATIONS AREAS

Cantonment Area


- 1. Modules A, C through L - each module is a well field of five to eight vertical wells that are pumped to a common collection/transfer tank.
- 2. Module B is a horizontal well with a collection/transfer tank; has not pumped since August 1986.
- 3. Wells H1 through H7 are horizontal wells.
- 4. Quad wells are a well field of four vertical wells.
- 5. Jungle wells are a well field of 11 vertical wells; have not pumped since February 1987.

Air Operations Area

- 1. Wells AO-2 through AO-5 are vertical wells.
- 2. Wells AO-6 through AO-9 are horizontal wells.
- 3. Wells AO-10 through AO-12 are horizontal wells; currently receiving injection water to divert fuel contaminants from a nearby leak. No samples are currently collected for chloride-concentration analysis.
- 4. Wells AO-13 through AO-15 are horizontal wells; AO-14 and AO-15 are currently pumping water to injection wells AO-10 through AO-12, while AO-13 is not pumping.
- 5. AO-16 through AO-19 are horizontal wells.

SECTION A

Maps of production and monitoring wells at Cantonment and Air Operations

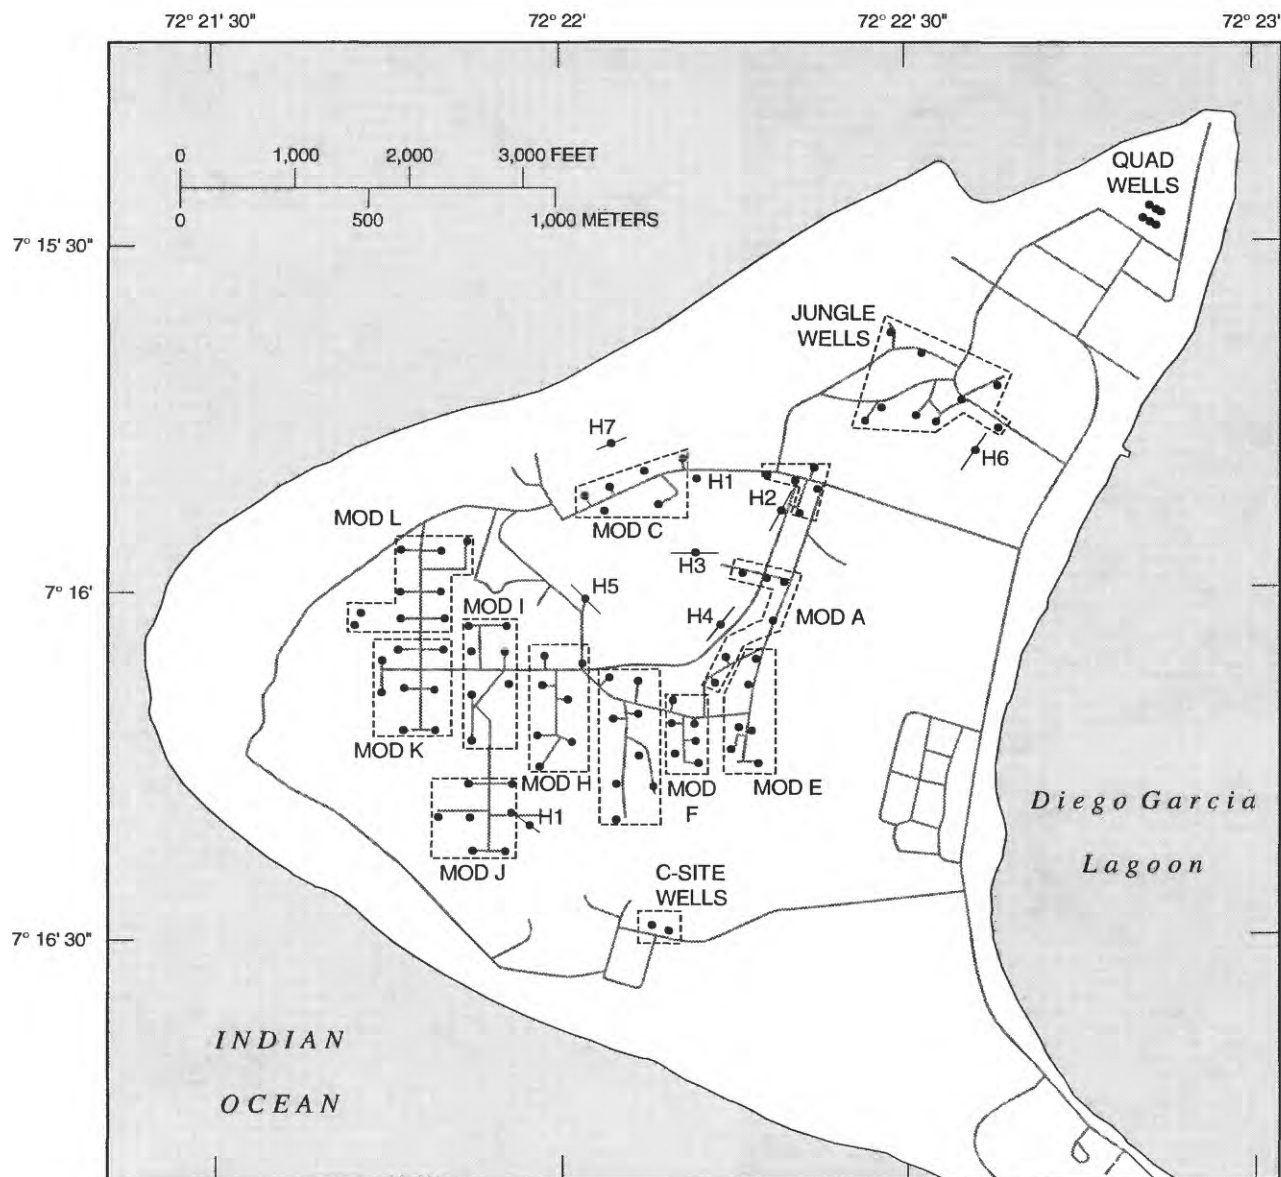

| QUAD WELLS | EXPLANATION |
|------------|--|
| • | VERTICAL WELL AND WELL OR WELL FIELD DESIGNATION--Typical pumping rate 10 to 12 gallons per minute |
| H7 | HORIZONTAL WELL AND DESIGNATION--Typical pumping rate 50 to 75 gallons per minute |
| MOD E | WELL MODULE AND DESIGNATION--Vertical well that pump to a common 1,000-gallon collection and transfer tank |

Figure A1. Ground-water production wells and well fields at Cantonment, Diego Garcia.


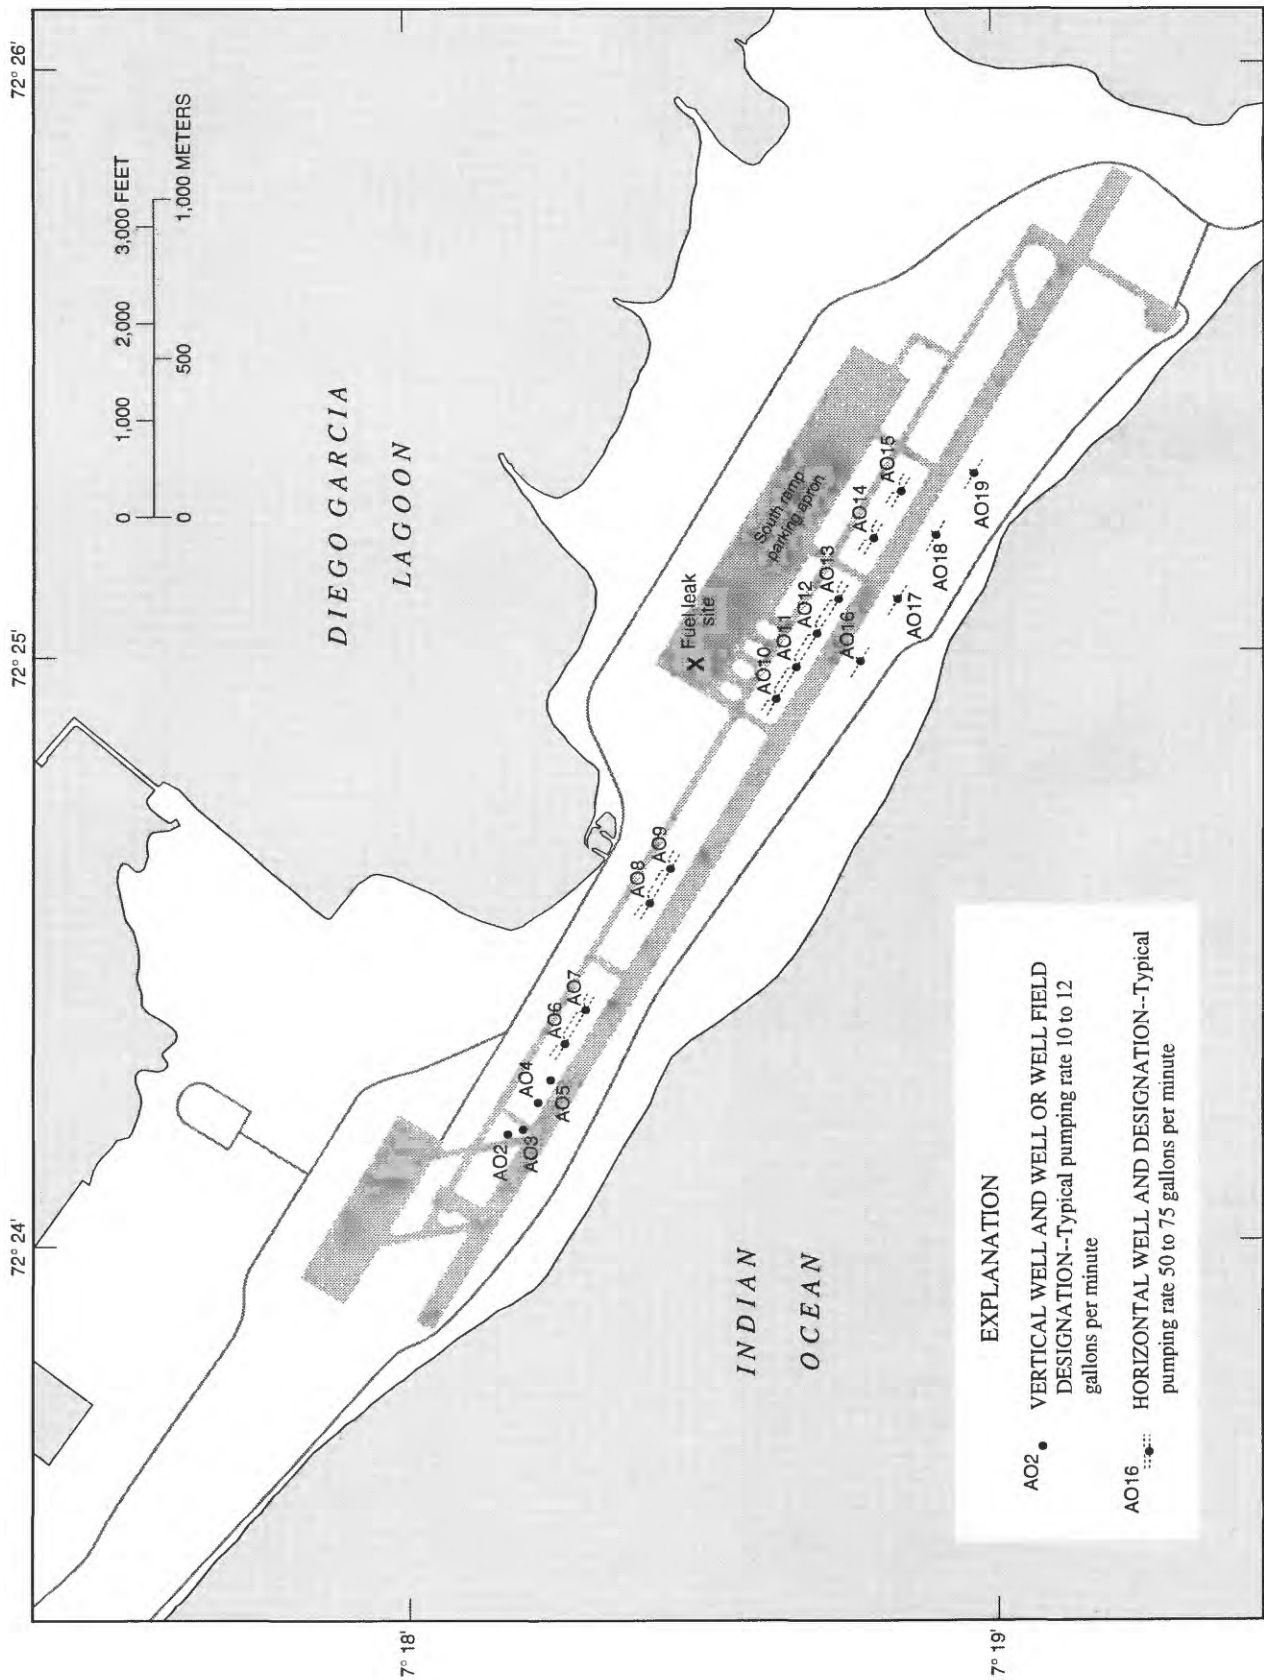


Figure A2. Ground-water production wells at Air Operations, Diego Garcia.

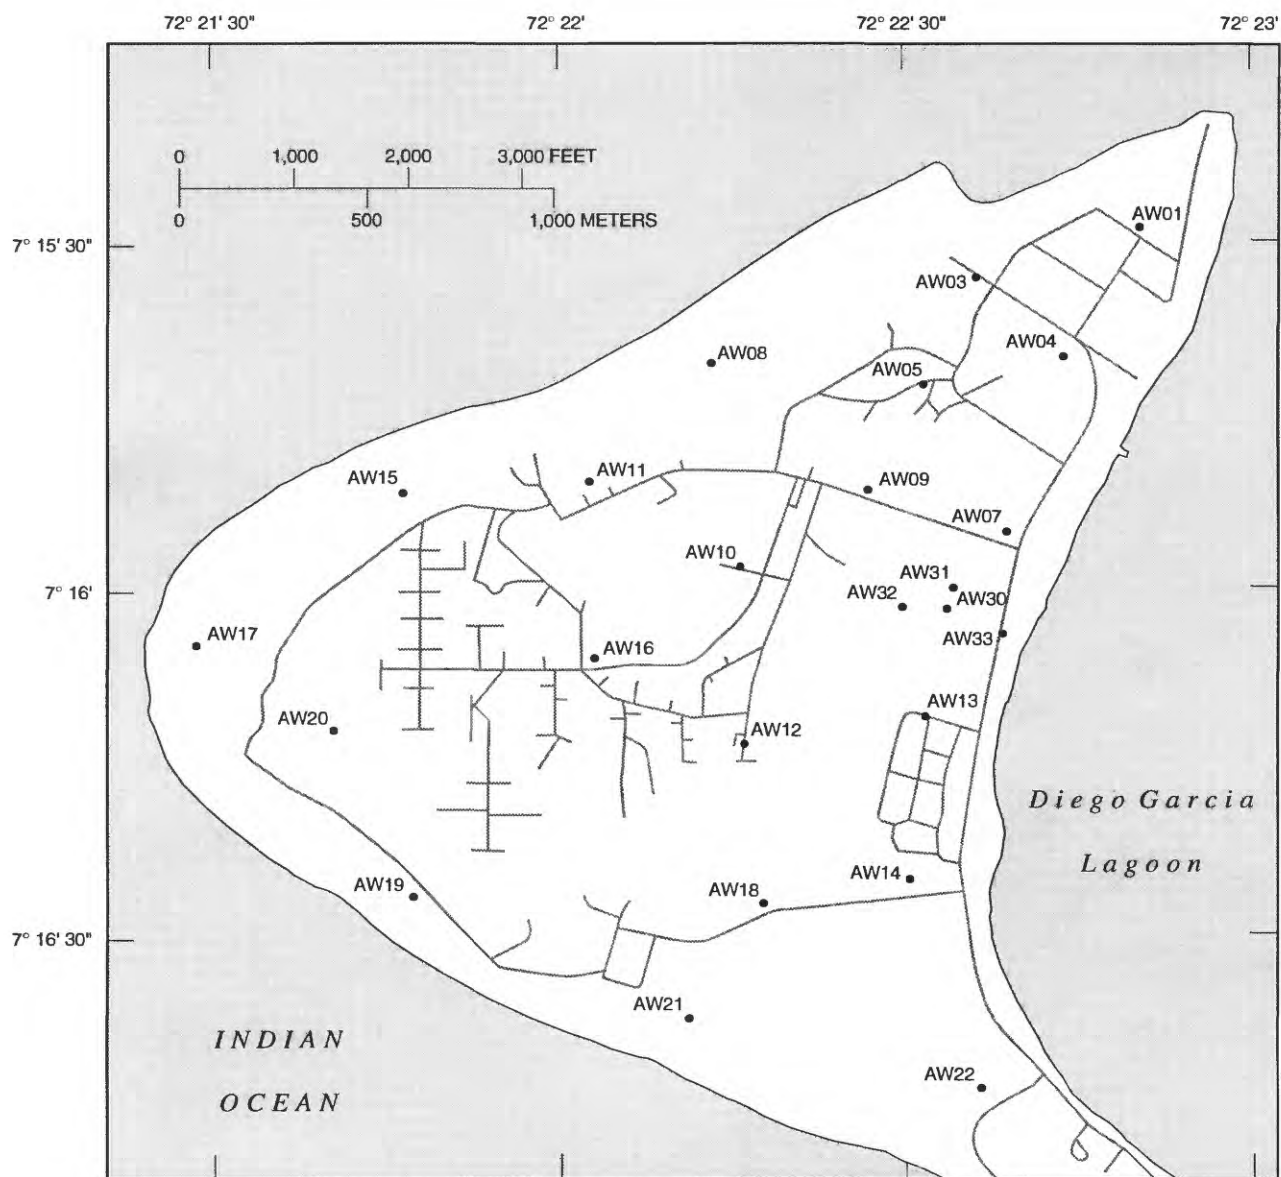

EXPLANATION

- AW21 • MONITORING SITE AND DESIGNATION--Consisting of two or more monitoring wells with short (2 to 5 foot) open intervals of different depths

Figure A3. Monitoring wells at Cantonment, Diego Garcia.

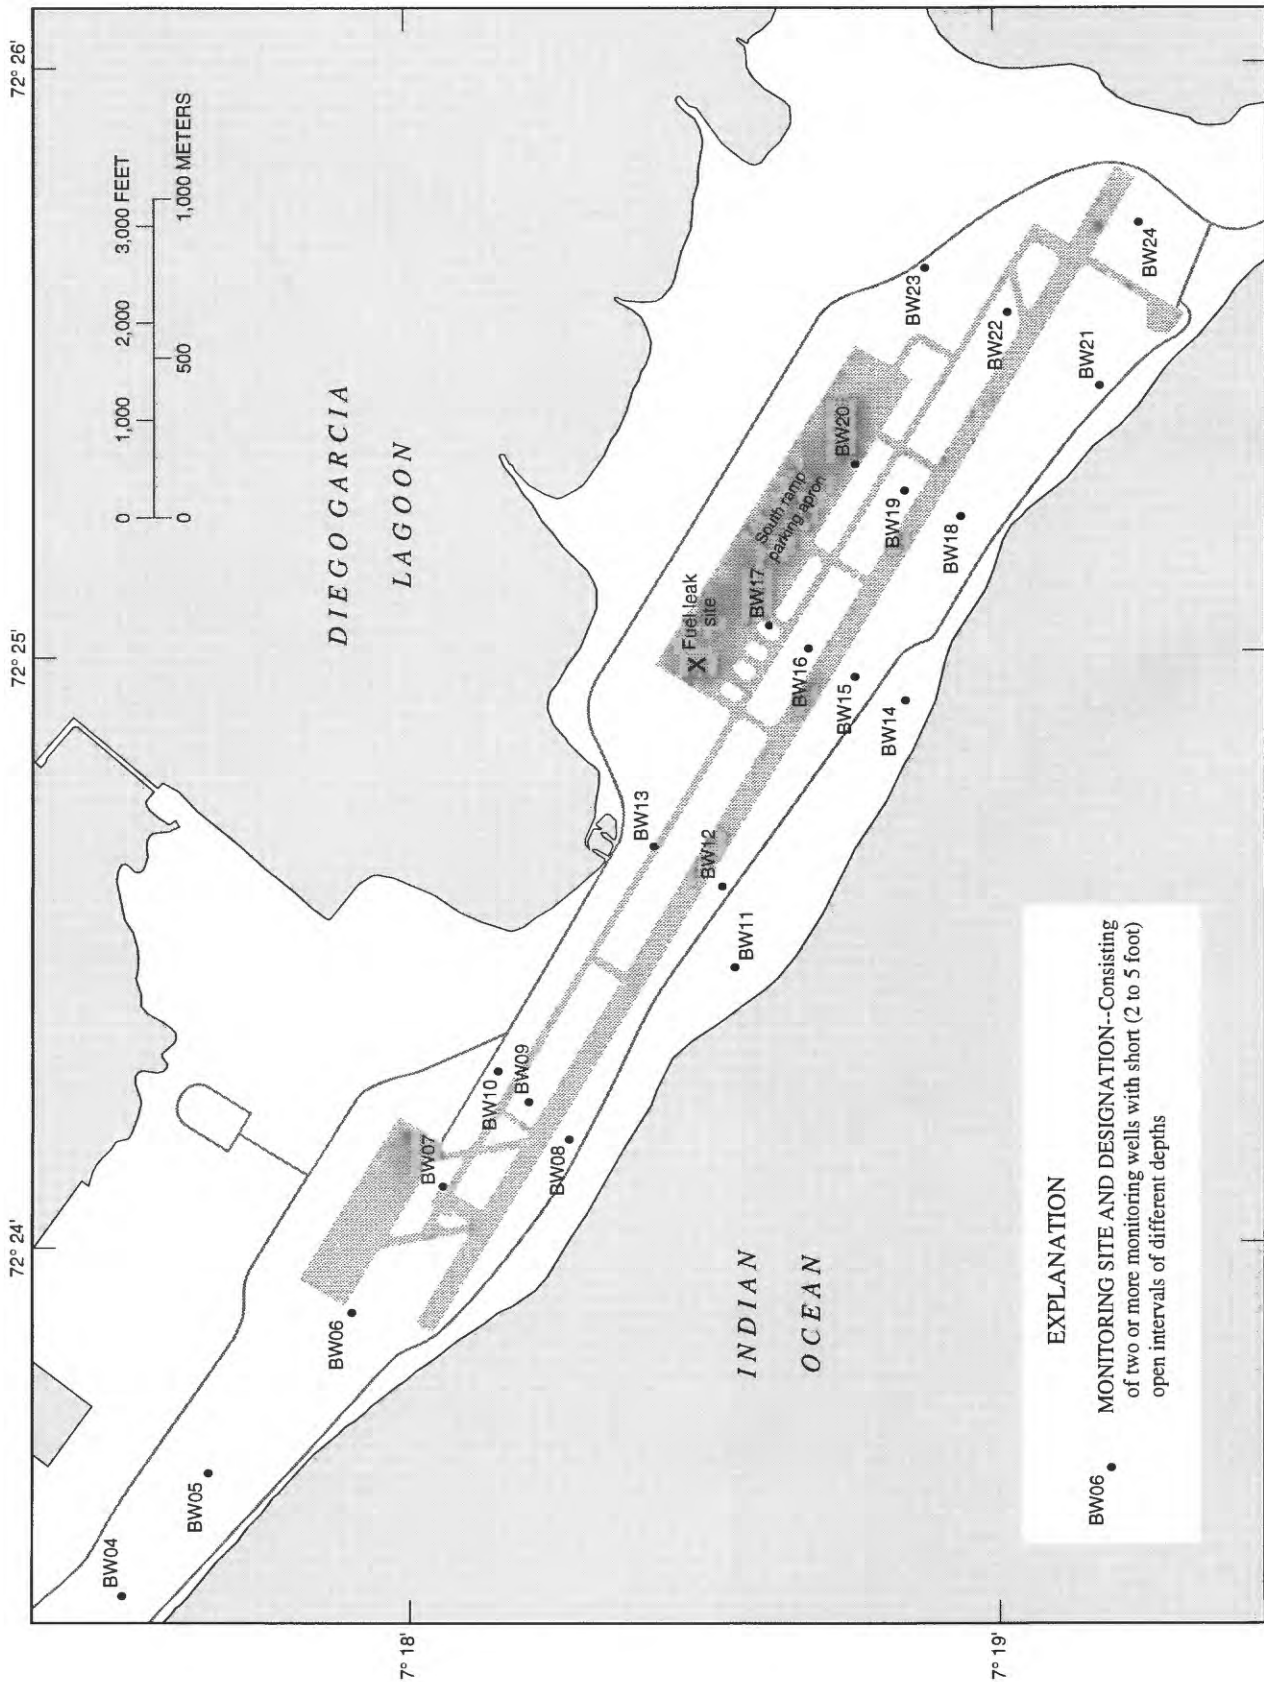


Figure A4. Monitoring wells at Air Operations, Diego Garcia.

SECTION B

**Graphs of monthly mean ground-water withdrawal,
January 1993 through June 1995**

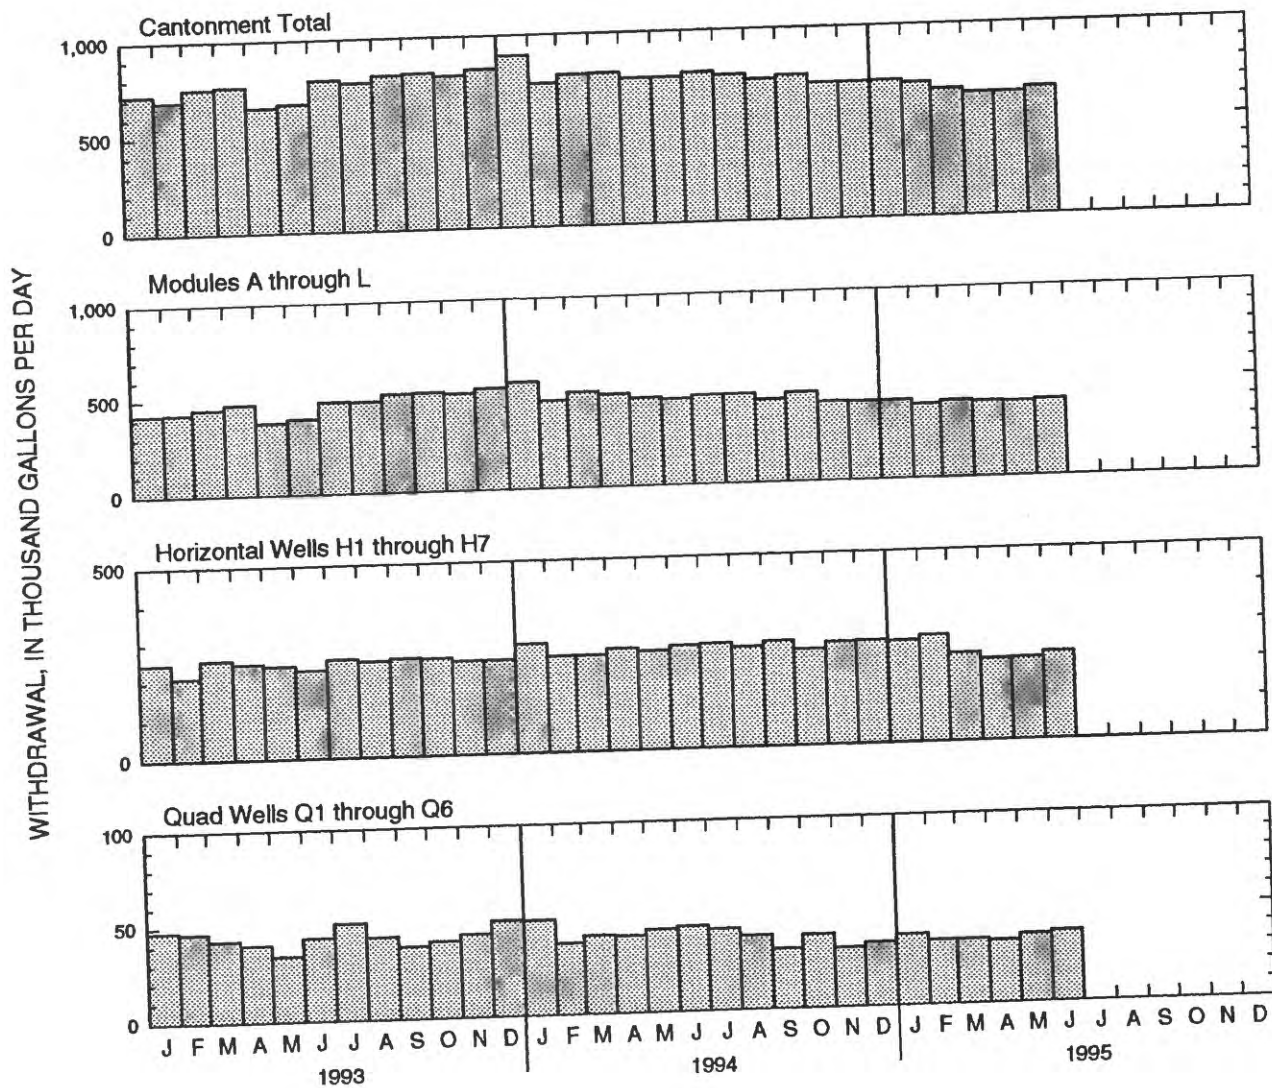


Figure B1. Monthly mean ground-water withdrawal at Cantonment, Diego Garcia, January 1993 through June 1995.

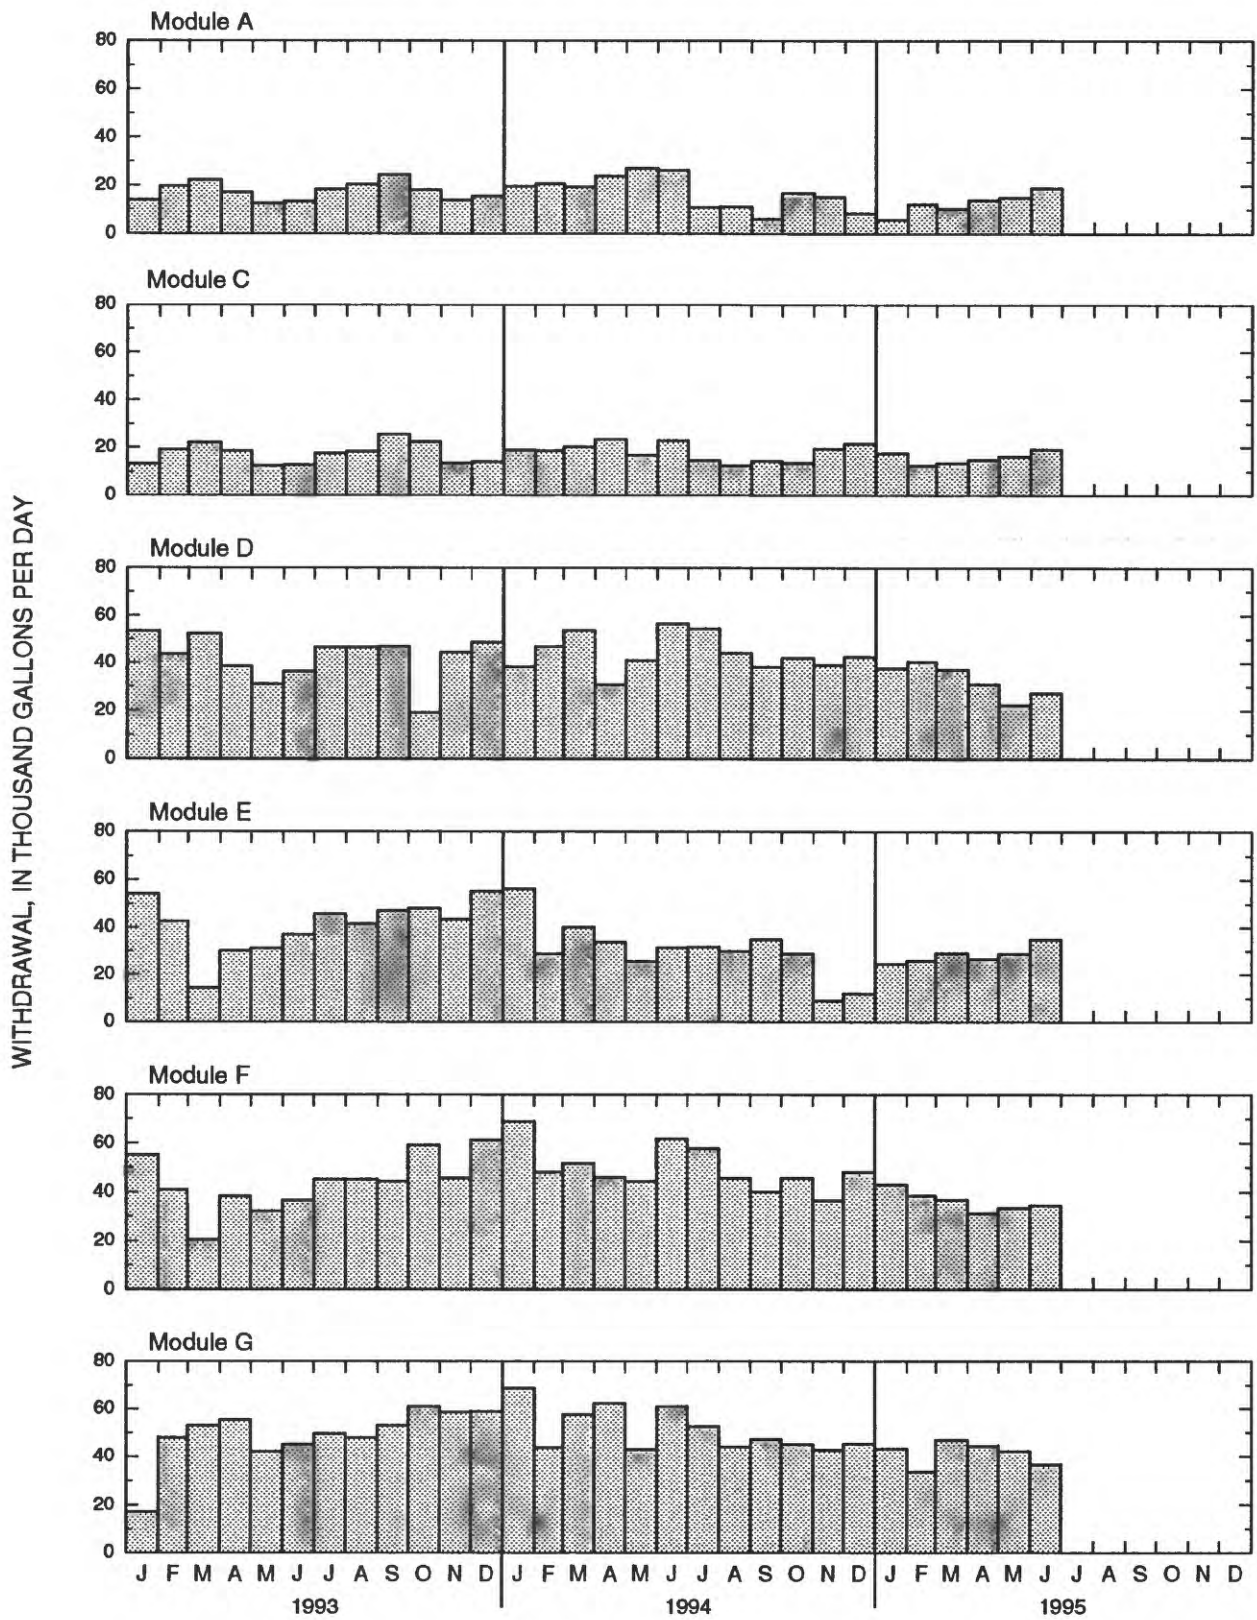


Figure B2. Monthly mean ground-water withdrawal at Modules A through L at Cantonment, Diego Garcia, January 1993 through June 1995.

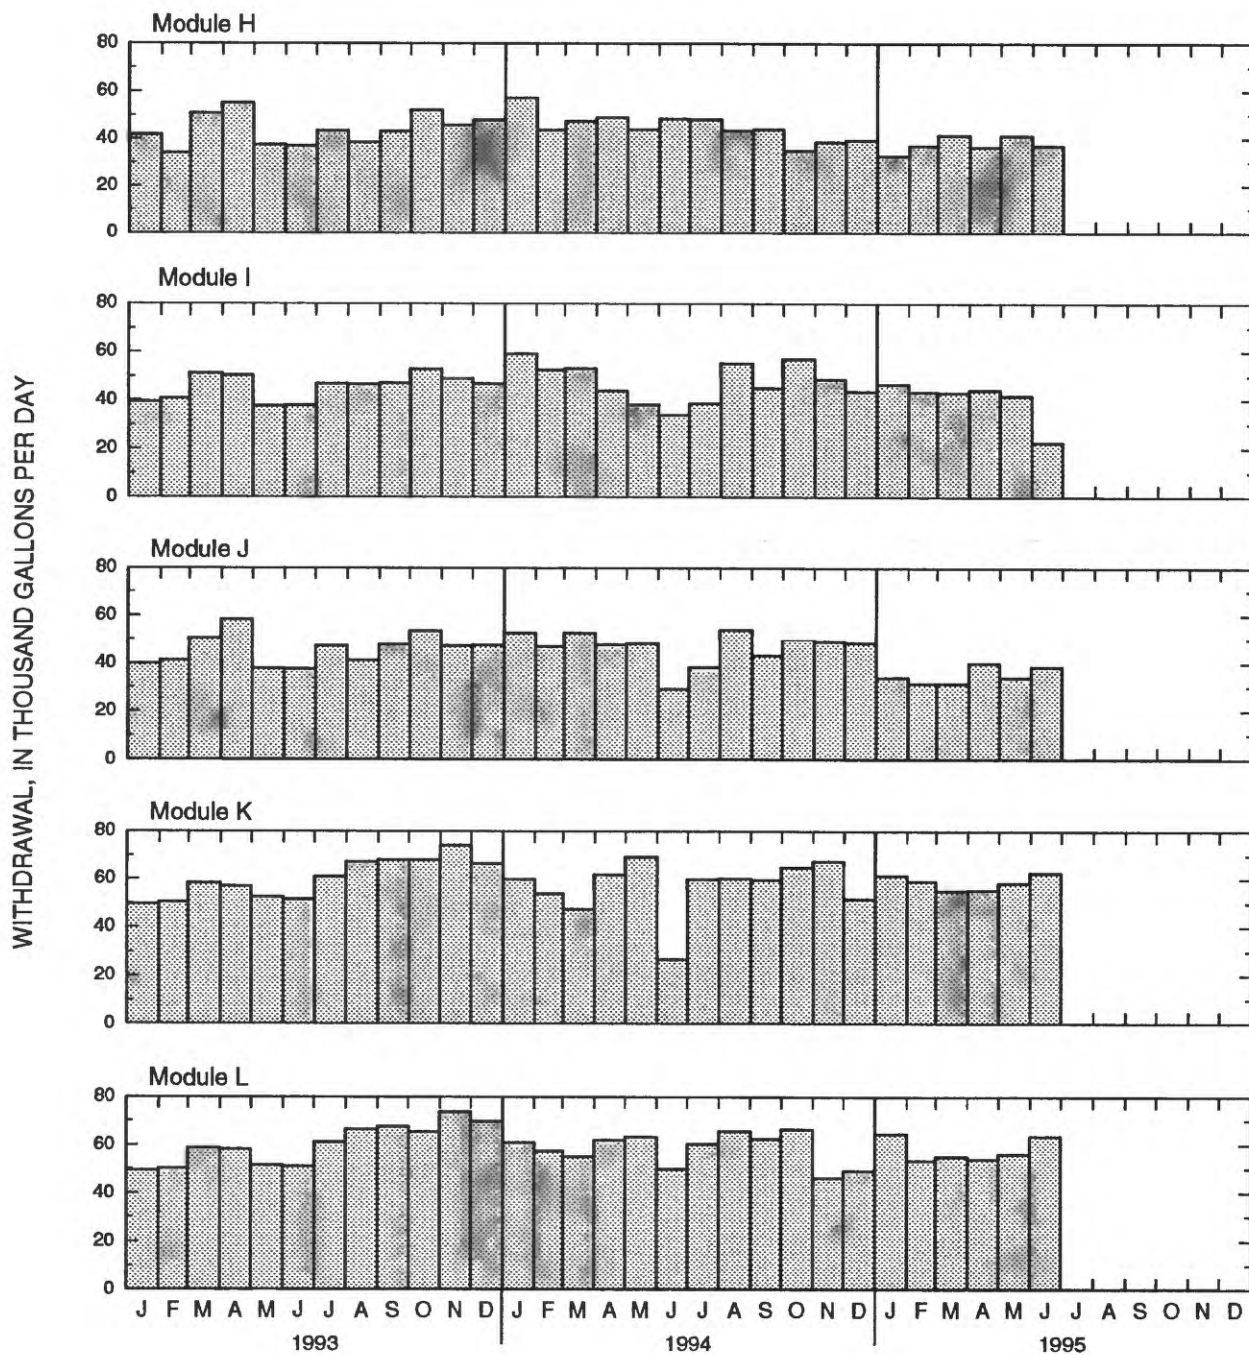


Figure B2 continued.--Monthly mean ground-water withdrawal at Modules A through L at Cantonment, Diego Garcia, January 1993 through June 1995.

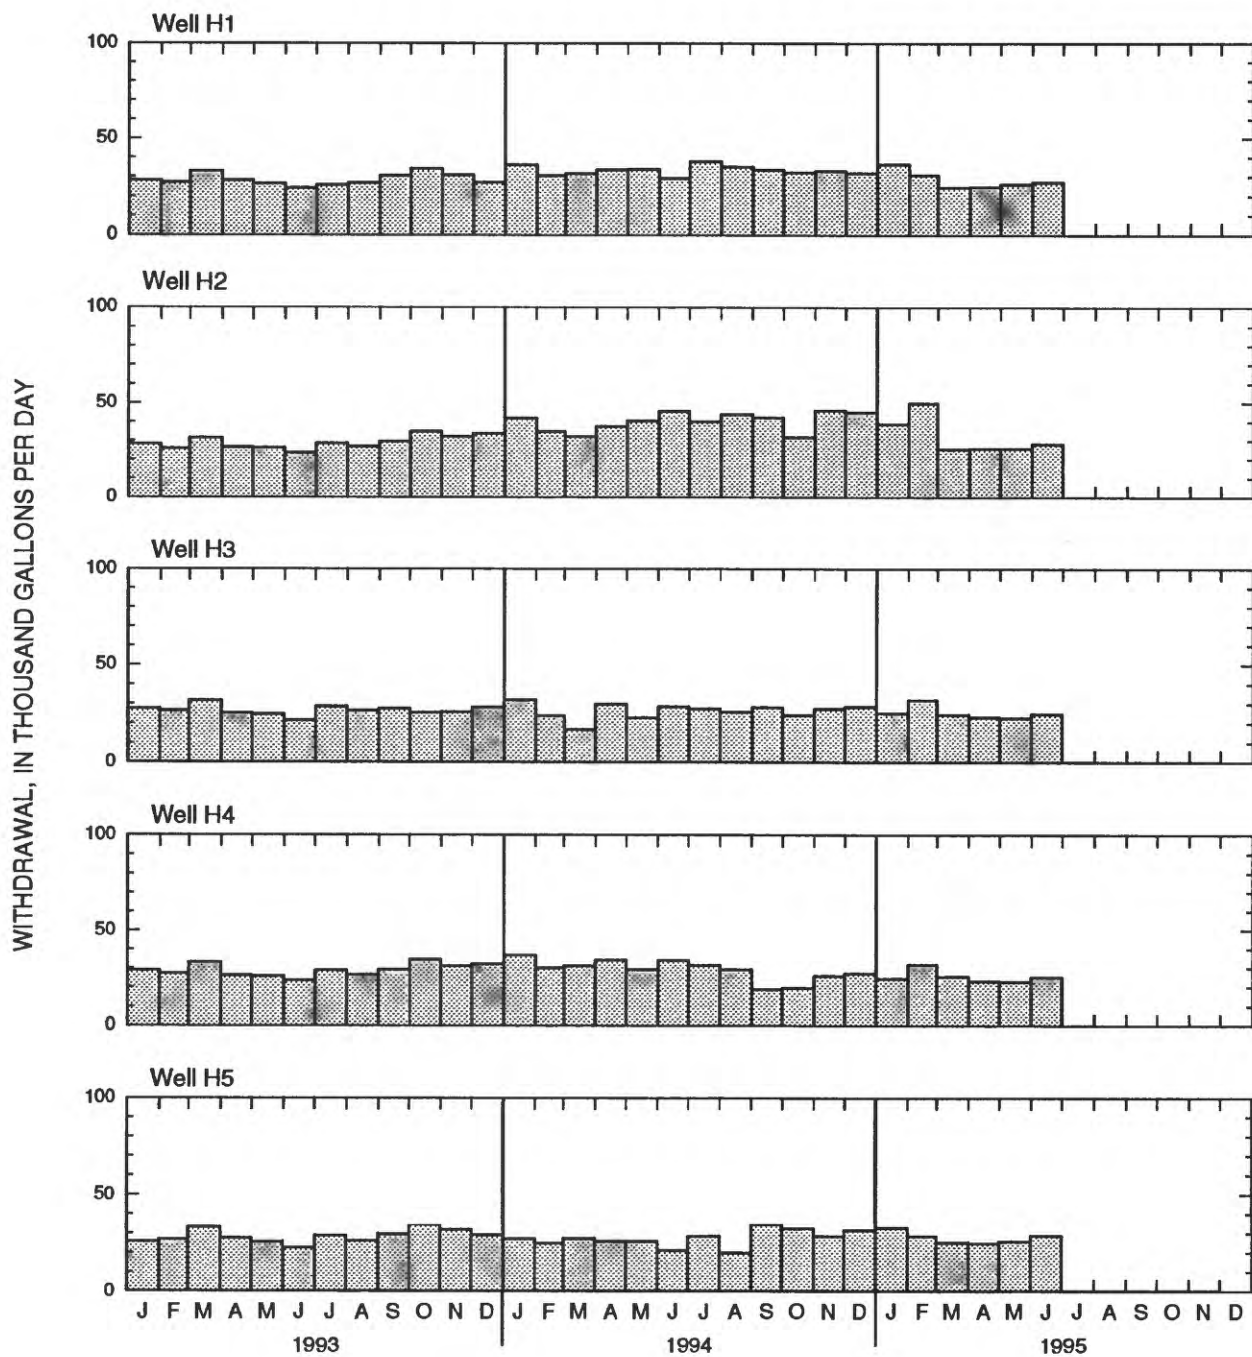


Figure B3. Monthly mean ground-water withdrawal at wells H1 through H7 at Cantonment, Diego Garcia, January 1993 through June 1995.

WITHDRAWAL, IN THOUSAND GALLONS PER DAY

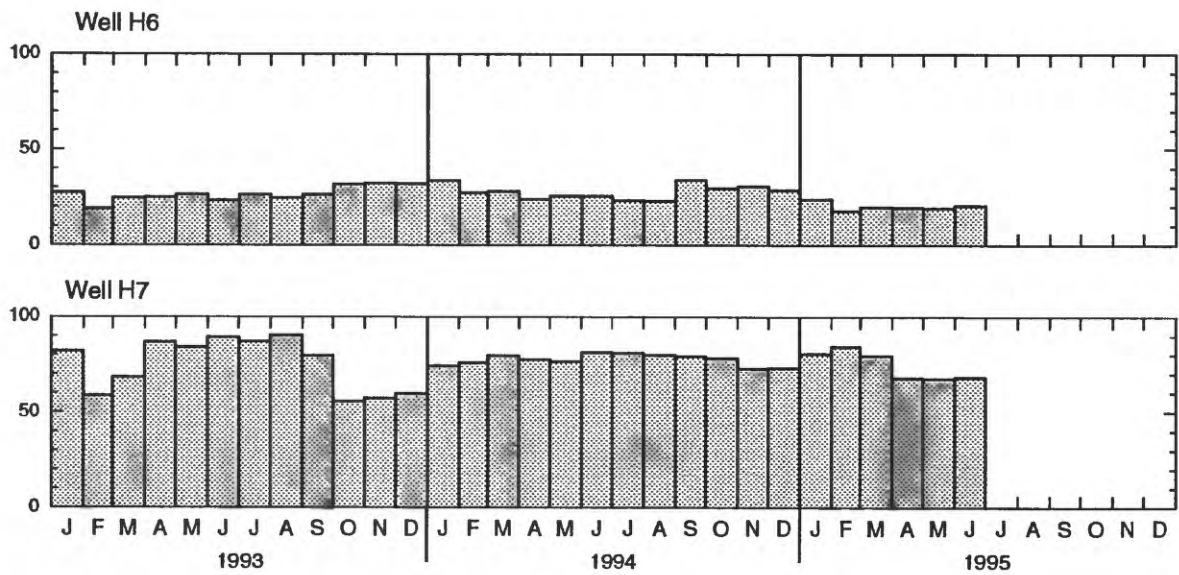


Figure B3 continued.--Monthly mean ground-water withdrawal at wells H1 through H7 at Cantonment, Diego Garcia, January 1993 through June 1995.

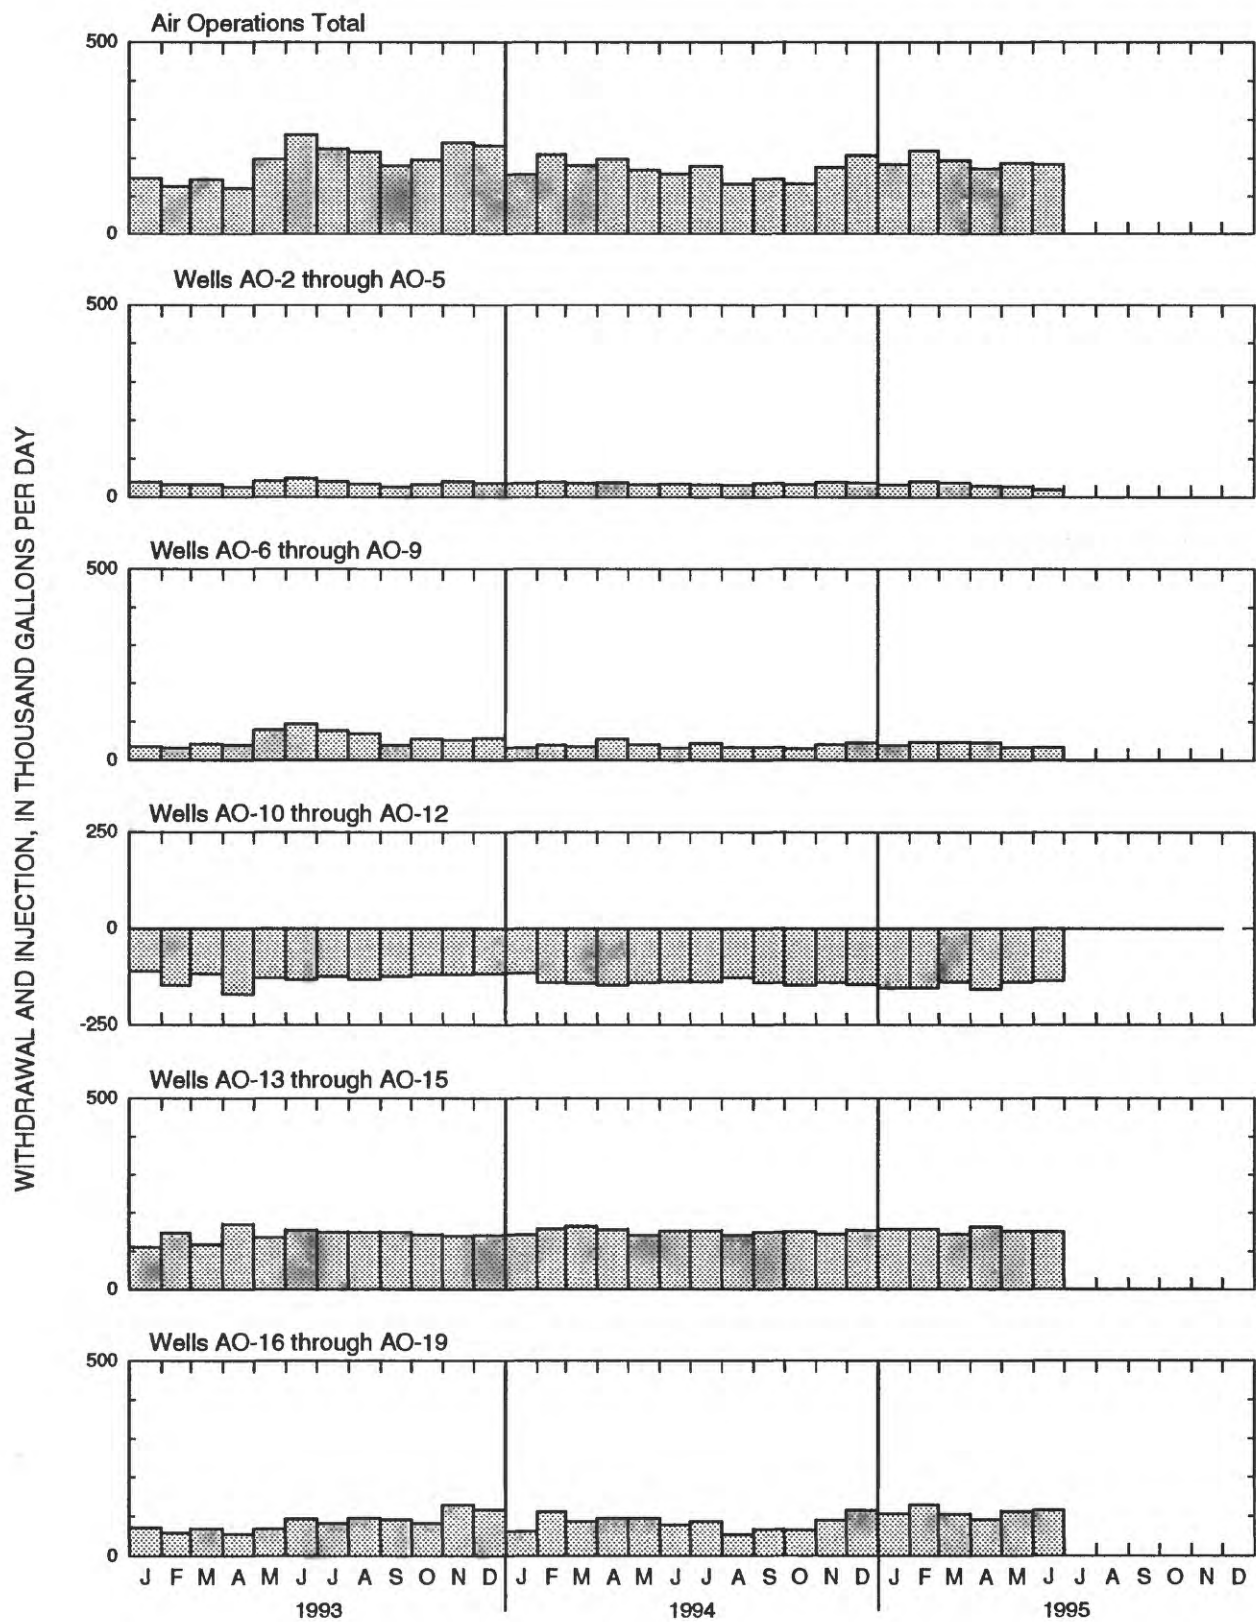


Figure B5. Monthly mean ground-water withdrawal and injection at Air Operations, Diego Garcia, January 1993 through June 1995. Injection is plotted as negative.

WITHDRAWAL AND INJECTION, IN THOUSAND GALLONS PER DAY

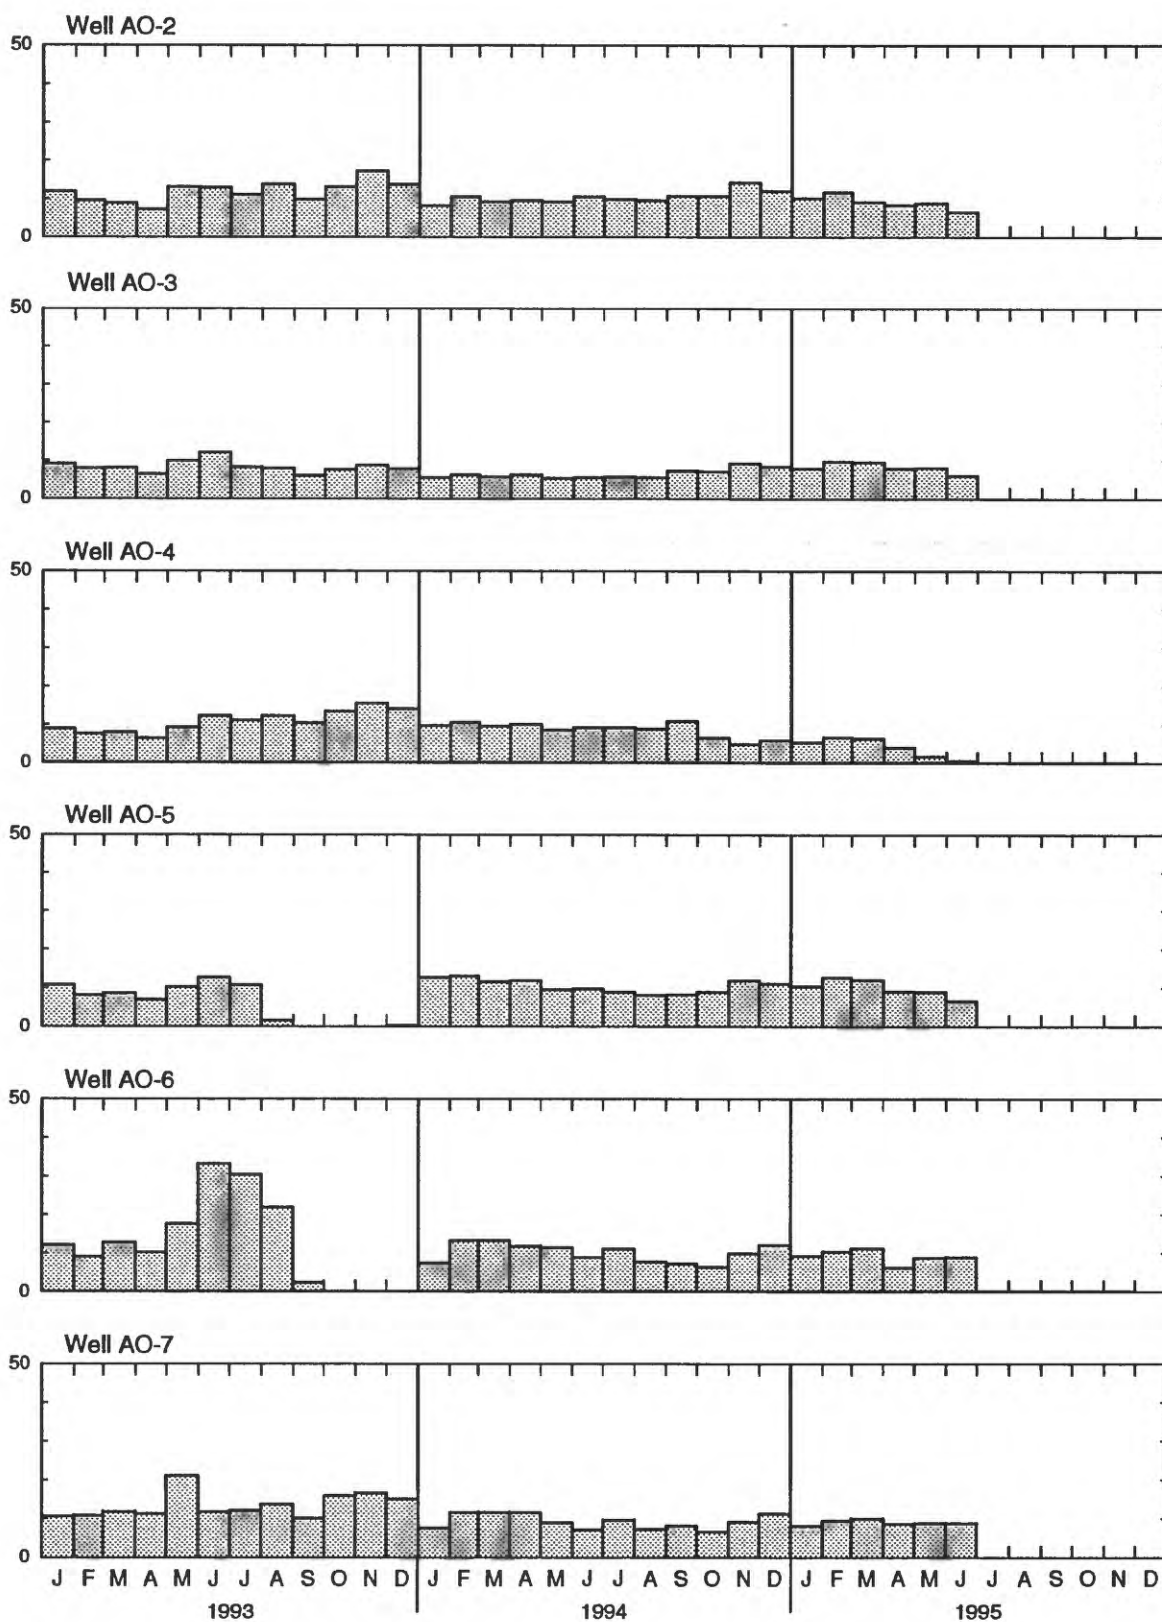


Figure B6. Monthly mean ground-water withdrawal and injection at wells AO-2 through AO-19 at Air Operations, Diego Garcia, January 1993 through June 1995. Injection is plotted as negative.

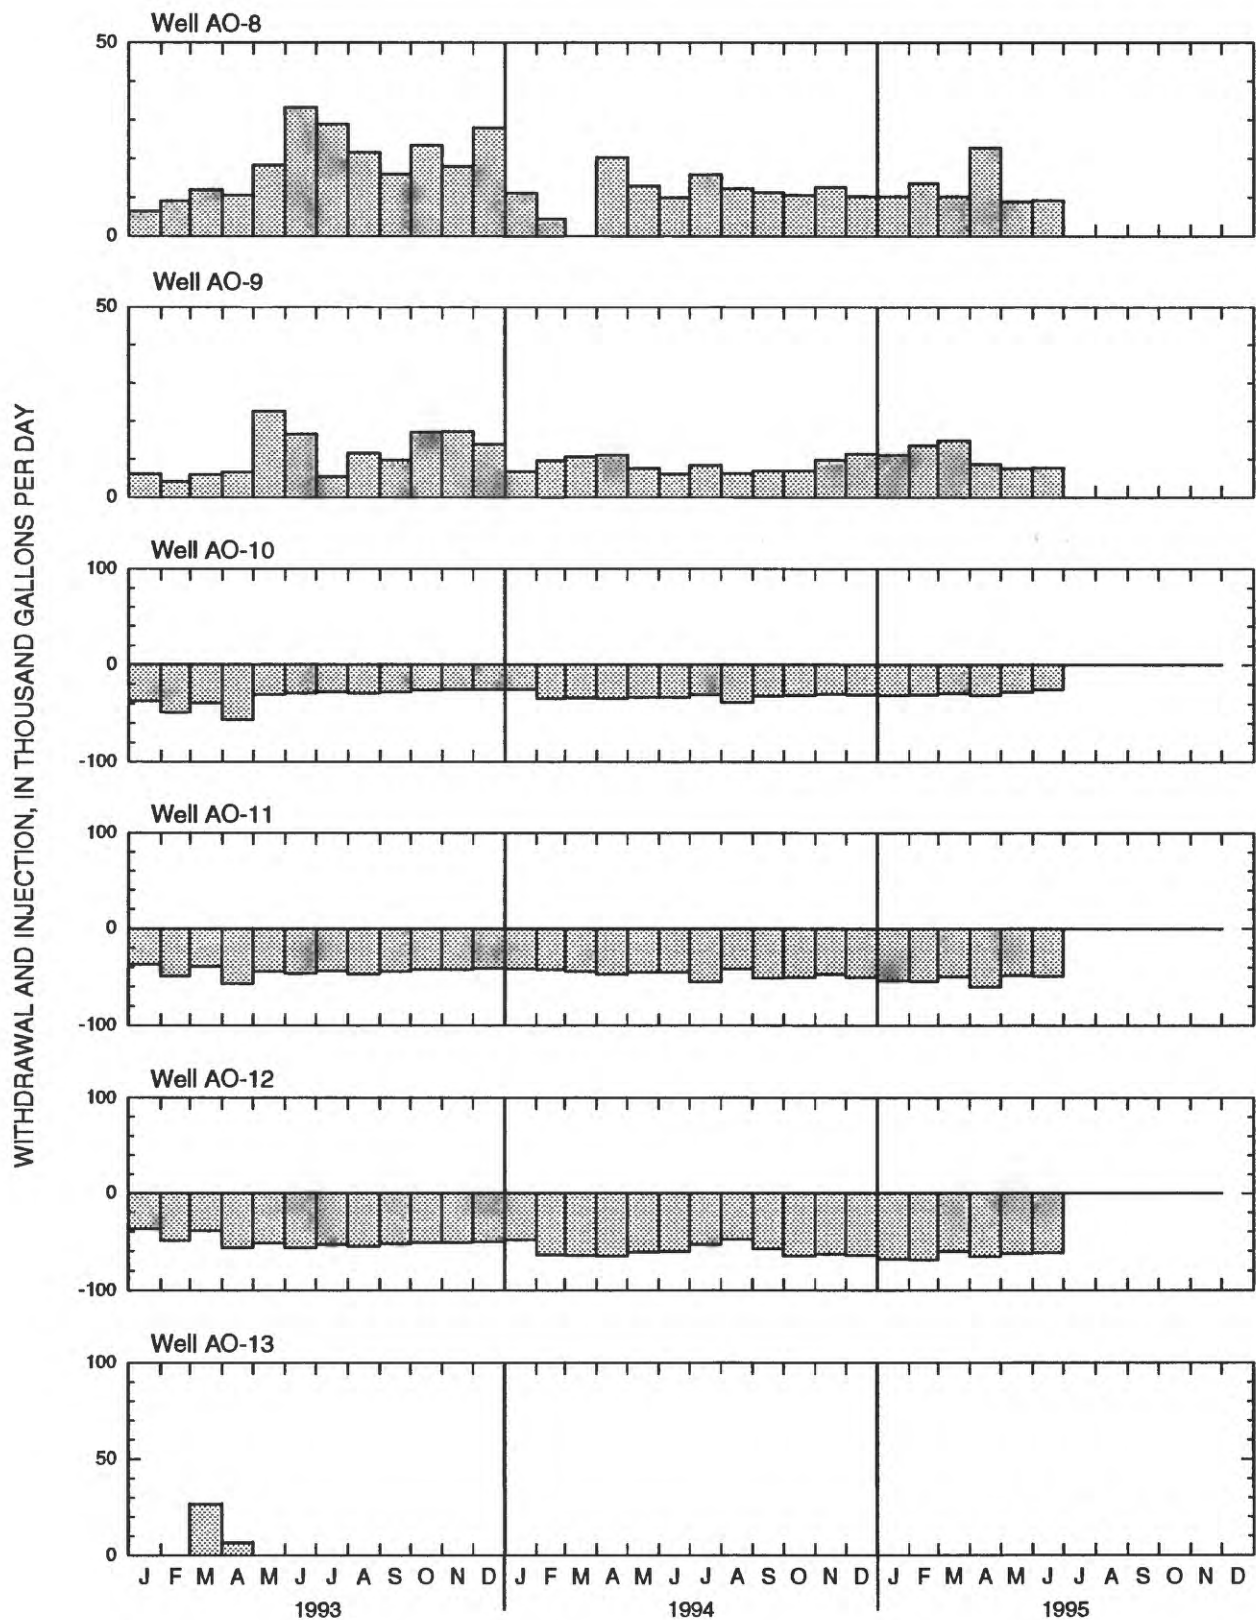


Figure B6 continued.--Monthly mean ground-water withdrawal and injection at wells AO-2 through AO-19 at Air Operations, Diego Garcia, January 1993 through June 1995. Injection is plotted as negative.

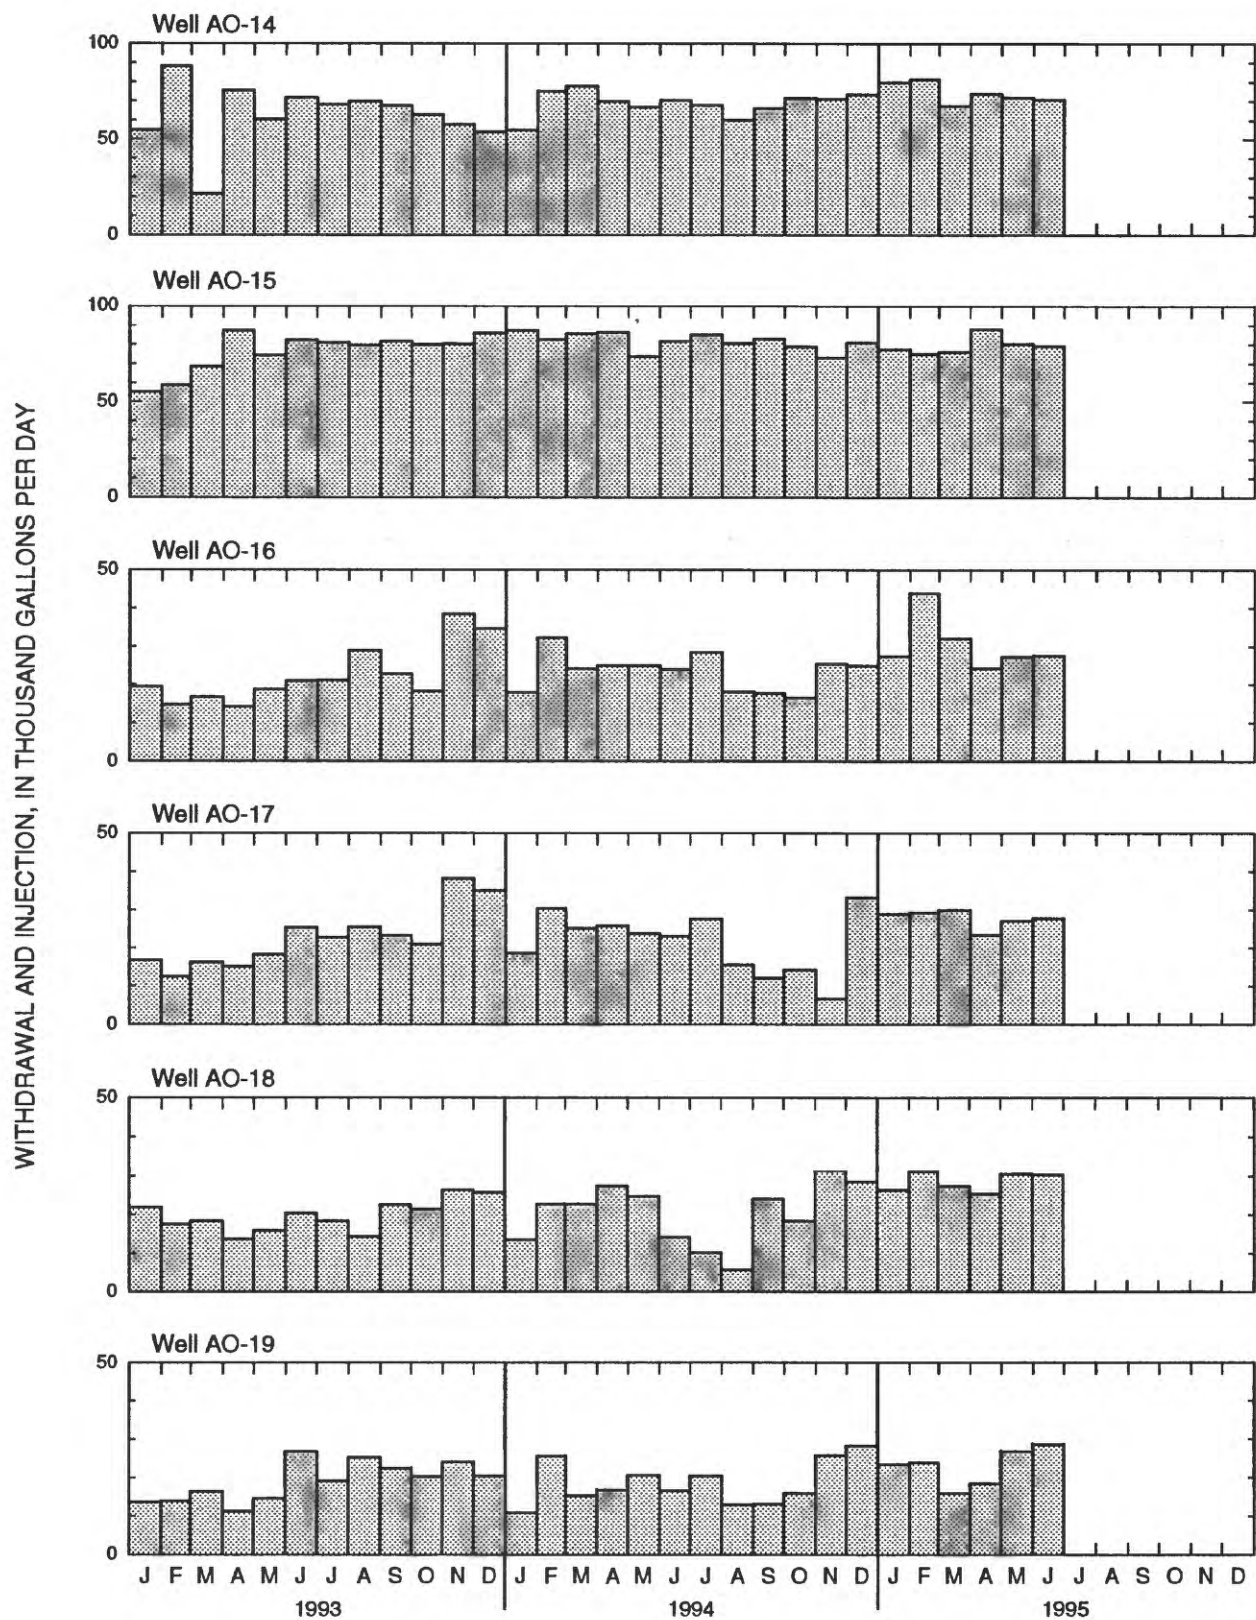


Figure B6 continued.--Monthly mean ground-water withdrawal and injection at wells AO-2 through AO-19 at Air Operations, Diego Garcia, January 1993 through June 1995. Injection is plotted as negative.

SECTION C

**Graphs of chloride concentration of pumped water,
January 1993 through June 1995**

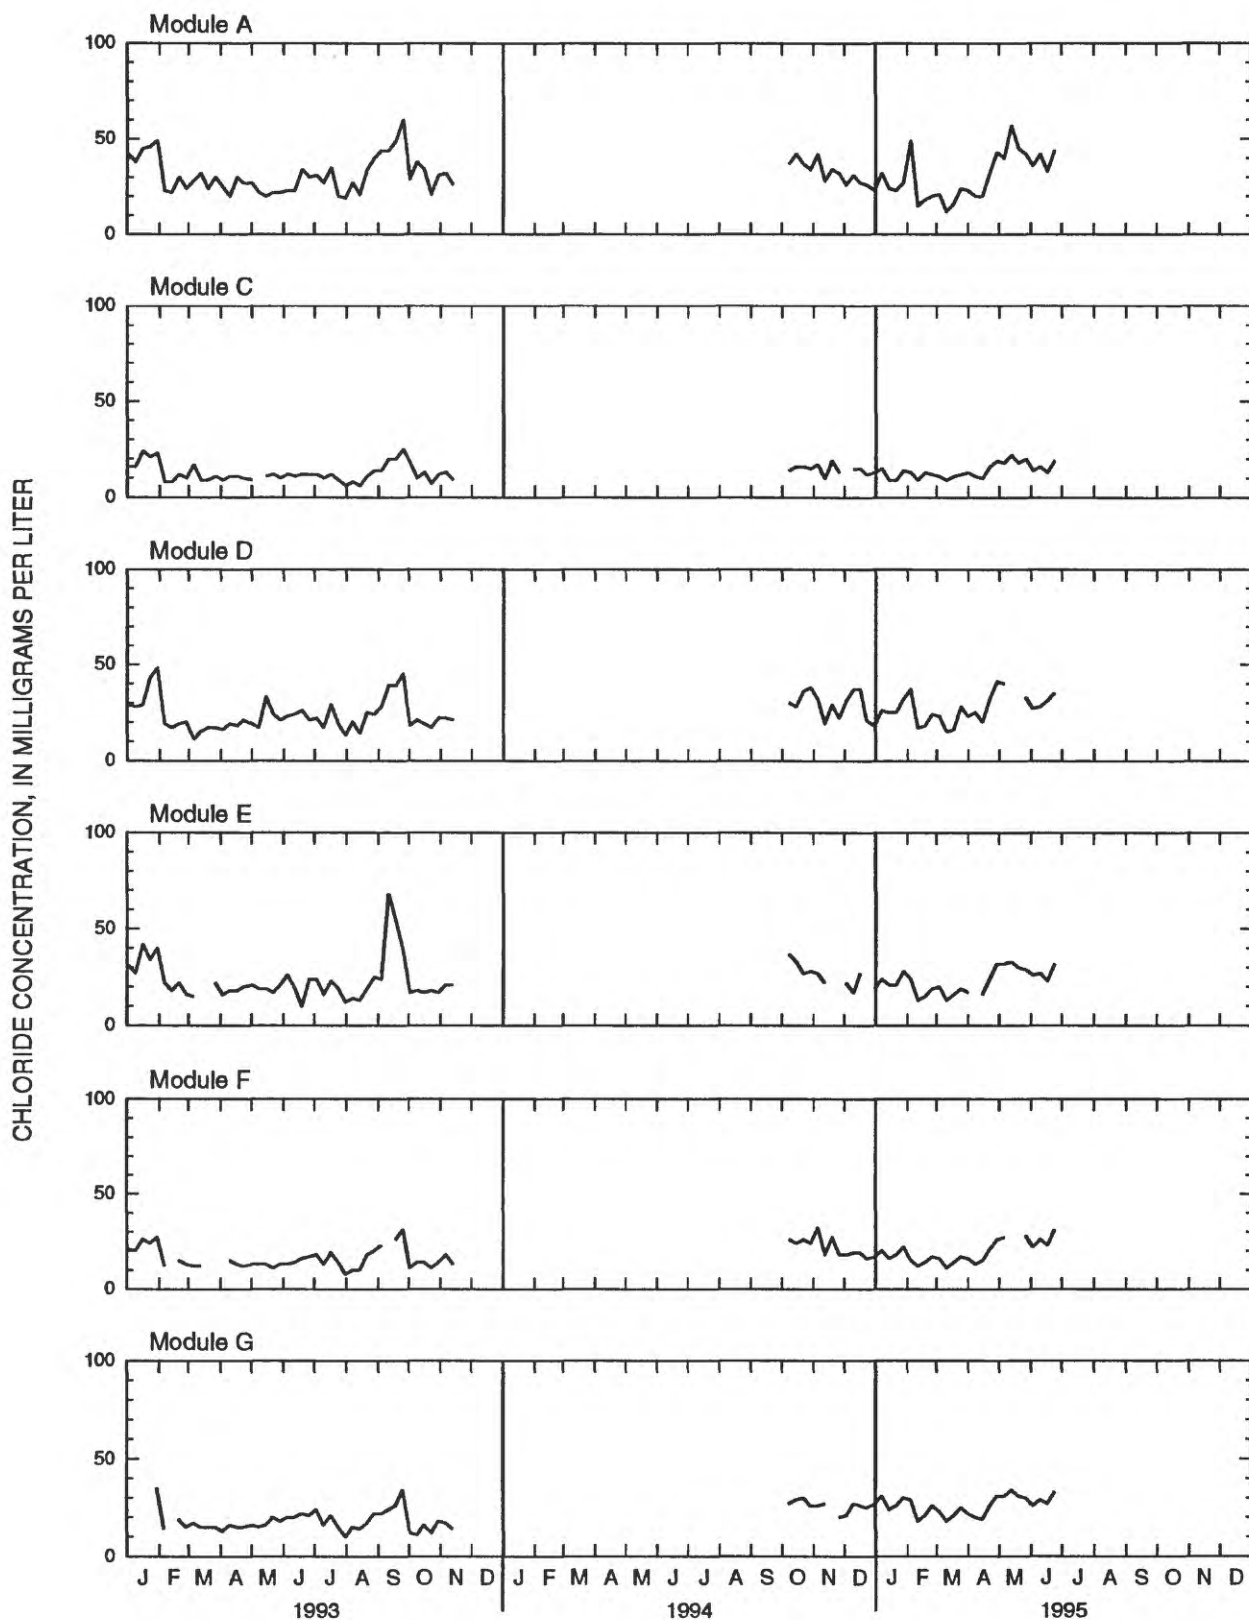


Figure C1. Chloride concentration of pumped water (sampled at weekly intervals) at Modules A through L at Cantonment, Diego Garcia, January 1993 through June 1995. Data not available for November 1993 through September 1994.

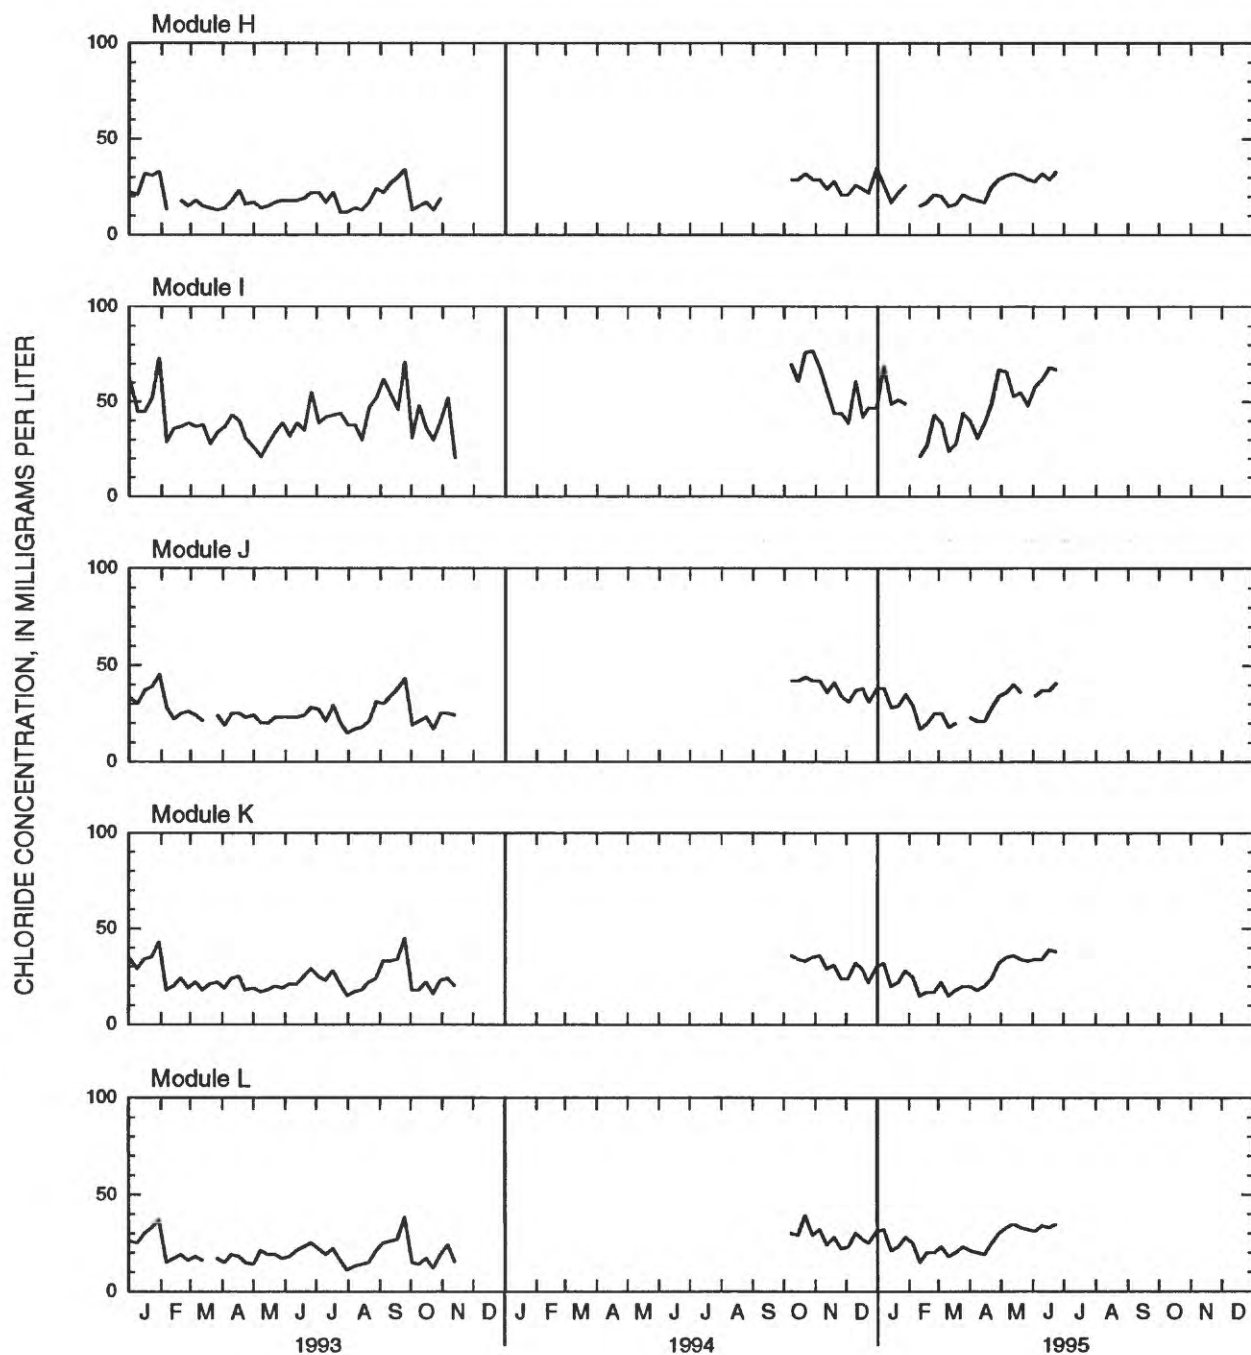


Figure C1 continued.--Chloride concentration of pumped water (sampled at weekly intervals) at Modules A through L at Cantonment, Diego Garcia, January 1993 through June 1995. Data not available for November 1993 through September 1994.

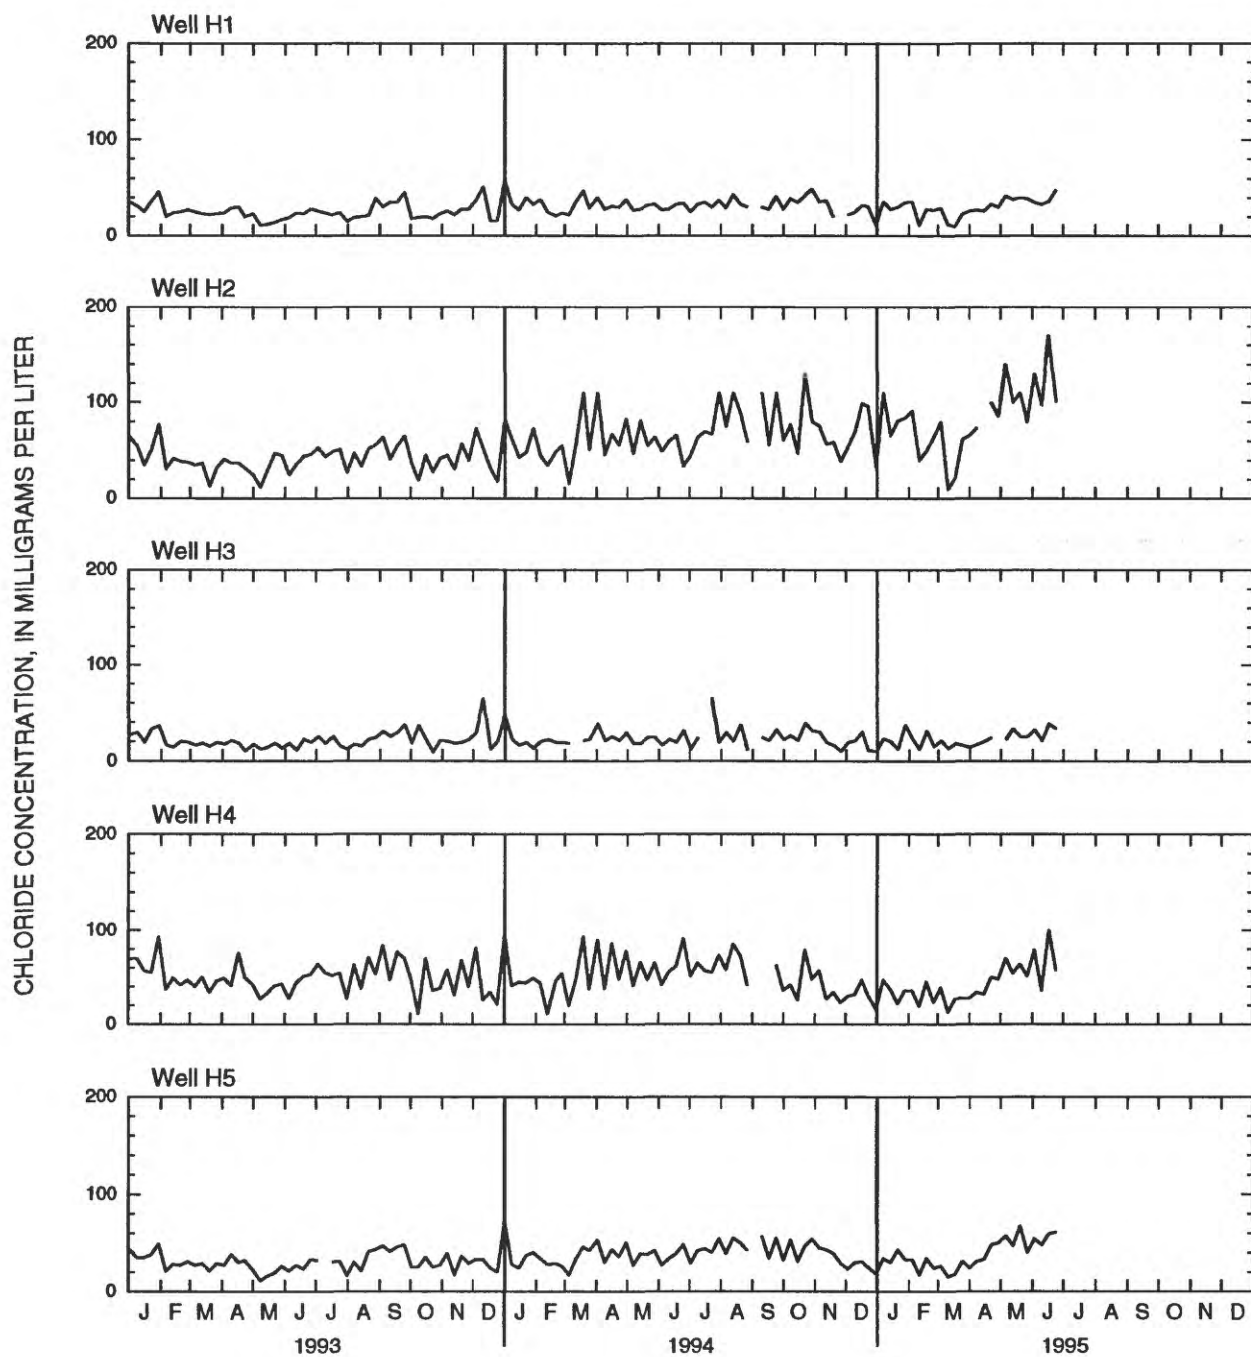


Figure C2. Chloride concentration of pumped water (sampled at weekly intervals) at wells H1 through H7 at Cantonment, Diego Garcia, January 1993 through June 1995.

CHLORIDE CONCENTRATION, IN MILLIGRAMS PER LITER

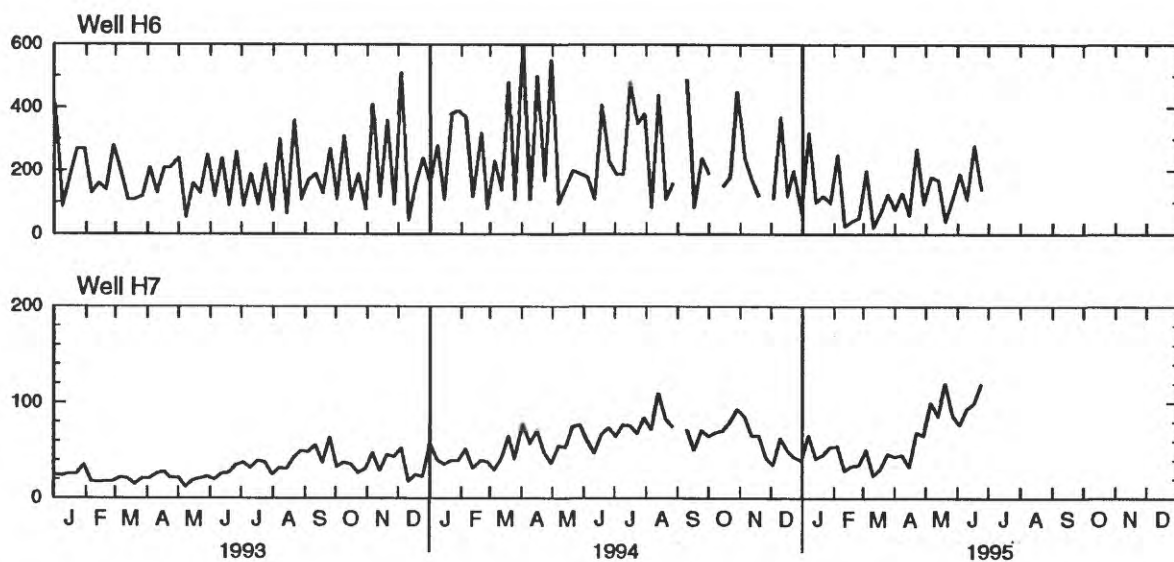


Figure C2 continued.--Chloride concentration of pumped water (sampled at weekly intervals) at wells H1 through H7 at Cantonment, Diego Garcia, January 1993 through June 1995.

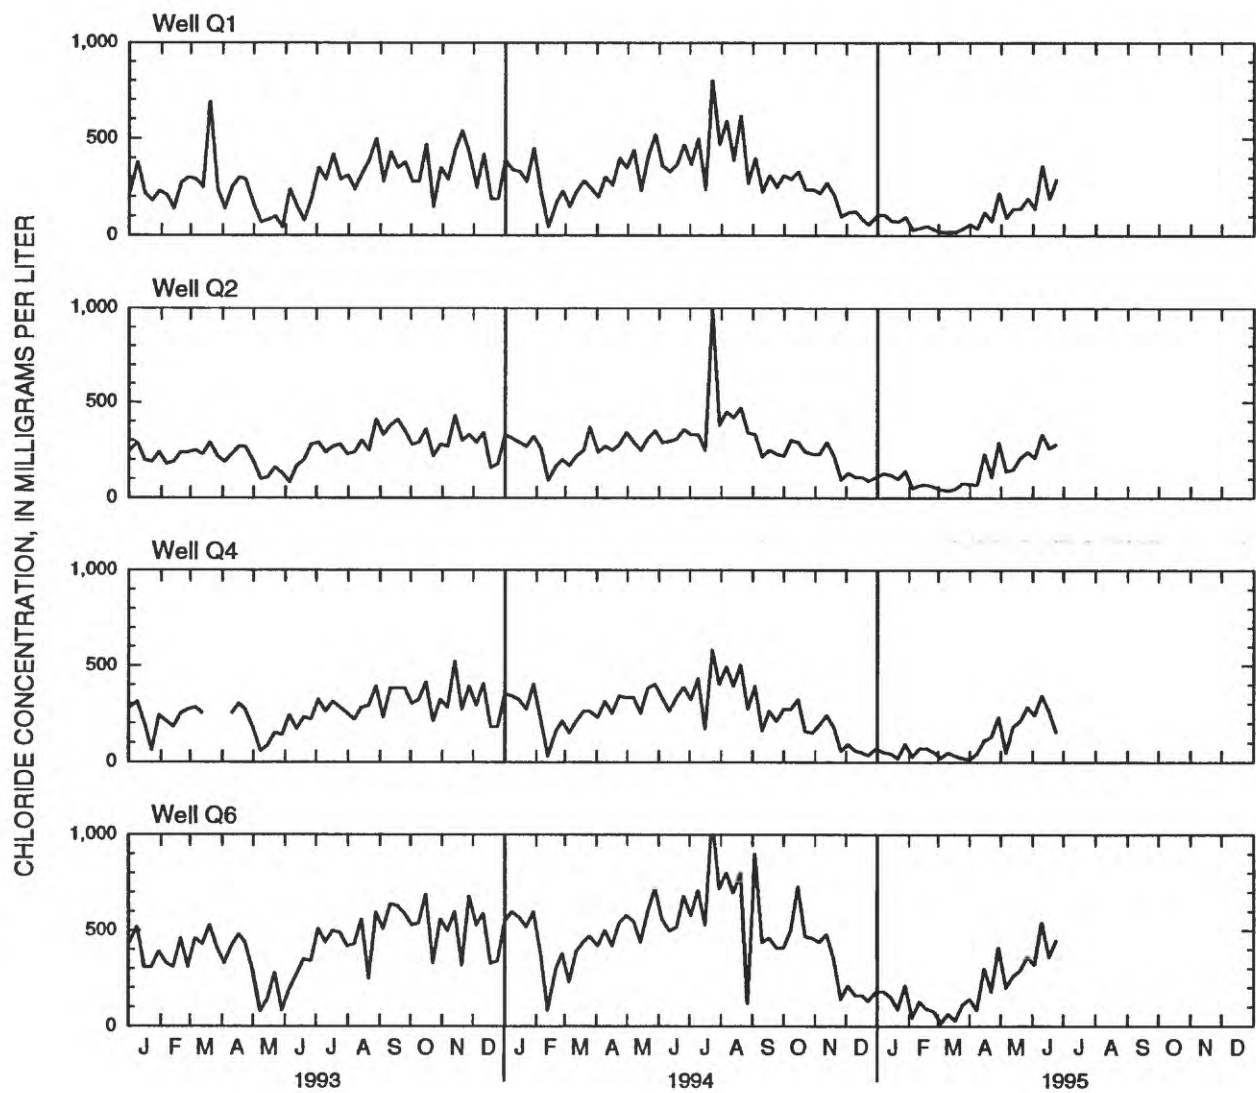


Figure C3. Chloride concentration of pumped water (sampled at weekly intervals) at wells Q1, Q2, Q4, and Q6 at Cantonment, Diego Garcia, January 1993 through June 1995.

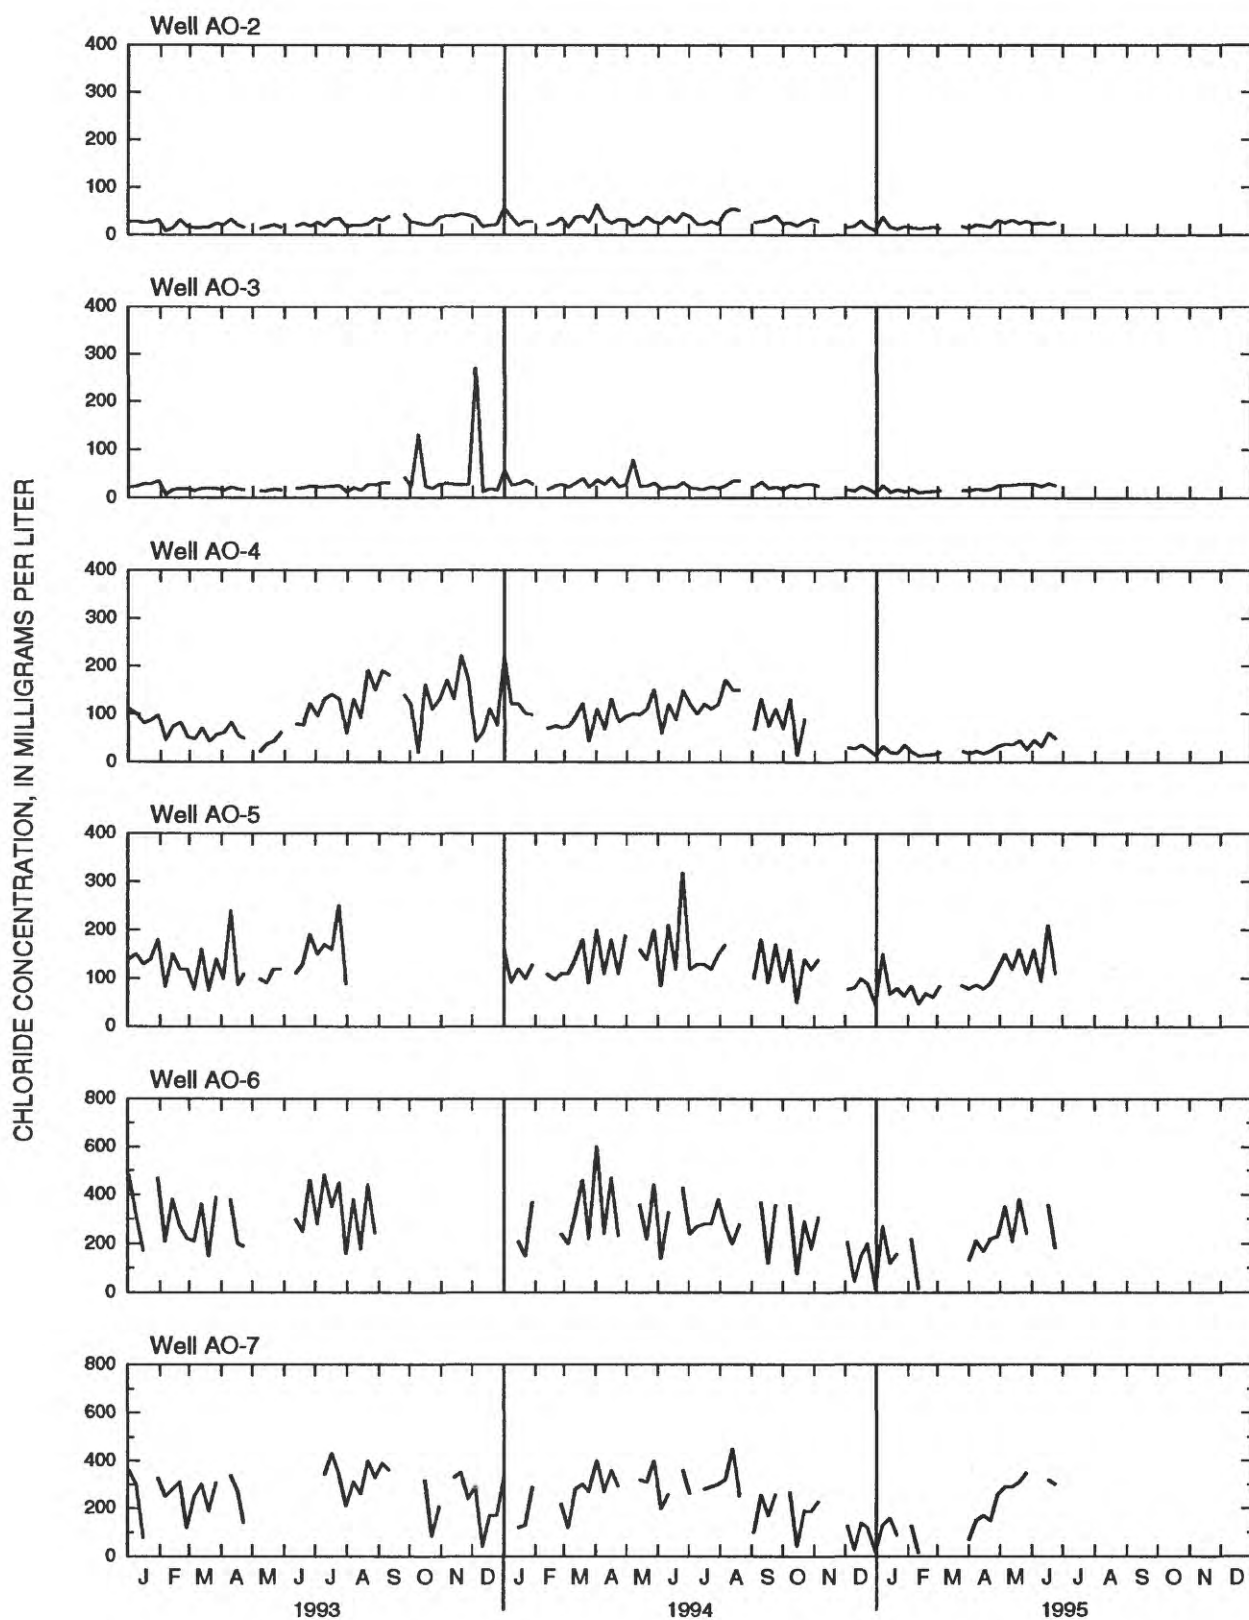


Figure C4. Chloride concentration of pumped water (sampled at weekly intervals) at wells AO-2 through AO-19 at Air Operations, Diego Garcia, January 1993 through June 1995. Water from well AO-13 has not been sampled since April 1993.

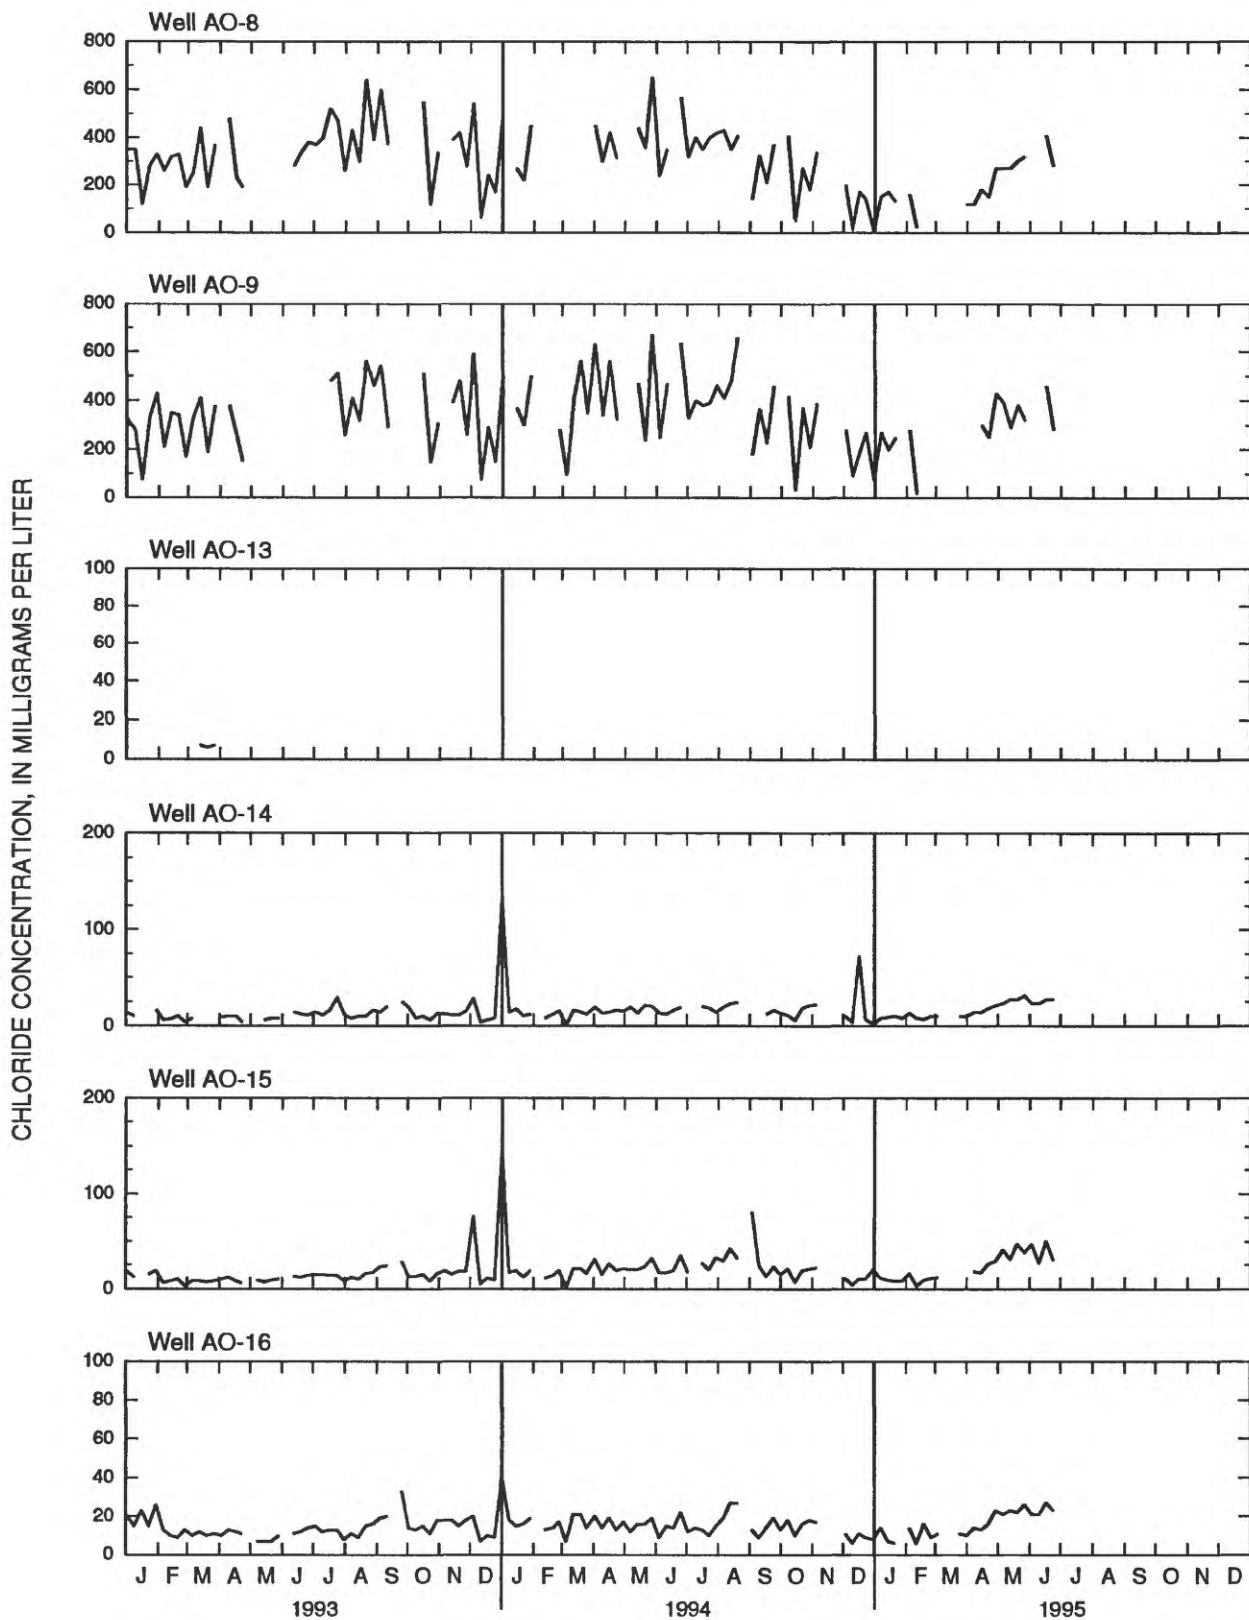


Figure C4 continued.--Chloride concentration of pumped water (sampled at weekly intervals) at wells AO-2 through AO-19 at Air Operations, Diego Garcia, January 1993 through June 1995. Water from well AO-13 has not been sampled since April 1993.

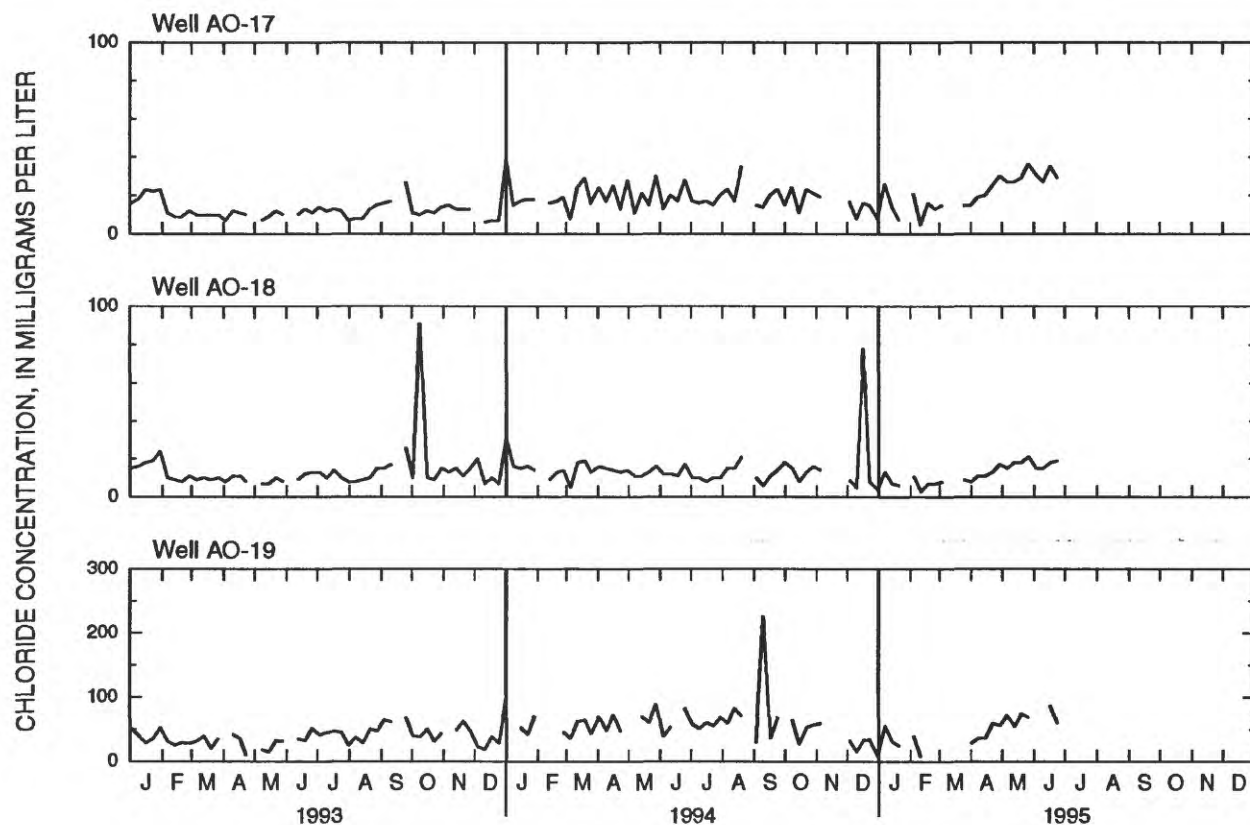


Figure C4 continued.--Chloride concentration of pumped water (sampled at weekly intervals) at wells AO-2 through AO-19 at Air Operations, Diego Garcia, January 1993 through June 1995. Water from well AO-13 has not been sampled since April 1993.

REFERENCES CITED

Torikai, J.D., 1995, Status of ground-water resources at U.S. Navy Support Facility, Diego Garcia: Summary of hydrologic and climatic data through September 1993; U.S. Geological Survey Open-File Report 94-306, 51 p.

U.S. Environmental Protection Agency, 1991, Secondary maximum contaminant levels (section 143.3 of part 143, National secondary drinking water regulations): U.S. Code of Federal Regulations, Title 40, Parts 100 to 149, revised through July 1, 1991.