


STATUS OF GROUND-WATER RESOURCES AT U.S. NAVY SUPPORT FACILITY, DIEGO GARCIA: SUMMARY OF HYDROLOGIC AND CLIMATIC DATA, JANUARY 1994 THROUGH MARCH 1996

U.S. GEOLOGICAL SURVEY

Open-File Report 96-349

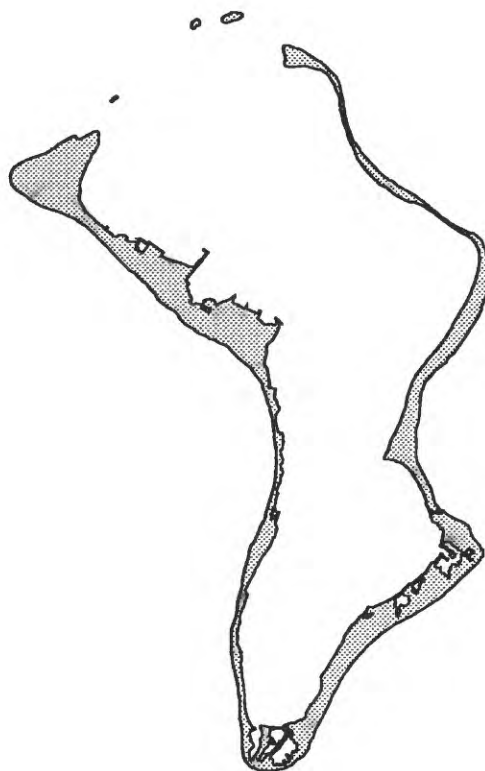

Prepared in cooperation with the

U.S. DEPARTMENT OF THE NAVY
NAVY SUPPORT FACILITY, DIEGO GARCIA



U.S. DEPARTMENT OF THE INTERIOR
BRUCE BABBITT, Secretary

U.S. GEOLOGICAL SURVEY
Gordon P. Eaton, Director

Any use of trade, product, or firm names in this publication
is for descriptive purposes only and does not imply
endorsement by the U.S. Government

For sale by:
U.S. Geological Survey
Branch of Information Services
Box 25286
Denver, CO 80225-0286

For additional information write to:
District Chief
U.S. Geological Survey
677 Ala Moana Blvd., Suite 415
Honolulu, HI 96813

CONTENTS

	Page
Executive Summary	1
Introduction	
Background	2
Organization of Report	2
Acknowledgments.....	3
Rainfall.....	5
Ground-Water Withdrawal	7
Chloride Concentration of Pumped Ground Water	9
Chloride Concentration of Ground Water in Monitoring Wells.....	11
Fuel-Diversion Program at Air Operations.....	14
Hydrologic-Data Section A. Maps of Production and Monitoring Wells at Cantonment and Air Operations	18
Hydrologic-Data Section B. Graphs of Monthly Mean Ground-Water Withdrawal, January 1994 through March 1996	23
Hydrologic-Data Section C. Graphs of Chloride Concentration of Pumped Water, January 1994 through March 1996	34
References Cited	43

FIGURES

	Page
1. Map showing areas of ground-water production, Diego Garcia.....	4
2. Graphs of monthly rainfall and monthly departure from mean monthly rainfall at Air Operations, Diego Garcia, January 1994 through March 1996.....	6
3. Graphs of monthly mean ground-water withdrawal islandwide and in the ground-water production areas, Diego Garcia, January 1994 through March 1996	8
4. Graphs of chloride concentration of pumped water in the ground-water production areas, Diego Garcia, January 1994 through March 1996	10
5. Graphs of chloride concentration of ground water (sampled at monthly intervals) in monitoring wells at site AW16 at Cantonment, Diego Garcia, January 1994 through March 1996	12
6. Graphs of chloride concentration of ground water (sampled at monthly intervals) in monitoring wells at site BW09 at Air Operations, Diego Garcia, January 1994 through March 1996	13
7. Graphs of monthly mean ground-water withdrawal and injection at wells AO-10 through AO-15 at Air Operations, Diego Garcia, January 1994 through March 1996.....	16

TABLE

	Page
1. Target and actual withdrawal and injection rates for fuel-diversion program.....	15

CONVERSION FACTORS AND ABBREVIATION

Multiply	By	To obtain
foot (ft)	0.3048	meter
gallon (gal)	3.785	liter
gallon per day (gal/d)	3.785	liter per day
million gallons per day (Mgal/d)	0.04381	cubic meter per second
inch (in.)	25.4	millimeter
inch per year (in/yr)	25.4	millimeter per year

Abbreviation used in water-quality descriptions

mg/L = milligrams per liter

**STATUS OF GROUND-WATER RESOURCES AT
U.S. NAVY SUPPORT FACILITY, DIEGO GARCIA:
SUMMARY OF HYDROLOGIC AND CLIMATIC DATA,
JANUARY 1994 THROUGH MARCH 1996**

EXECUTIVE SUMMARY

This report describes the status of ground-water resources at U.S. Navy Support Facility, Diego Garcia. Data presented are from January 1994 through March 1996, with a focus on data from January through March 1996 (first quarter of 1996). A complete database of ground-water withdrawals and chloride-concentration records since 1985 is maintained by the U.S. Geological Survey.

1. RAINFALL--Cumulative rainfall for January through March 1996 was about 30 inches, which is 9 percent less than the mean cumulative rainfall of about 33 inches for January through March. The period January through February is the end of the annual wet season, while March marks the start of the annual dry season.

2. GROUND-WATER WITHDRAWAL--Ground-water withdrawal during January through March 1996 averaged 970,300 gallons per day. Withdrawal for the same 3 months in 1995 averaged 894,600 gallons per day. Withdrawal patterns during the first quarter of 1996 did not change significantly since 1991, with the Cantonment and Air Operations areas supplying about 99 percent of total islandwide pumpage.

3. CHLORIDE CONCENTRATION OF PUMPED GROUND WATER--At the end of March 1996, the chloride concentration of water from the elevated tanks at Cantonment and Air Operations were 47 and 80 milligrams per liter, respectively. The chloride data from all five production areas showed no significant upward or downward trends throughout the first quarter of 1996. Potable levels of chloride concentrations have been maintained by adjusting individual pumping rates, and also because of the absence of long-term droughts.

4. CHLORIDE CONCENTRATION OF GROUND WATER IN MONITORING WELLS--Chloride concentration of ground water in monitoring wells at Cantonment and Air Operations also showed no significant trends throughout the first quarter of 1996. Chloride concentrations have been about the same since the last quarter of 1995.

5. FUEL-DIVERSION PROGRAM AT AIR OPERATIONS--A fuel-pipeline leak at Air Operations in May 1991 decreased total islandwide withdrawals by 15 percent. This lost pumping capacity is being offset by increased pumpage at Cantonment. Six wells do not contribute to the water supply because they are being used to hydraulically divert fuel migration away from water-supply wells by a program of ground-water withdrawal and injection.

**STATUS OF GROUND-WATER RESOURCES AT
U.S. NAVY SUPPORT FACILITY, DIEGO GARCIA:
SUMMARY OF HYDROLOGIC AND CLIMATIC DATA,
JANUARY 1994 THROUGH MARCH 1996**

By Jill D. Torikai

INTRODUCTION

Background

Diego Garcia Atoll is part of the British Indian Ocean Territory and the site of a U.S. Navy Support Facility. The island's drinking-water supply is derived from ground water, and recharge to the ground-water system is from rainfall. Since 1985, the island's water-supply system has produced about 1 Mgal/d by maintaining low individual pumping rates at the many scattered wells (Torikai, 1995). Ground water is pumped from lens-shaped bodies of freshwater floating on seawater. Chloride concentrations of the water have been kept at acceptable levels for drinking by adjusting individual pumping rates. The water-supply system, which has been in operation since 1978, has more than 100 active wells in five production areas (fig. 1). Water from the Cantonment and Air Operations areas combined account for about 99 percent of total islandwide pumpage. The remainder is pumped for local use at Industrial Site South (I-Site), Transmitter Site (T-Site), and GEODSS Site.

Long-term ground-water management has been facilitated by a cooperative agreement between the Navy Support Facility (NAVSUPFAC) and the U.S. Geological Survey (USGS) since 1984. However, USGS involvement at Diego Garcia began in 1978 with hydrogeologic investigations for the Naval Facilities Engineering Command, Pacific Division. The study provided estimates of ground-water resource potential, and helped with the subsequent design, layout, and testing of the water-supply wells (D.A. Davis, USGS, 1979, written commun. to U.S. Navy).

Organization of Report

This data summary contains hydrologic and climatic data that describe the status of ground-water resources at Navy Support Facility, Diego Garcia. Data presented are from January 1994 through March 1996. Data of primary relevance to the water supply are:

1. Rainfall
2. Volume of ground water withdrawn at production wells
3. Chloride concentration of pumped ground water
4. Chloride concentration of ground water sampled from monitoring wells
5. Volume of ground water injected at Air Operations

The following narrative highlights trends in the data for January through March 1996, and makes comparisons with historical data. Ground-water withdrawal and chloride concentrations

of water from individual wells are presented in the “Hydrologic-Data Section.” The data section contains the following:

- A. Maps of production and monitoring wells at Cantonment and Air Operations
- B. Graphs of monthly mean ground-water withdrawal, January 1994 through March 1996
- C. Graphs of chloride concentration of pumped water, January 1994 through March 1996

Acknowledgments

Ground-water data were provided by the NAVSUPPFAC, Public Works Department, and rainfall data were from Naval Pacific Meteorology and Oceanography Detachment (NAVPACMETOC DET). Logistical support from the staff of the Public Works Department is greatly appreciated.

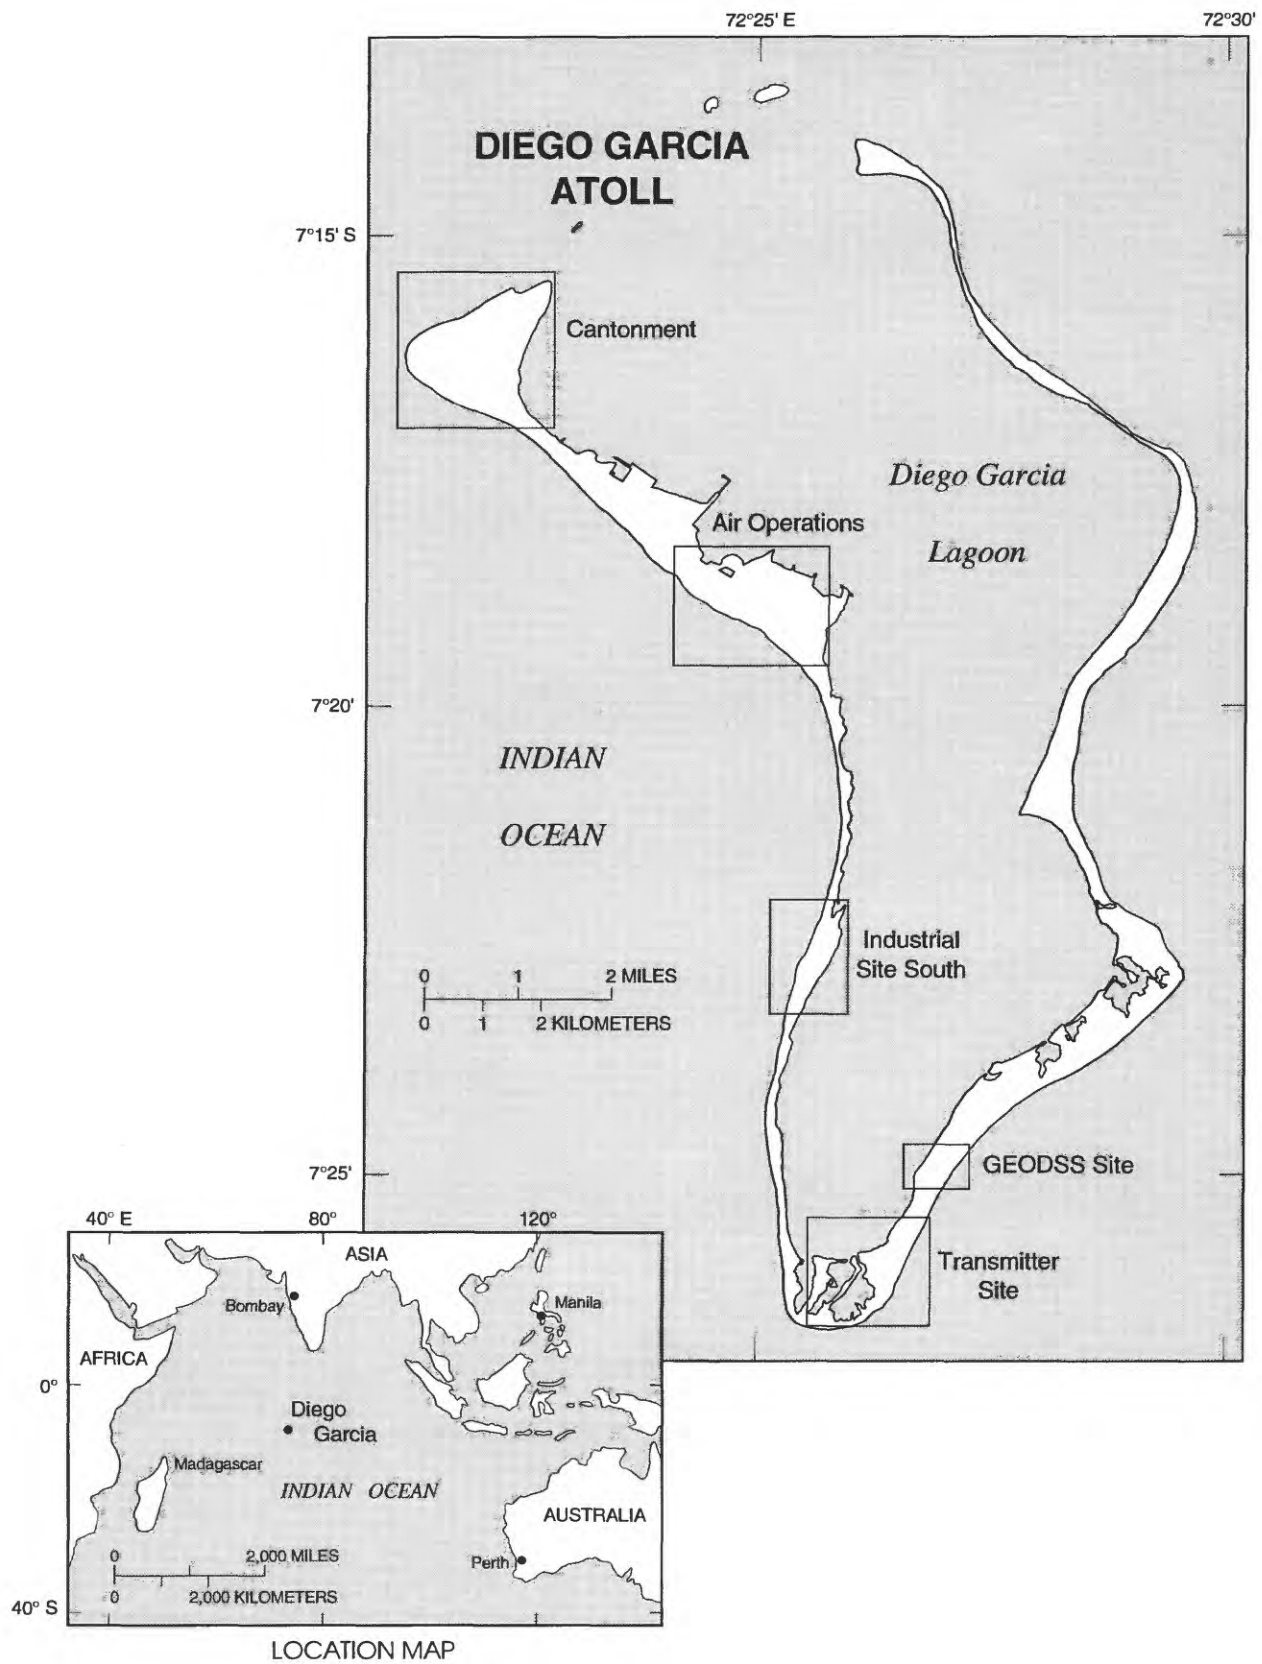


Figure 1. Areas of ground-water production, Diego Garcia.


RAINFALL

Background.--Rainfall data are available since 1951, and all mean rainfall values in this report are calculated for the fixed base period 1951-90. The mean annual rainfall at Diego Garcia is 105.78 in/yr. Rainfall varies considerably from month to month and from year to year. A wet season occurs from about September through February, and a dry season occurs from about March through August.

Recent trends.--Cumulative rainfall for January through March 1996 was 29.61 inches, which is 9 percent less than the mean cumulative rainfall of 32.52 inches for January through March. For the same 3 months in 1994 and 1995, the cumulative rainfall was 37.37 inches and 41.98 inches, respectively. For reference, in 1994 the total rainfall of 131.17 inches was 24 percent above the mean annual rainfall, while in 1995 the total rainfall of 111.55 inches was 5 percent above the mean.

Figure 2 shows graphs of recorded rainfall amounts and rainfall departures from mean monthly rainfall values that were averaged for the base period 1951-90. The months of January and February are part of the annual wet season, while March is the start of the dry season. Periods of below average rainfall can be inferred from the graph when the departure from the mean monthly rainfall is less than zero. Rainfall for January and February was below the respective mean monthly rainfall for January and February, but rainfall was above the respective mean monthly for March.

RAINFALL, IN INCHES

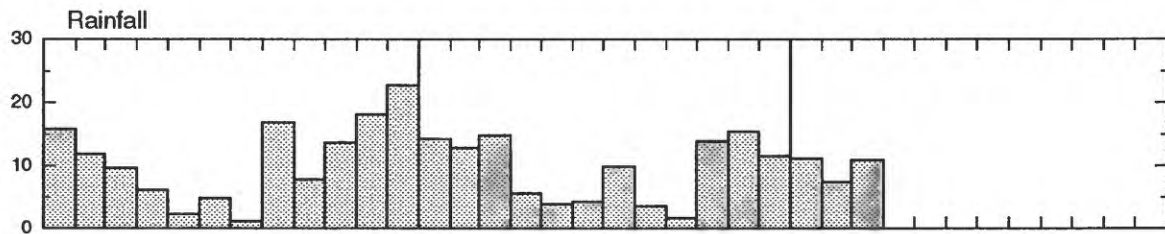

DEPARTURE, IN INCHES

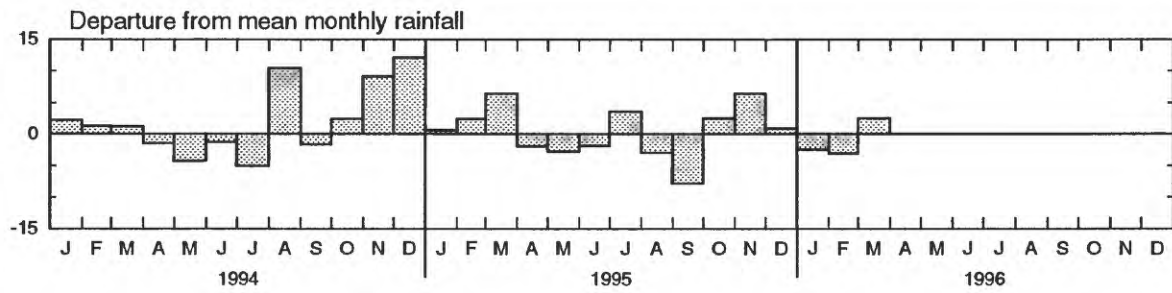


Figure 2. Monthly rainfall and monthly departure from mean monthly rainfall at Air Operations, Diego Garcia, January 1994 through March 1996.

GROUND-WATER WITHDRAWAL

Background.--Withdrawal is measured by flow meters at all production wells and storage tanks in the water system, and is recorded daily. There are 102 production wells in 5 ground-water production areas, of which 80 wells are in the Cantonment area and 18 are in the Air Operations area (figs. A1, A2). The wells in the Cantonment area are further separated into sub-groups, and the measured ground-water withdrawals are presented as such in this report. About 80 percent of total islandwide pumpage is from Cantonment, and about 19 percent is from Air Operations, with the remainder from the other three ground-water production areas.

Pumpage from the Cantonment area increased in 1991 because of decreased pumpage at Air Operations (Torikai, 1995). From May 1991 through April 1992, 10 wells at Air Operations were temporarily secured because of an underground fuel-pipeline leak near those wells. Pumping resumed at four wells in May 1992, but six Air Operations wells still do not contribute to the water supply because of their proximity to the fuel leak. The lost pumping capacity is about 15 percent of the total islandwide withdrawal, and is being offset by increased pumpage at Cantonment.

Recent trends.--Figure 3 shows time-series graphs of monthly mean withdrawal islandwide and in each ground-water production area from January 1994 through March 1996. Total islandwide withdrawal increased from 894,600 gal/d during January through March 1995 to 970,300 gal/d during January through March 1996. Patterns of withdrawal during the first quarter of 1996 have not changed significantly in all areas since May 1991 (Torikai, 1995). Changes in monthly mean withdrawal during the past 18 months at T-Site and GEODSS Site are probably a result of changes in demand because ground water withdrawn from these areas is for local use.

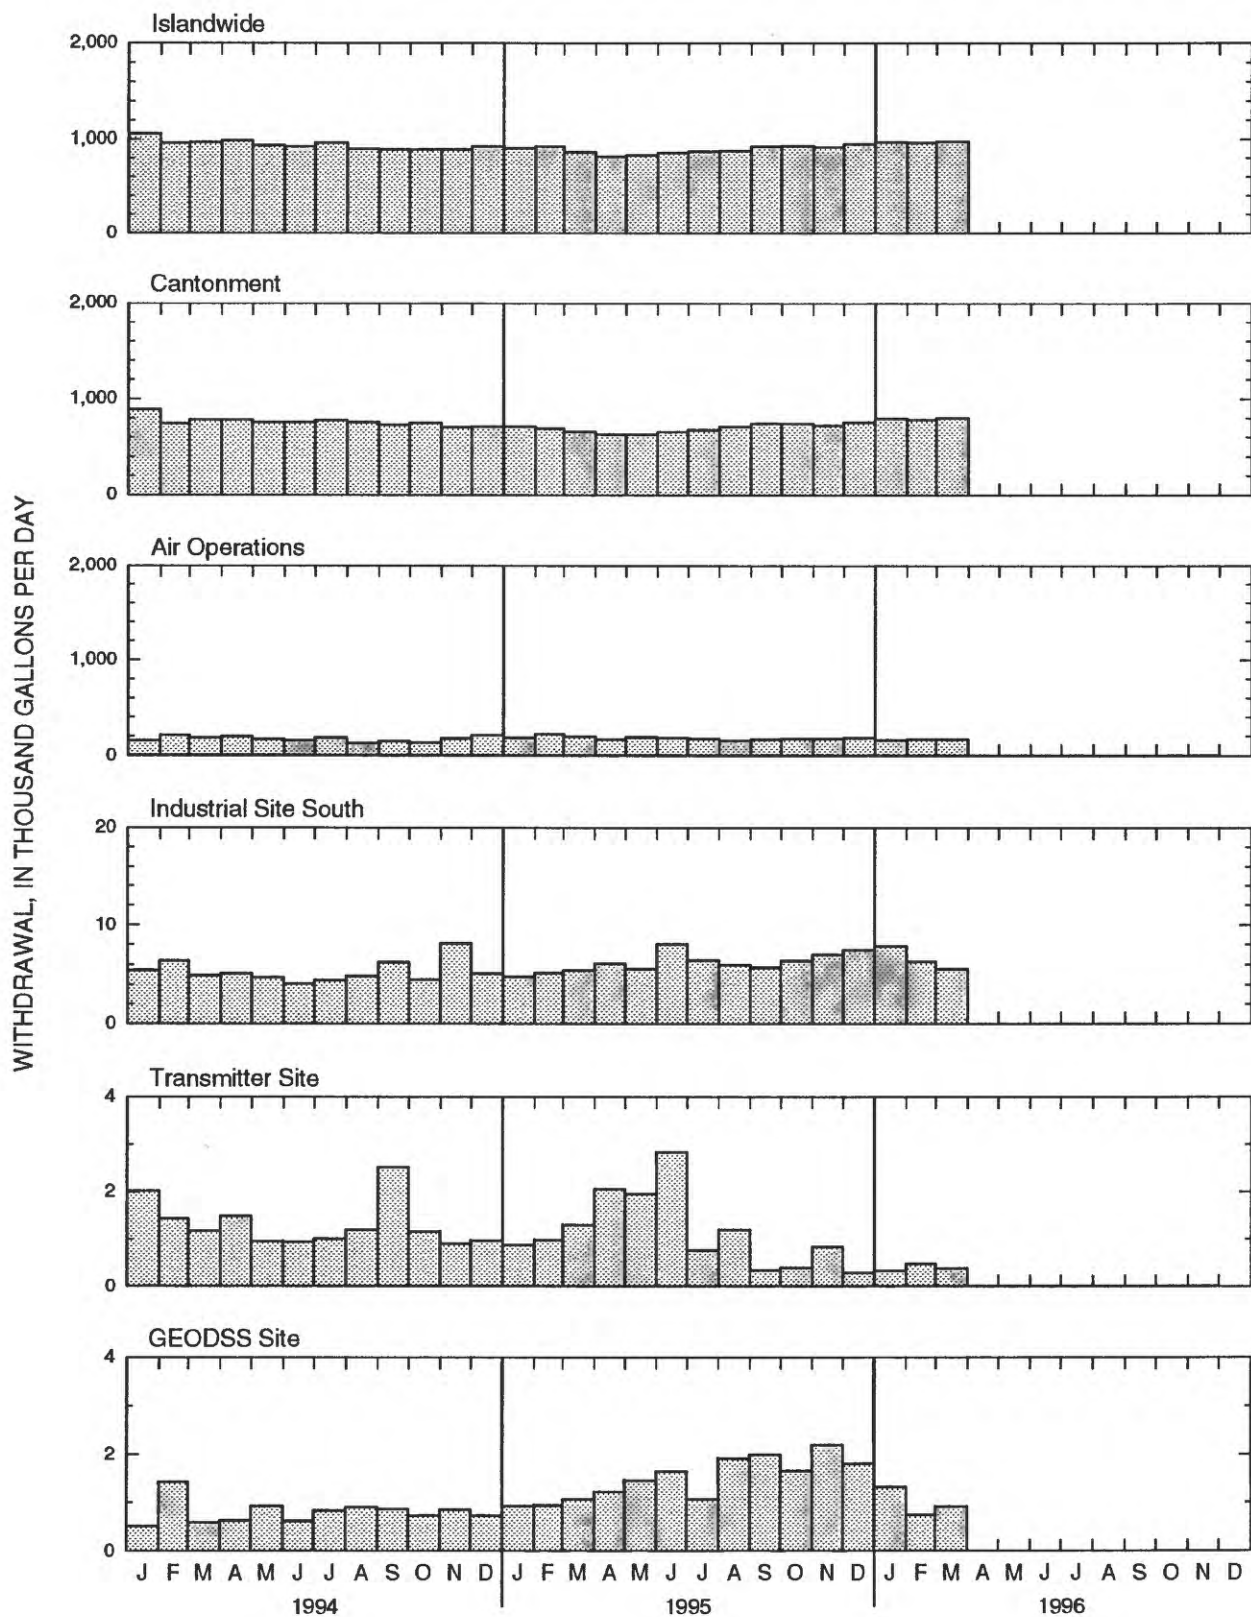


Figure 3. Monthly mean ground-water withdrawal islandwide and in the ground-water production areas, Diego Garcia, January 1994 through March 1996.

CHLORIDE CONCENTRATION OF PUMPED GROUND WATER

Background.--In this report, chloride concentration is used as a quantitative measure of salinity. Chloride concentration in seawater at Diego Garcia is about 19,500 mg/L whereas a concentration of 250 mg/L is the secondary maximum contaminant level (SMCL) under secondary drinking-water standards (U.S. Environmental Protection Agency, 1991). Secondary standards are not enforceable limits, but instead establish goals for constituents that may affect the aesthetic qualities of drinking water, such as taste or color.

Chloride concentration is analyzed daily from water samples collected from the elevated tanks at Cantonment and Air Operations, and from the tap at I-Site, T-Site, and GEODSS Site. These samples are representative of each of the five ground-water production areas. Water is also sampled at weekly intervals for chloride concentration at all individual wells and storage tanks in the water-supply system. This report uses the daily chloride concentrations that represent the five production areas. However, the data used for discussion are the chloride concentrations from every seventh day that are extracted from the daily record.

Recent trends.--The chloride concentration of water showed no significant upward or downward trends in the five ground-water production areas during the first quarter of 1996 (fig. 4). At Cantonment and Air Operations, which account for about 99 percent of all pumped water, the chloride concentrations have remained at about 50 and 100 mg/L, respectively, since about April 1995. Chloride-concentration data for I-Site, T-Site, and GEODSS Site have decreased by 50 to 100 mg/L since December 1995.

At the end of March 1996, the chloride concentration of water from the elevated tanks at Cantonment and Air Operations were 47 and 80 mg/L, respectively. This is well below the 250 mg/L secondary drinking-water standard.

RAINFALL, IN INCHES

CHLORIDE CONCENTRATION, IN MILLIGRAMS PER LITER

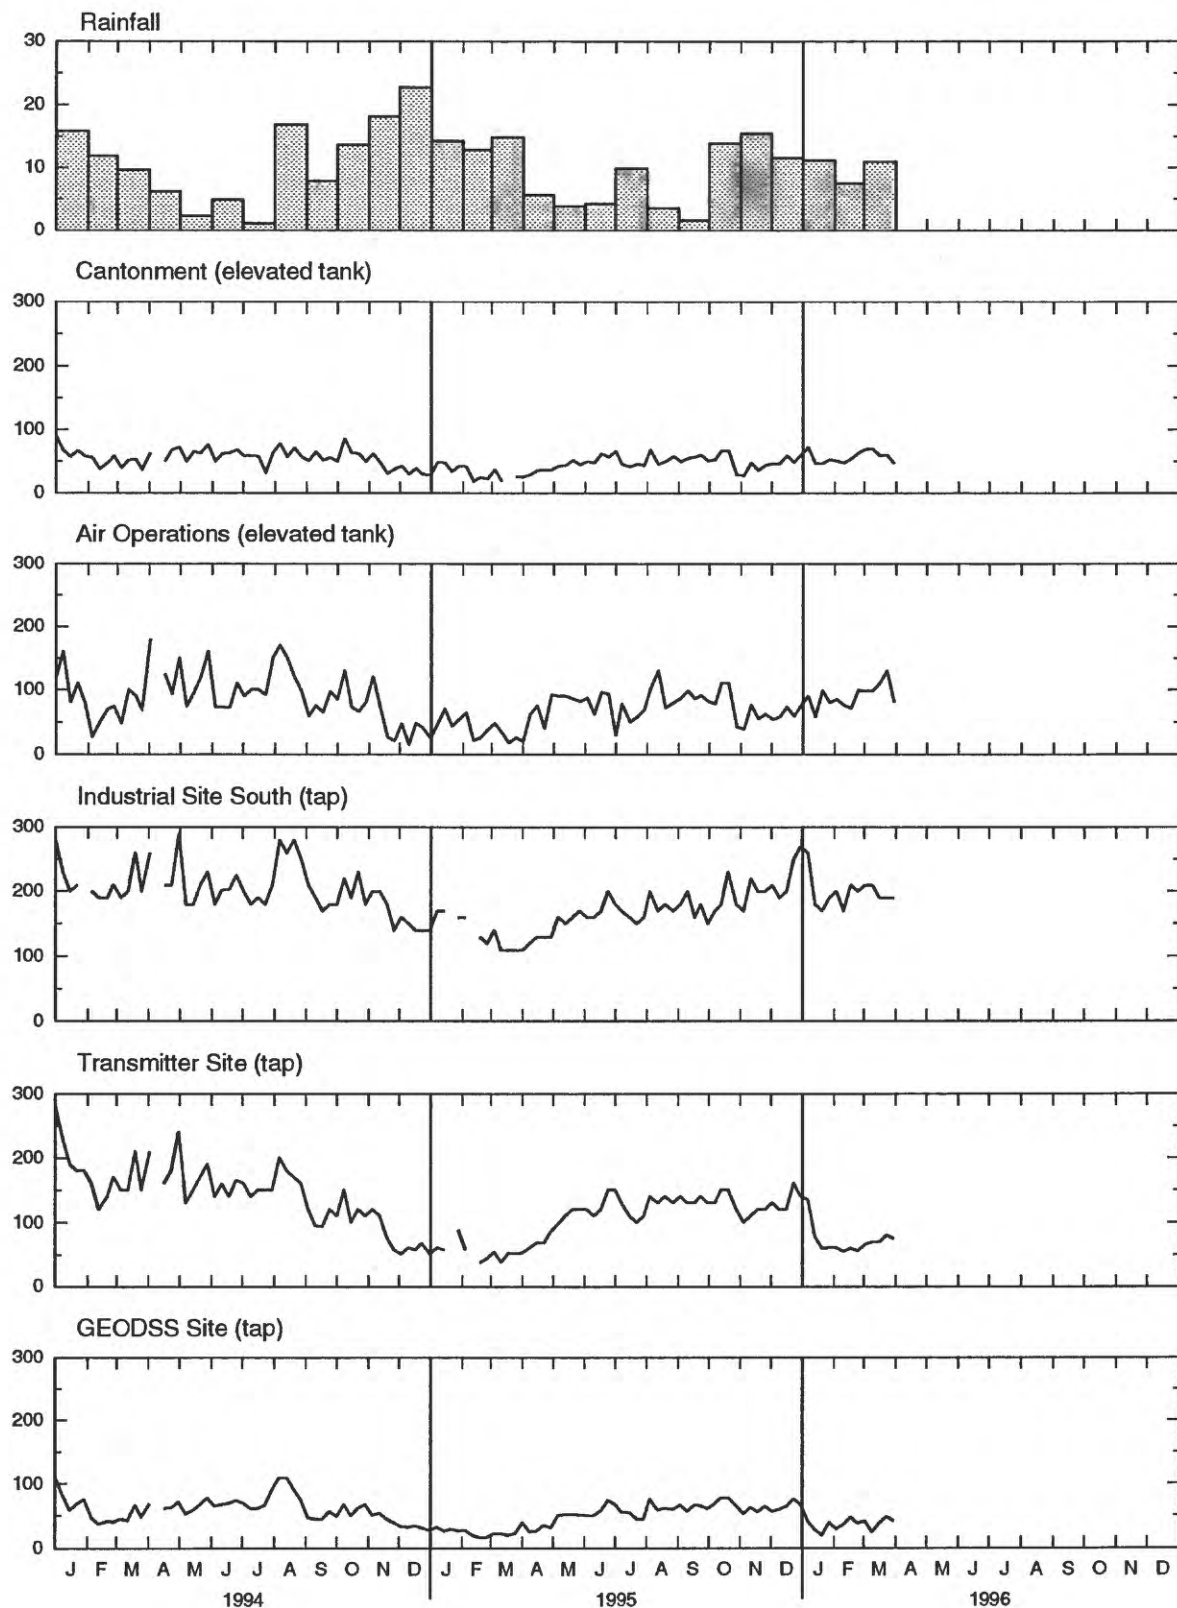


Figure 4. Chloride concentration of pumped water in the ground-water production areas, Diego Garcia, January 1994 through March 1996. Data shown are values from every seventh day extracted from the daily record. Rainfall data are shown for comparison.


CHLORIDE CONCENTRATION OF GROUND WATER IN MONITORING WELLS

Background.--Ground-water chloride concentration is measured monthly at 35 monitoring-well sites (figs. A3, A4) to help estimate the thickness of the freshwater lenses. Each site comprises several wells, with each well having a short screened (open) interval that bottoms at a different depth. The deeper wells usually tap the freshwater-saltwater mixing zones that underlie the freshwater lenses. Chloride concentrations of water from these deep monitoring wells will typically provide the earliest indication that the freshwater lenses may be constricting.

Recent trends.--Monitoring sites AW16 and BW09 were selected to show trends in ground-water chloride concentration at Cantonment and Air Operations, respectively. Figures 5 and 6 show time-series graphs of chloride concentration at three depths at the Cantonment and Air Operations sites, respectively, with rainfall data included in the figures for climatic reference.

Chloride concentrations of the water remained fairly steady at both sites during the period January through March 1996. Chloride concentrations from these selected sites have either slightly decreased or remained about the same since the start of the last annual wet season, which began in September 1995 and ended in February 1996. Changes in concentration may lag behind the change in climatic seasons by 1 or 2 months (figs. 5 and 6). March marks the start of the annual dry season.

RAINFALL, IN INCHES

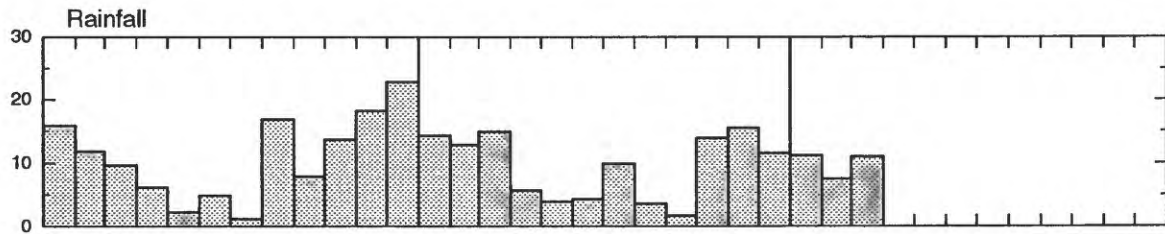

CHLORIDE CONCENTRATION, IN MILLIGRAMS PER LITER


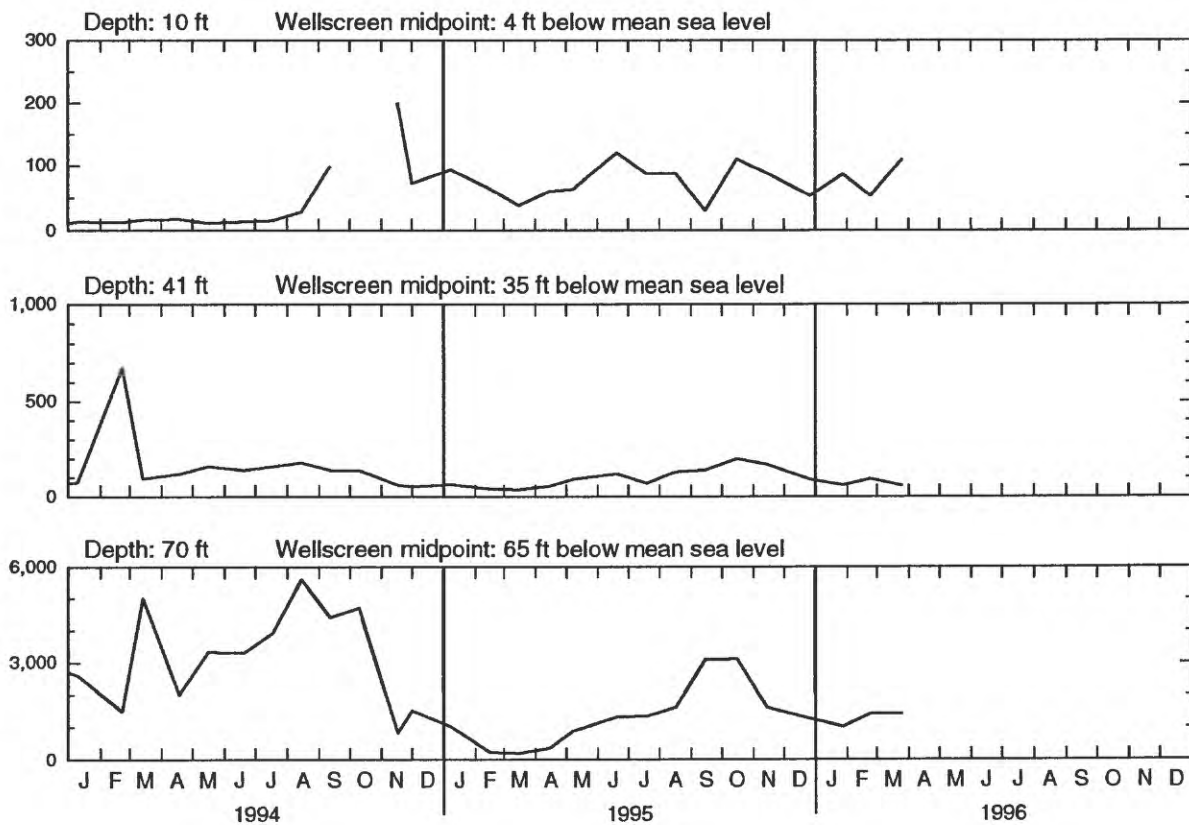


Figure 5. Chloride concentration of ground water (sampled at monthly intervals) in monitoring wells at site AW16 at Cantonment, Diego Garcia, January 1994 through March 1996. Rainfall data are shown for comparison.

RAINFALL, IN INCHES

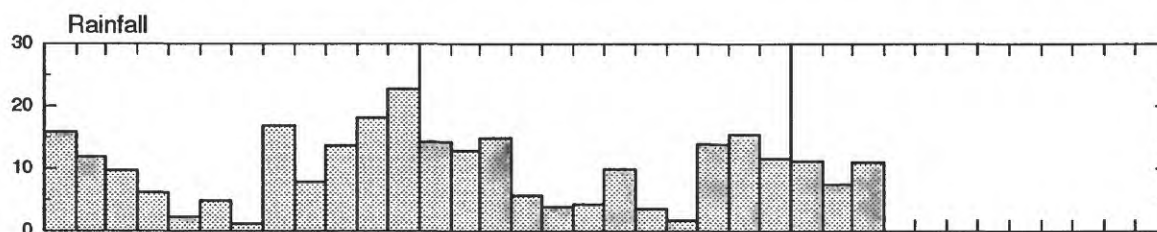

CHLORIDE CONCENTRATION, IN MILLIGRAMS PER LITER

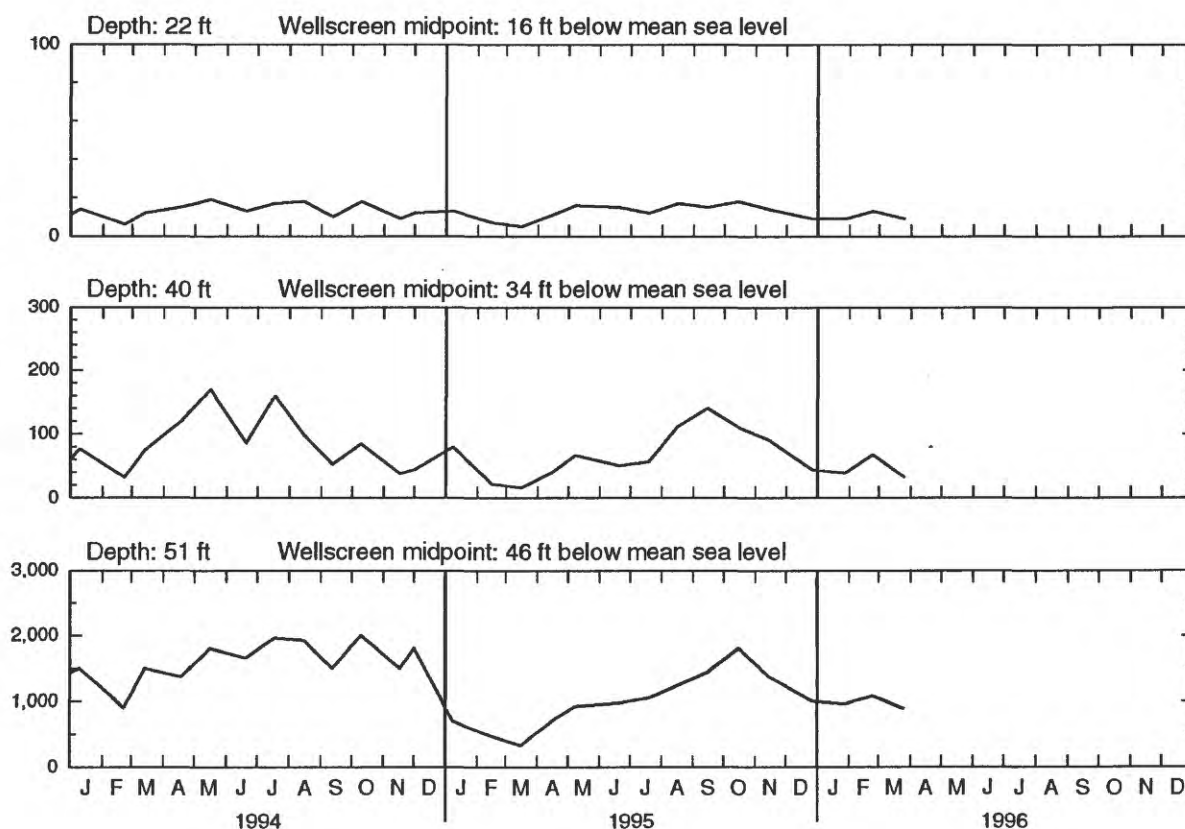


Figure 6. Chloride concentration of ground water (sampled at monthly intervals) in monitoring wells at site BW09 at Air Operations, Diego Garcia, January 1994 through March 1996. Rainfall data are shown for comparison.

FUEL-DIVERSION PROGRAM AT AIR OPERATIONS

Background.--The normal pattern of ground-water withdrawal at Air Operations has been disrupted since May 1991 by a JP-5 jet-fuel leak at the South Ramp parking apron (fig. A2). The leak was about 800 ft upgradient of several water-supply wells.

In August 1991, the USGS suggested a scheme to hydraulically alter the natural ground-water flow direction in the Air Operations area, and in April 1992, the program to divert fuel away from the production wells was initiated. The fuel-diversion program consists of the injection of water into three wells closest to the leak using water pumped from two other wells. An elevated mound in the water table helps to retard the migration of fuel toward the water-supply wells. Subsequent to the leak detection, 10 wells were secured from May 1991 to April 1992. However, with the inception of the diversion program, only six wells still do not contribute to the water supply. Lost production capacity is about 15 percent of total islandwide pumpage prior to the leak detection.

The fuel-diversion program is a closed recirculation loop of withdrawal and injection. It utilizes six wells (AO-10 through AO-15), and consists of pumping about 150,000 gal/d of water from wells AO-14 and AO-15 and directing this water through the common collection main to the wells nearest the leak (AO-10 through AO-12), where it is injected back into the ground. Well AO-13 has been used only intermittently since the fuel leak detection 1991 (Torikai, 1995). It is expected that the fuel-diversion program will continue until the site is remediated.

Injection data for wells AO-10 through AO-12 from May 10, 1993 through March 1996 are actual water-meter readings. From April 1992 through early May 1993, meter readings of injection were not available, and daily injection at each of the three wells was estimated to be one-third of the total daily withdrawal from wells AO-13 through AO-15 which provided the injection-supply water (Torikai, 1995). Monthly mean withdrawal and injection at wells AO-10 through AO-15 are shown in figure 7.

Recent trends.--Withdrawal and injection rates for wells in the fuel-diversion program did not change significantly during the period January through March 1996. Actual pumping rates of these six wells have been very close to the established target rates. Target withdrawal and injection rates are listed in table 1 for wells AO-10 through AO-15. Daily mean withdrawal and injection rates for these wells are also shown.

Table 1. Target and actual withdrawal and injection rates for fuel-diversion program.
 [Injection is denoted by negative values; all values are in gallons per day.]

Well	Target rates	Daily mean rates, January through March 1996
AO-10	-30,000	-33,000
AO-11	-50,000	-45,300
AO-12	-70,000	-80,200
AO-13	0	0
AO-14	70,000	74,500
AO-15	80,000	76,100

WITHDRAWAL AND INJECTION, IN THOUSAND GALLONS PER DAY

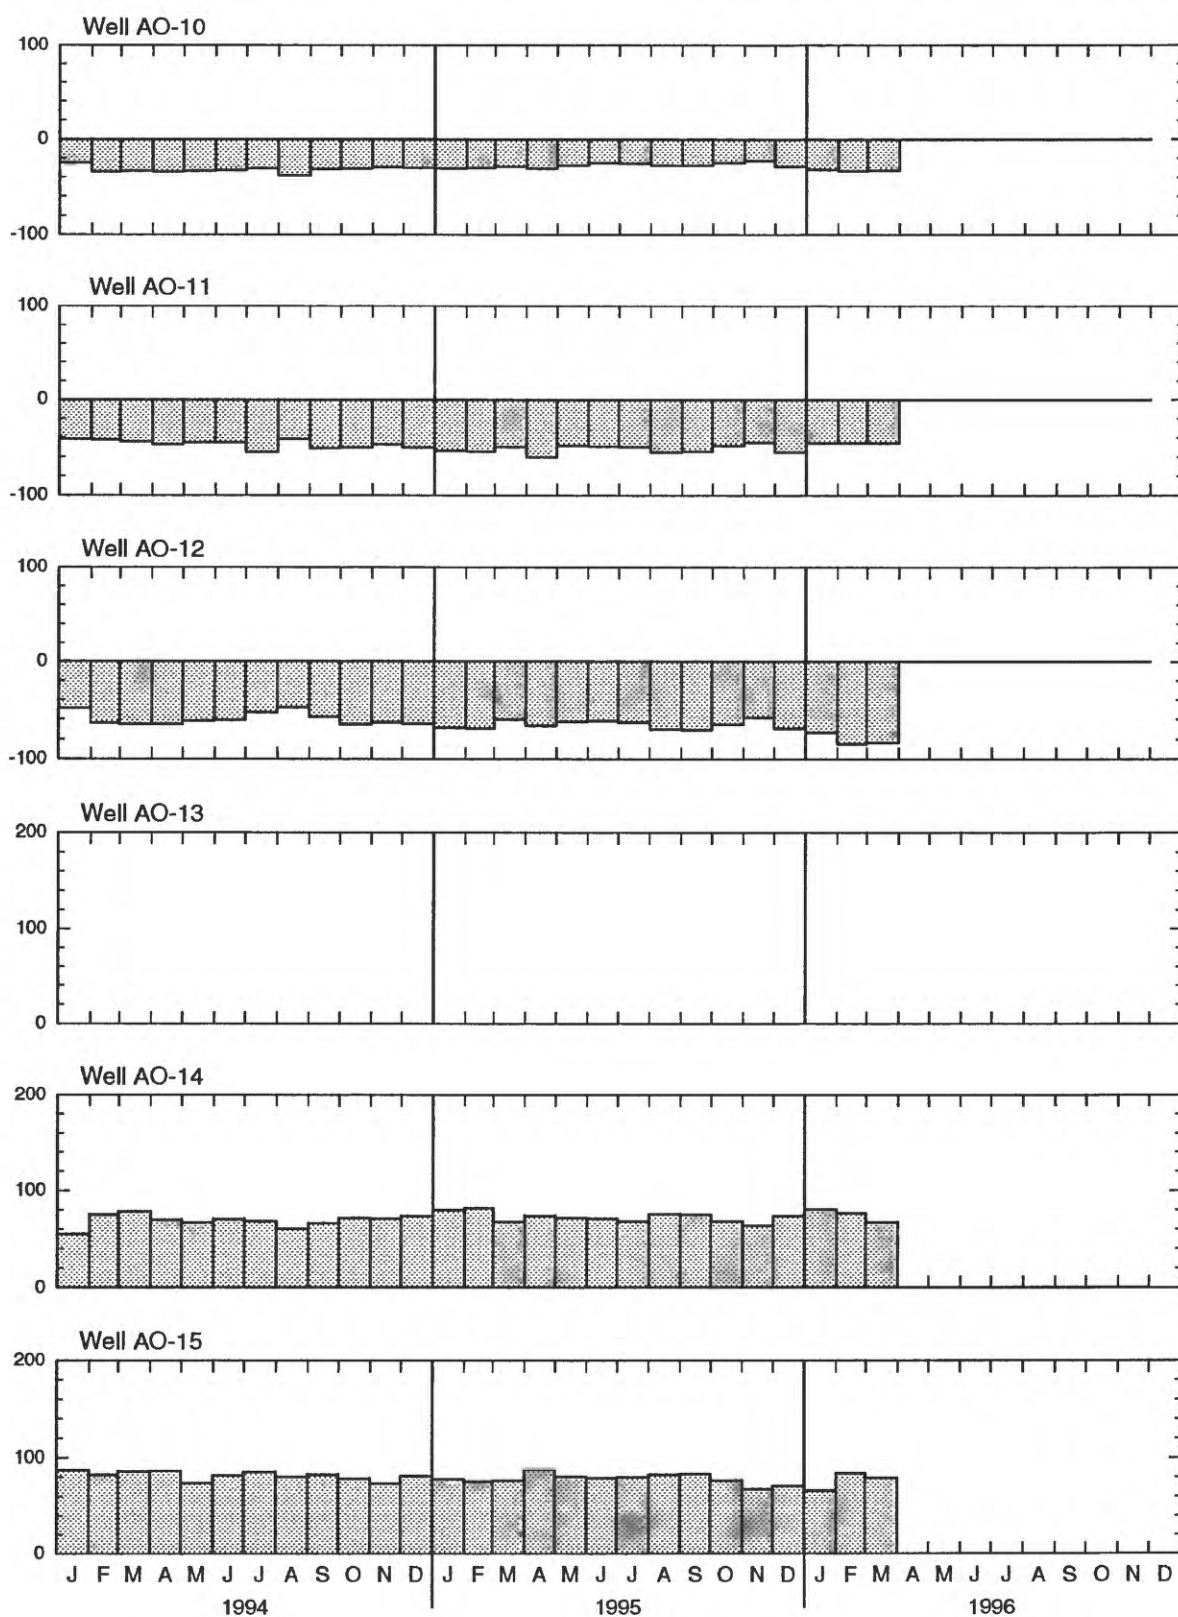


Figure 7. Monthly mean ground-water withdrawal and injection at wells AO-10 through AO-15 at Air Operations, Diego Garcia, January 1994 through March 1996. Injection is plotted as negative.

HYDROLOGIC-DATA SECTION

TYPES OF DATA INCLUDED

- A. Maps of production and monitoring wells at Cantonment and Air Operations
- B. Graphs of monthly mean ground-water withdrawal, January 1994 through March 1996
- C. Graphs of chloride concentration of pumped water, January 1994 through March 1996

DESCRIPTIONS OF PRINCIPAL PRODUCTION SOURCES AT CANTONMENT AND AIR OPERATIONS AREAS

Cantonment Area


- 1. Modules A, C through L - each module is a well field of five to eight vertical wells that are pumped to a common collection/transfer tank.
- 2. Module B is a horizontal well with a collection/transfer tank; has not pumped since August 1986.
- 3. Wells H1 through H7 are horizontal wells.
- 4. Quad wells are a well field of four vertical wells; originally, six wells drilled.
- 5. Jungle wells are a well field of 11 vertical wells; have not pumped since February 1987.

Air Operations Area

- 1. Wells AO-2 through AO-5 are vertical wells.
- 2. Wells AO-6 through AO-9 are horizontal wells.
- 3. Wells AO-10 through AO-12 are horizontal wells; currently receiving injection water to divert fuel contaminants from a nearby leak. No samples are currently collected for chloride-concentration analysis.
- 4. Wells AO-13 through AO-15 are horizontal wells; AO-14 and AO-15 are currently pumping water to injection wells AO-10 through AO-12, while AO-13 is not pumping.
- 5. AO-16 through AO-19 are horizontal wells.

SECTION A

Maps of production and monitoring wells at Cantonment and Air Operations

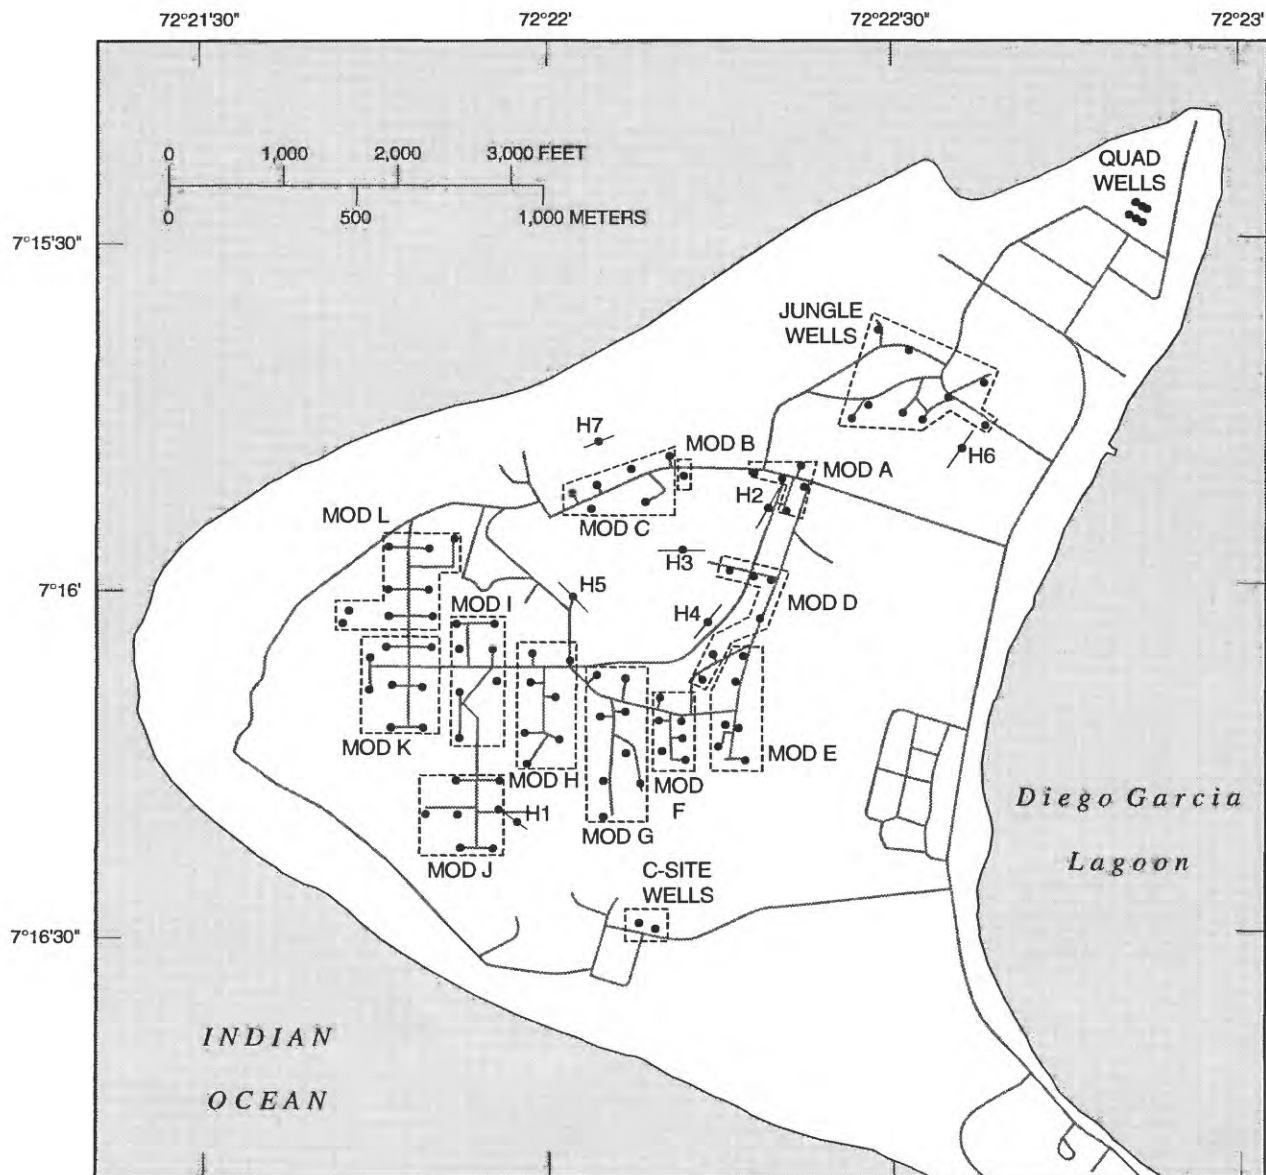

EXPLANATION	
QUAD WELLS	VERTICAL WELL AND WELL OR WELL FIELD DESIGNATION--Typical pumping rate 10 to 12 gallons per minute
H7	HORIZONTAL WELL AND DESIGNATION--Typical pumping rate 50 to 75 gallons per minute
MOD E	WELL MODULE AND DESIGNATION--Vertical wells that pump to a common 1,000-gallon collection and transfer tank

Figure A1. Ground-water production wells and well fields at Cantonment, Diego Garcia.


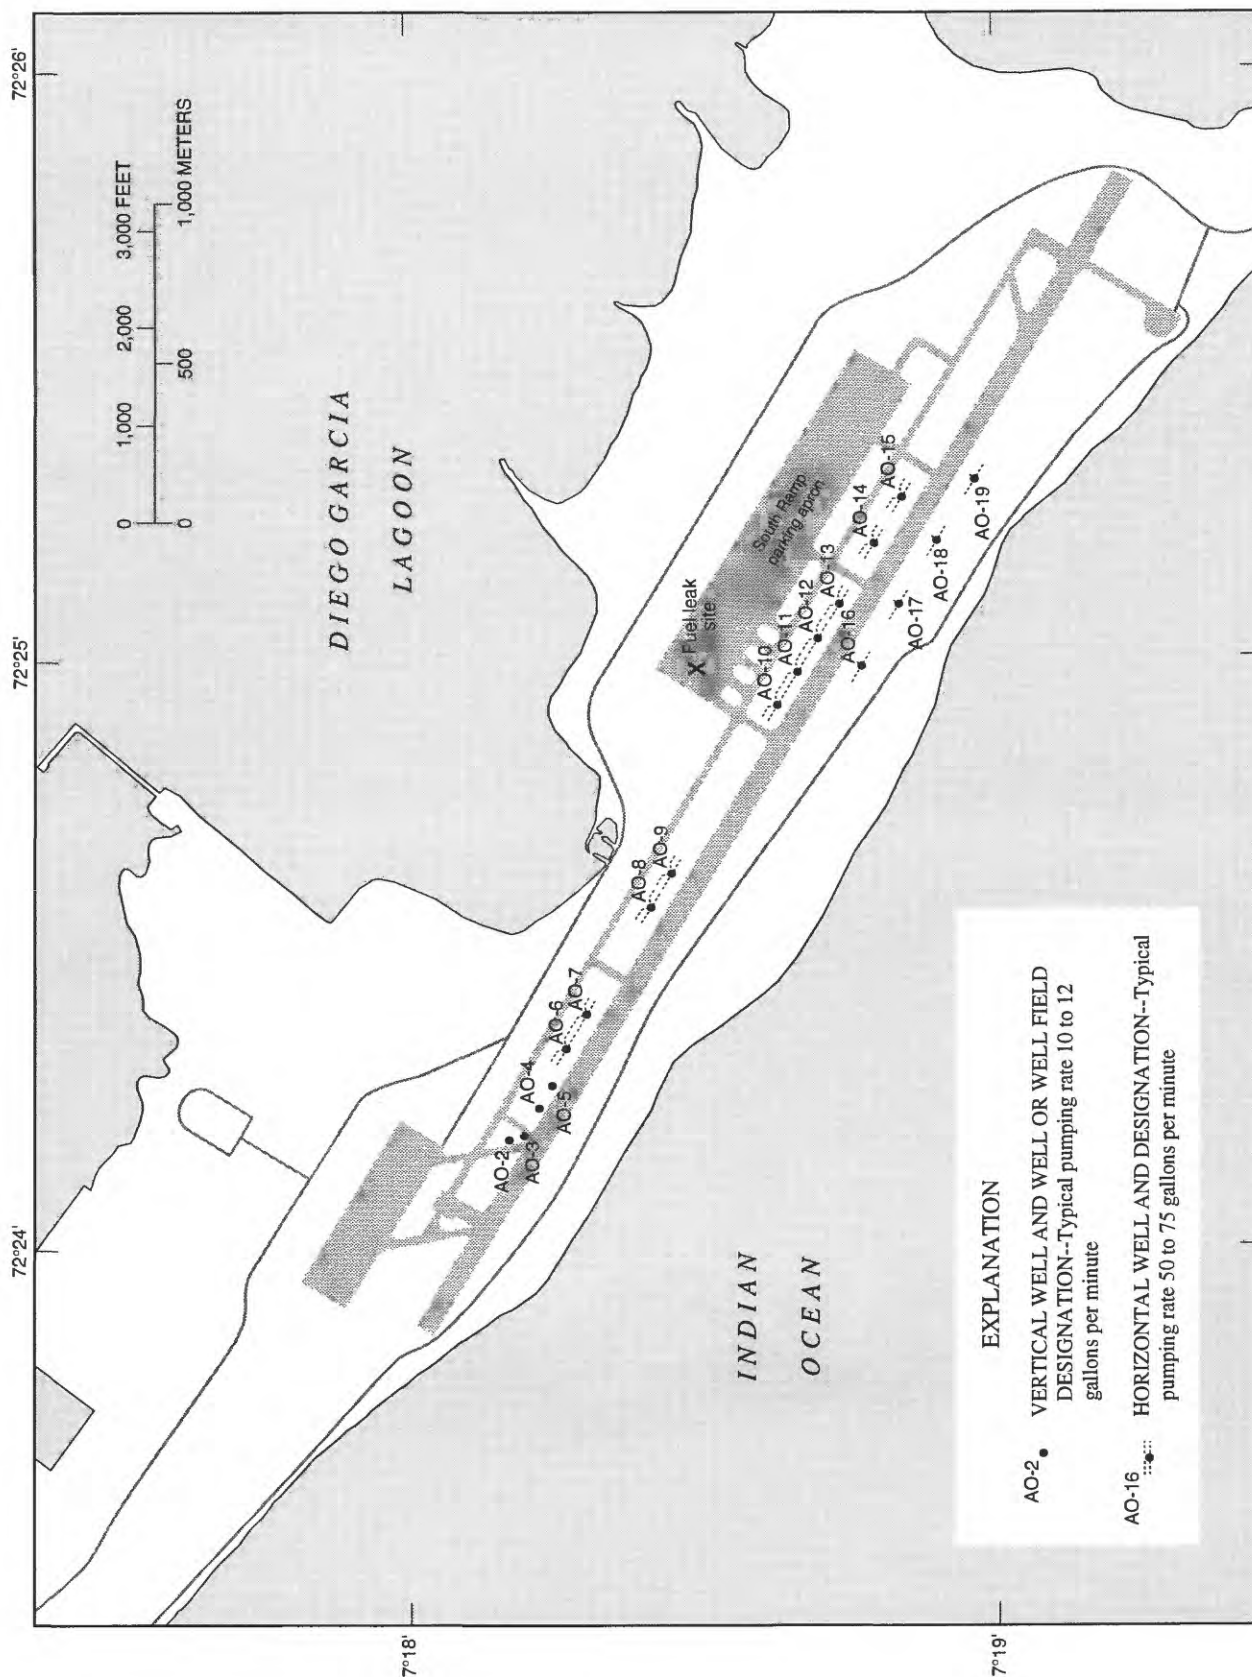


Figure A2. Ground-water production wells at Air Operations, Diego Garcia.

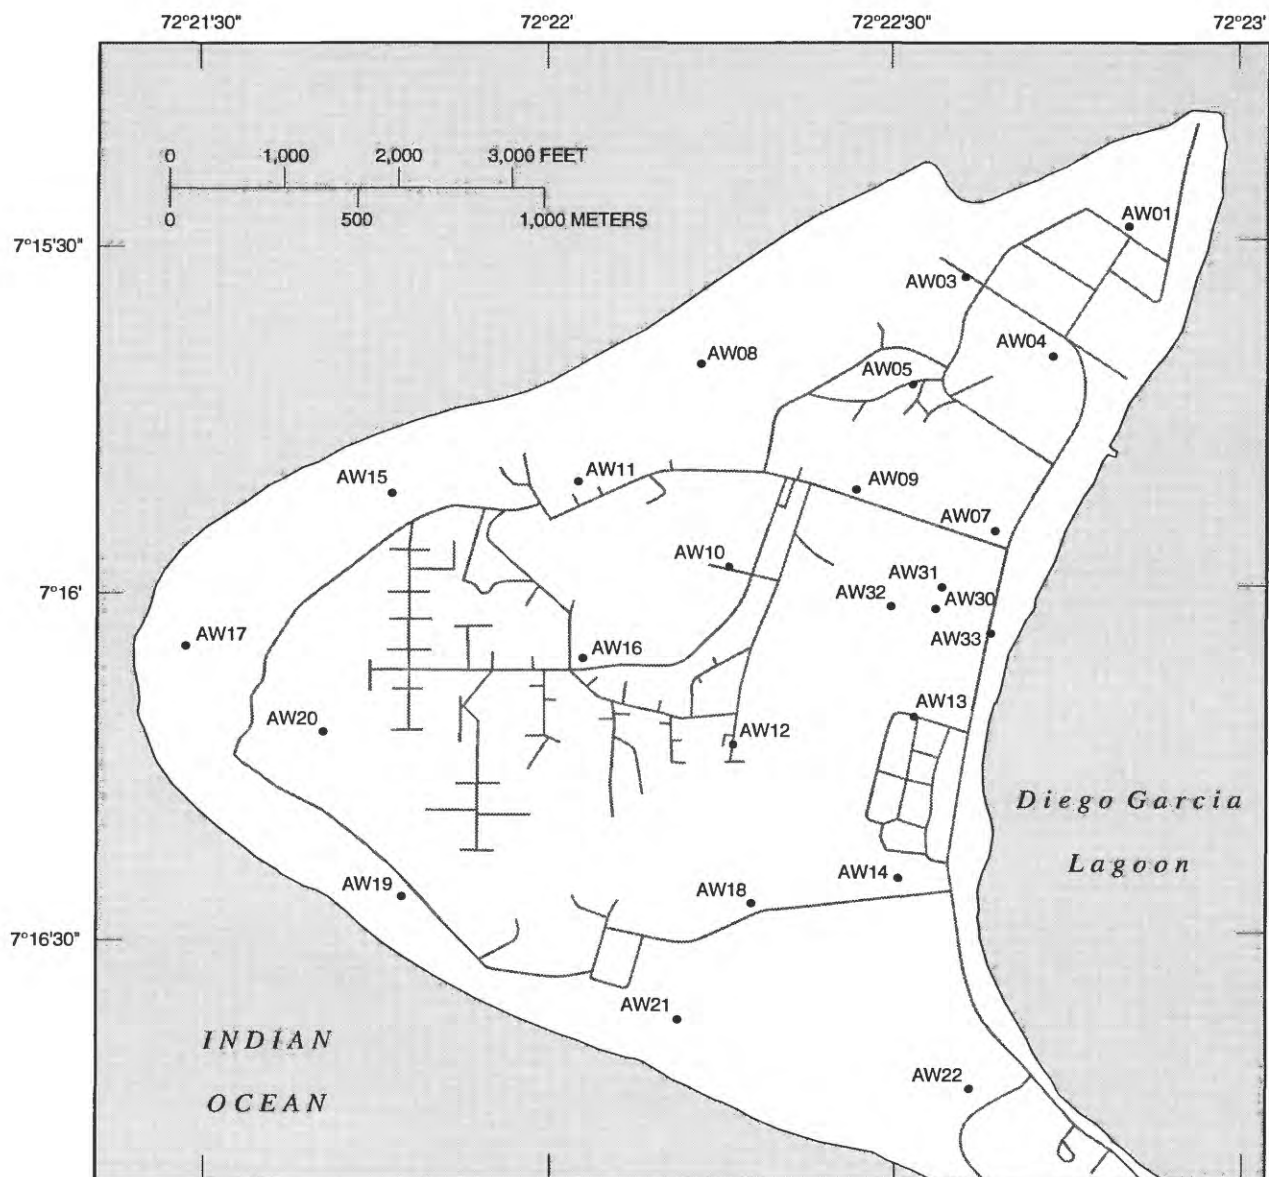

EXPLANATION

- AW21 • MONITORING SITE AND DESIGNATION--Consisting of two or more monitoring wells with short (2- to 5-foot) open intervals of different depths

Figure A3. Monitoring wells at Cantonment, Diego Garcia.

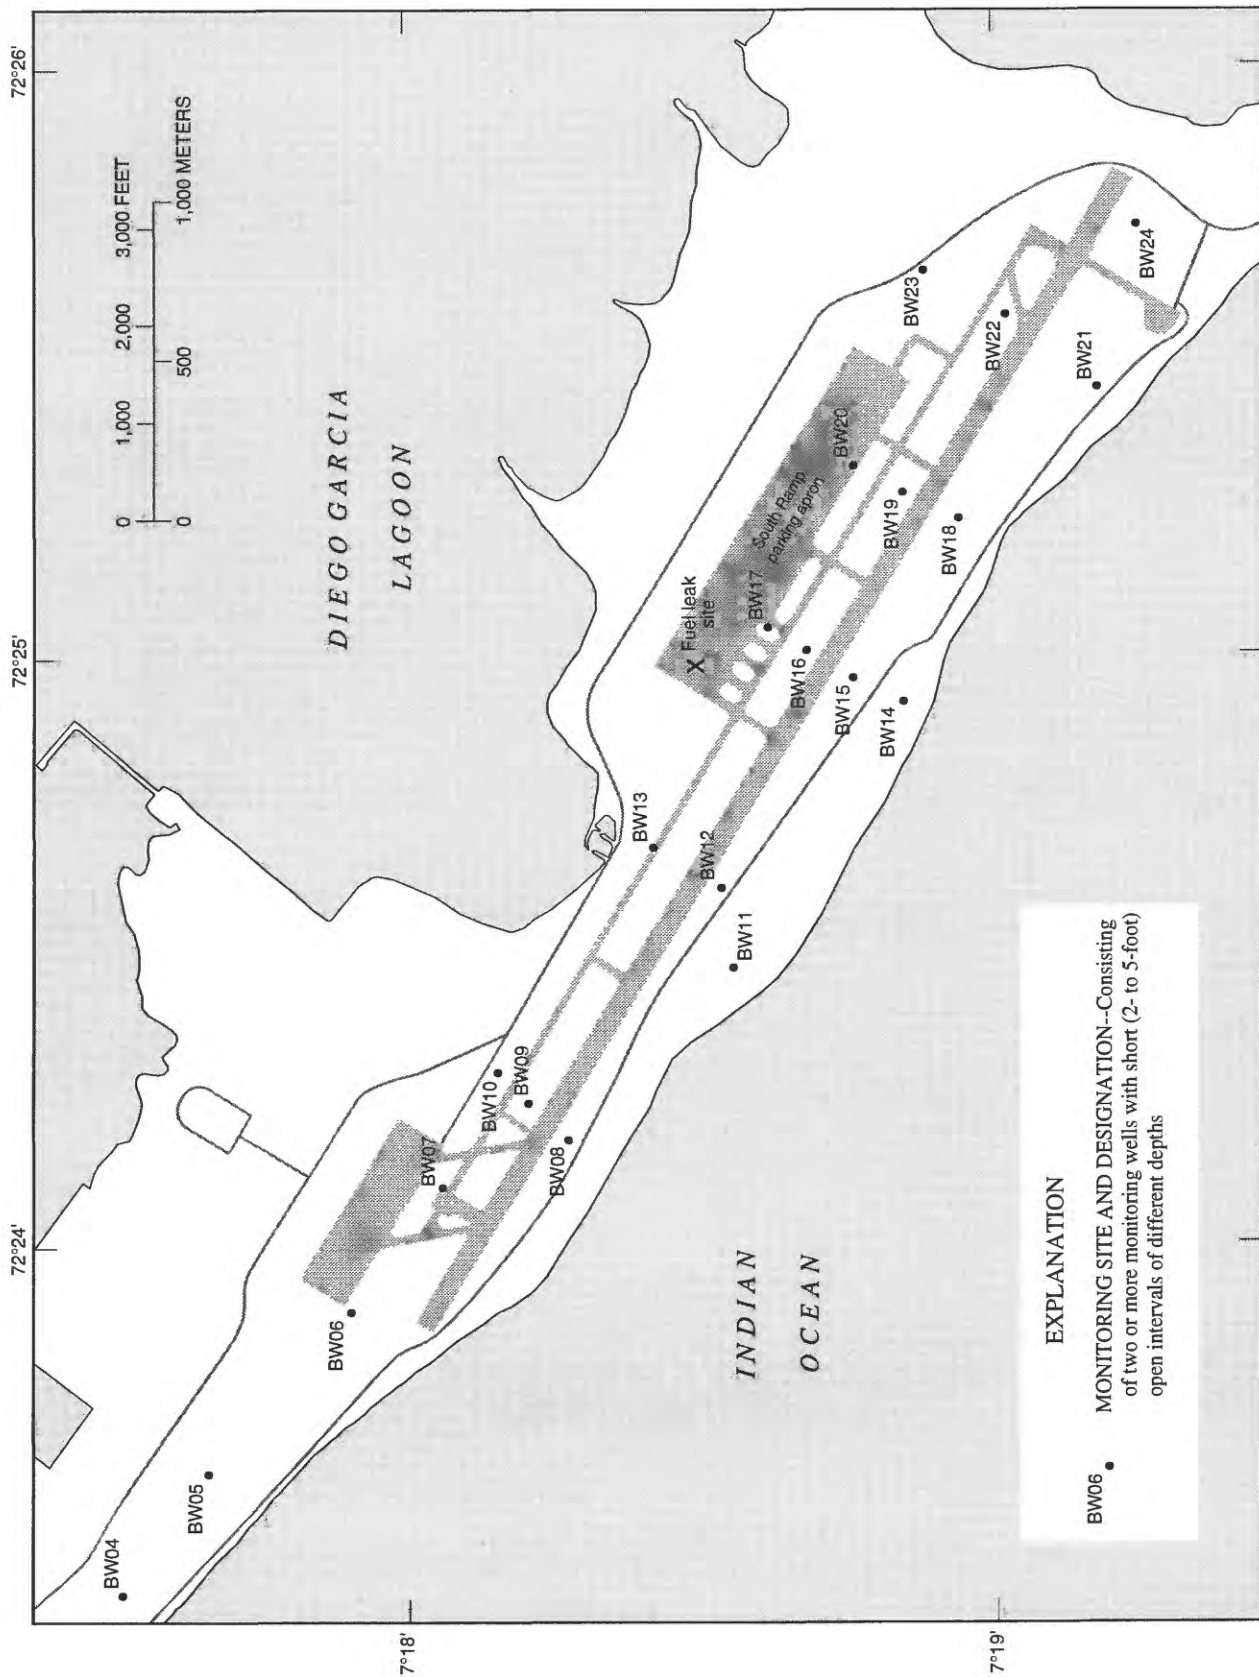


Figure A4. Monitoring wells at Air Operations, Diego Garcia.

SECTION B

**Graphs of monthly mean ground-water withdrawal,
January 1994 through March 1996**

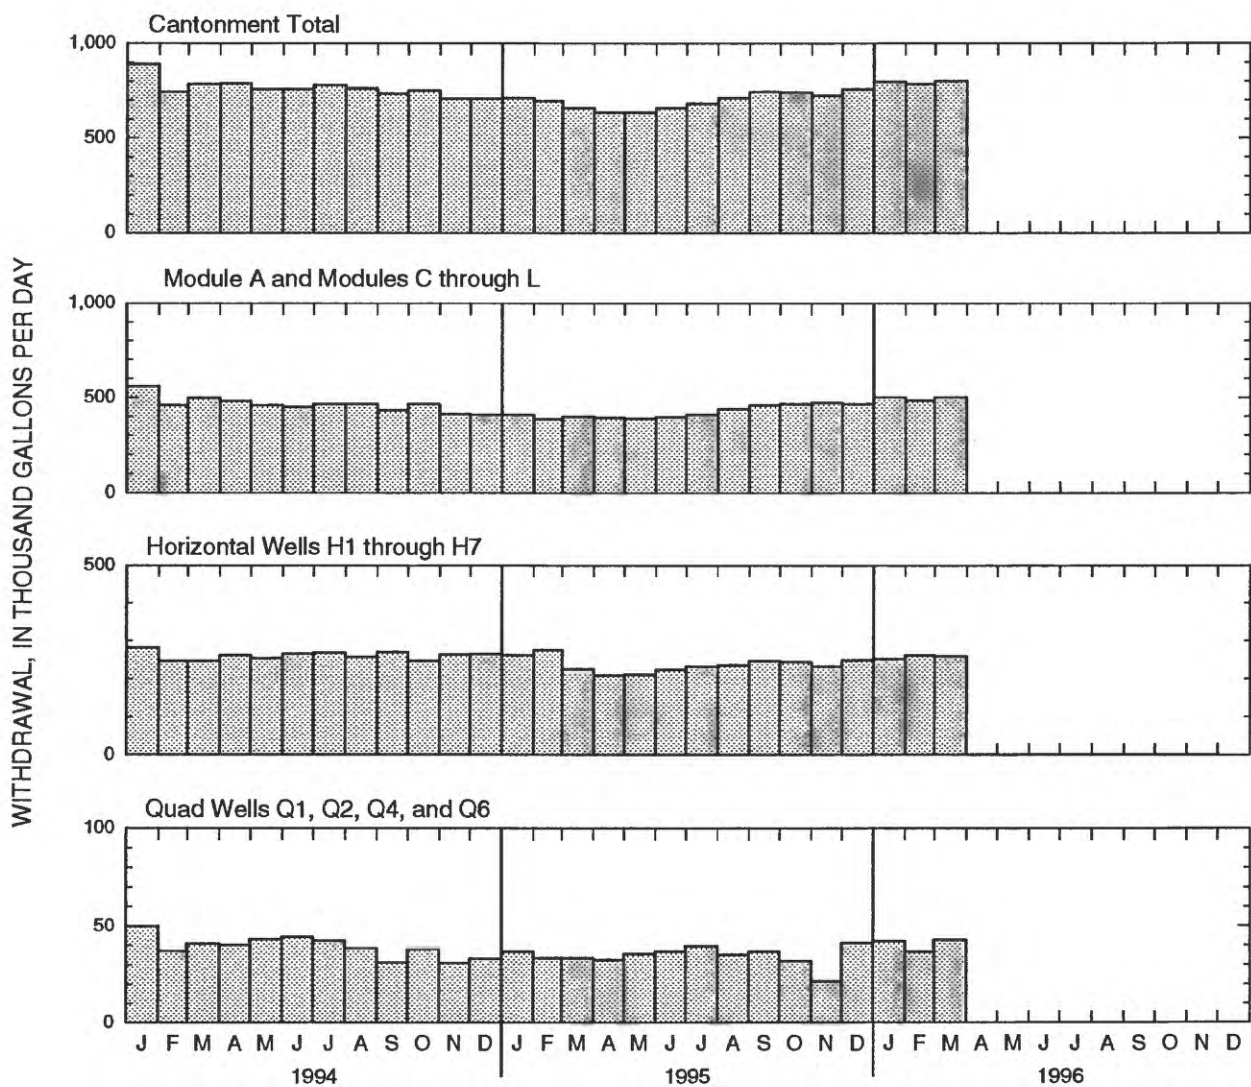


Figure B1. Monthly mean ground-water withdrawal at Cantonment, Diego Garcia, January 1994 through March 1996.

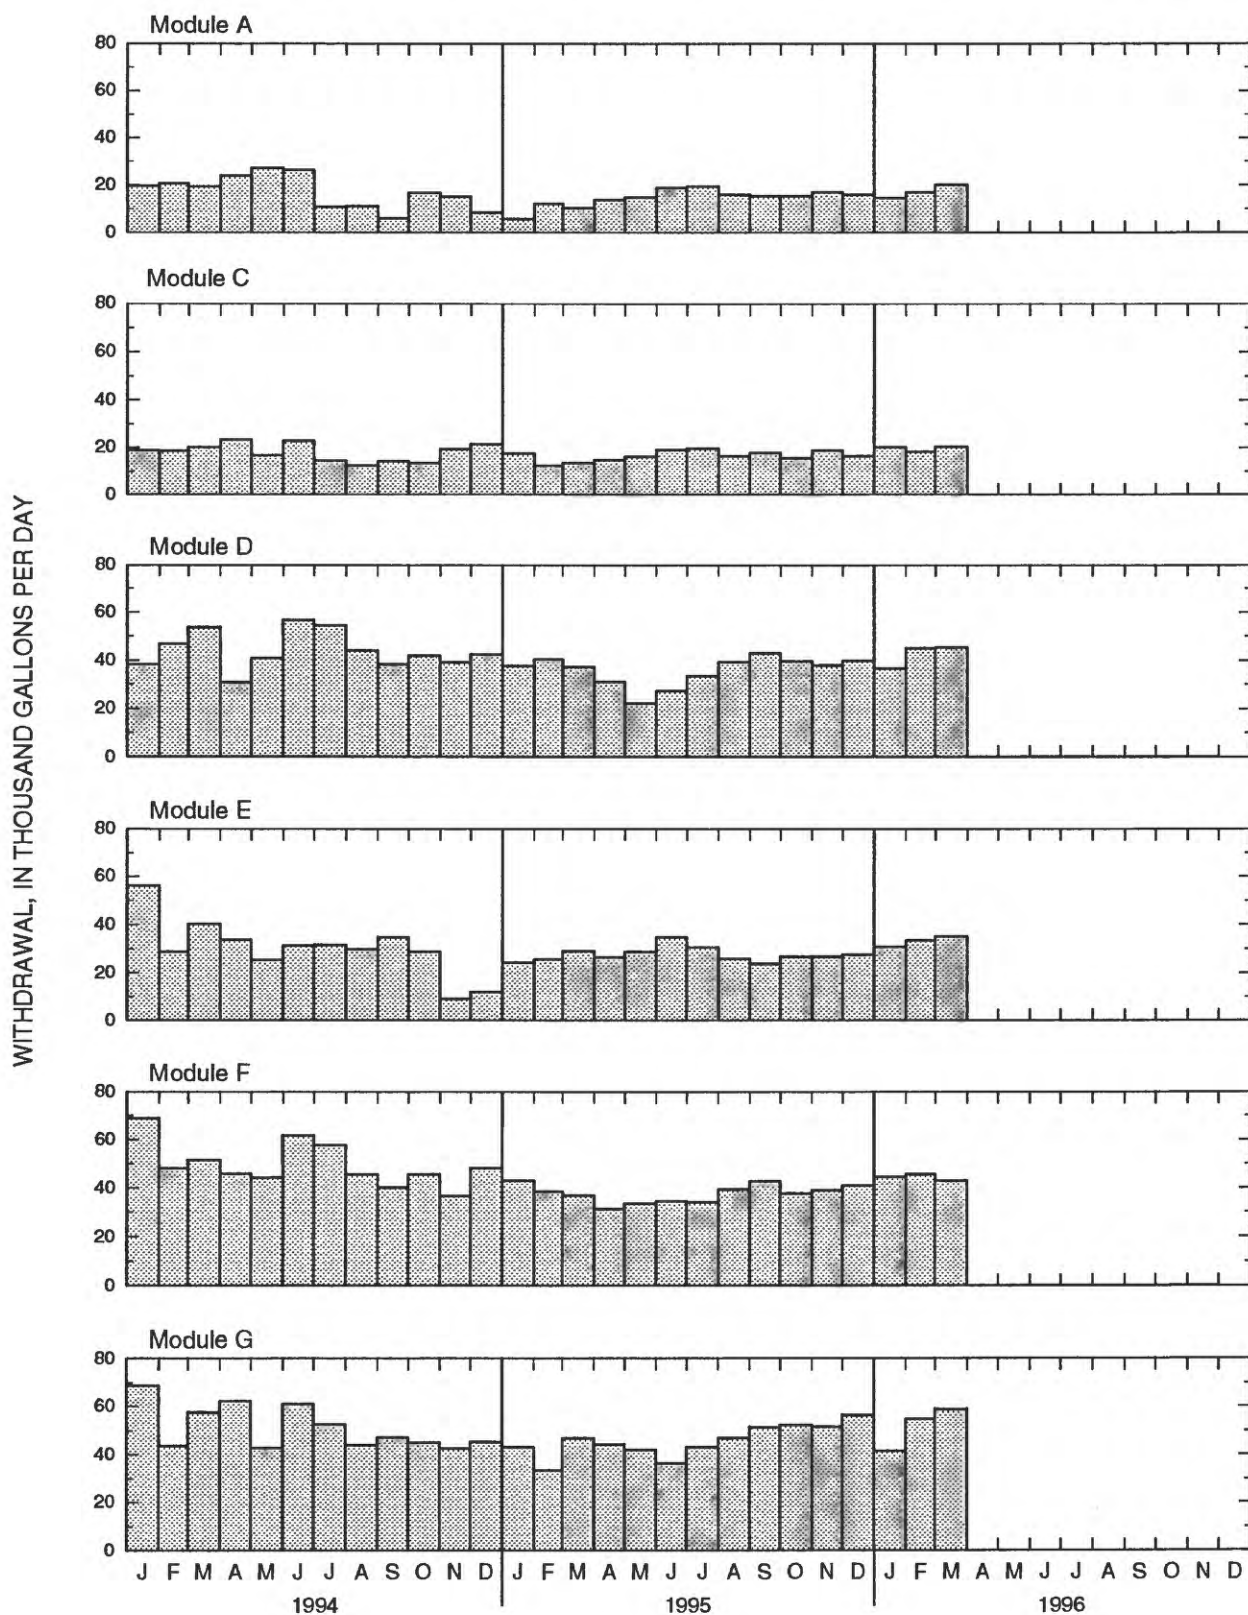


Figure B2. Monthly mean ground-water withdrawal at Module A and Modules C through L at Cantonment, Diego Garcia, January 1994 through March 1996.

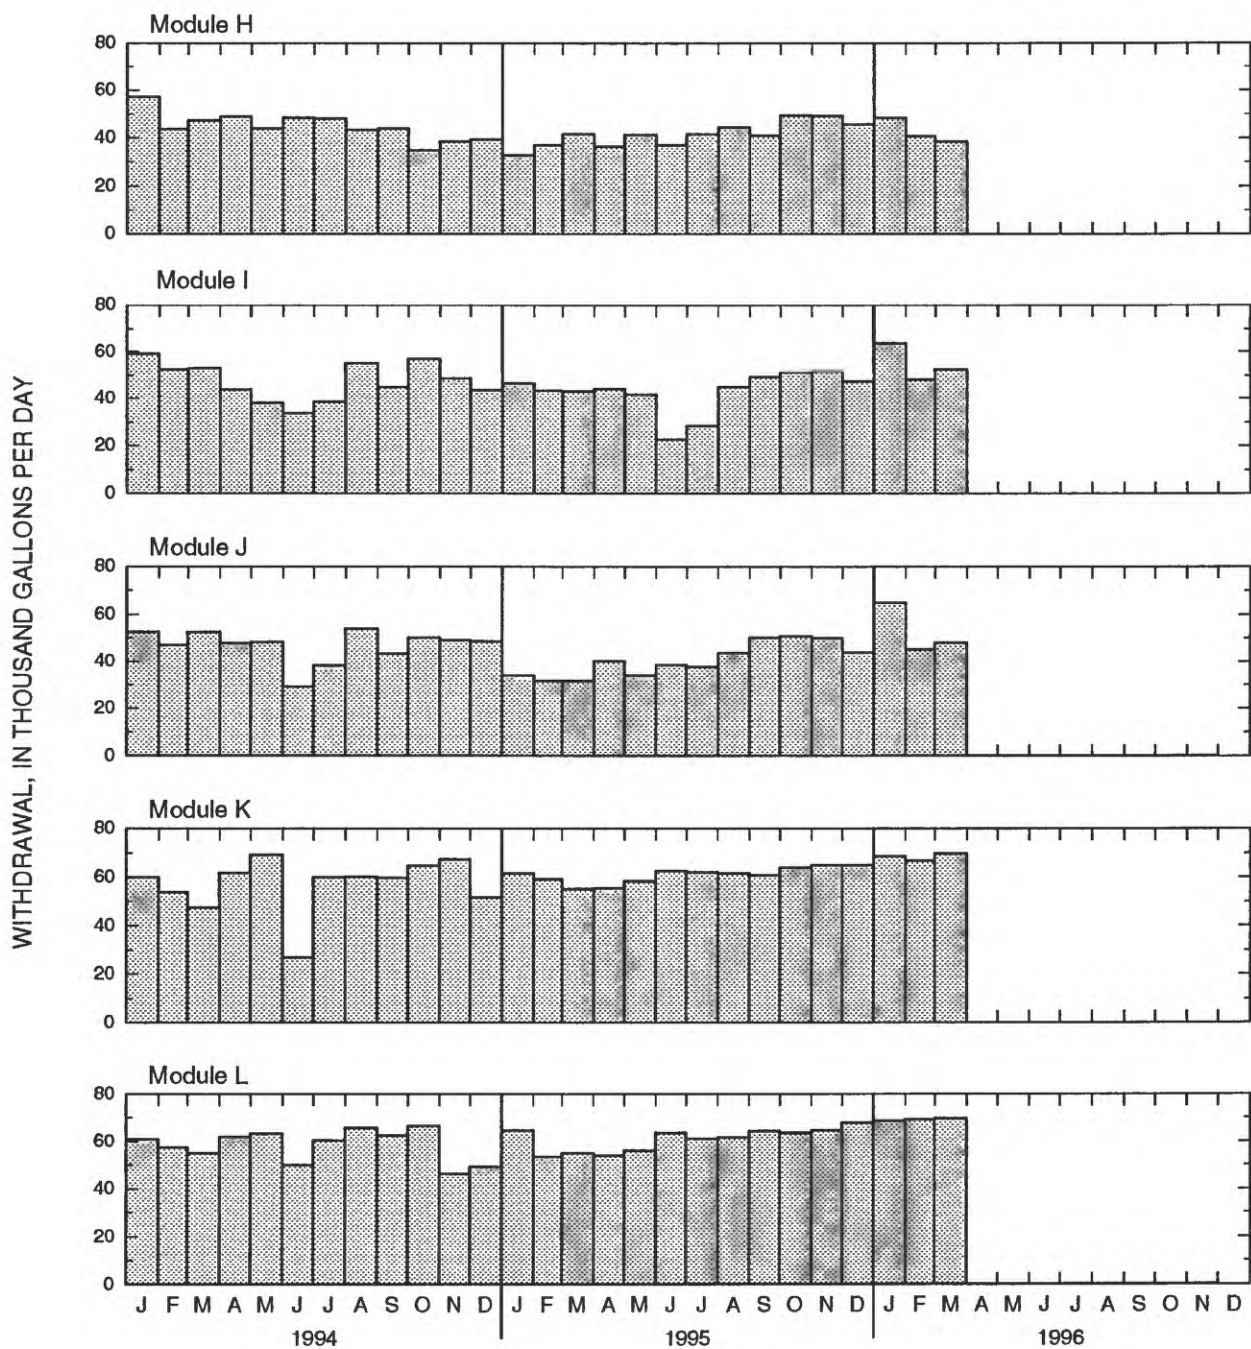


Figure B2. Monthly mean ground-water withdrawal at Module A and Modules C through L at Cantonment, Diego Garcia, January 1994 through March 1996--Continued.

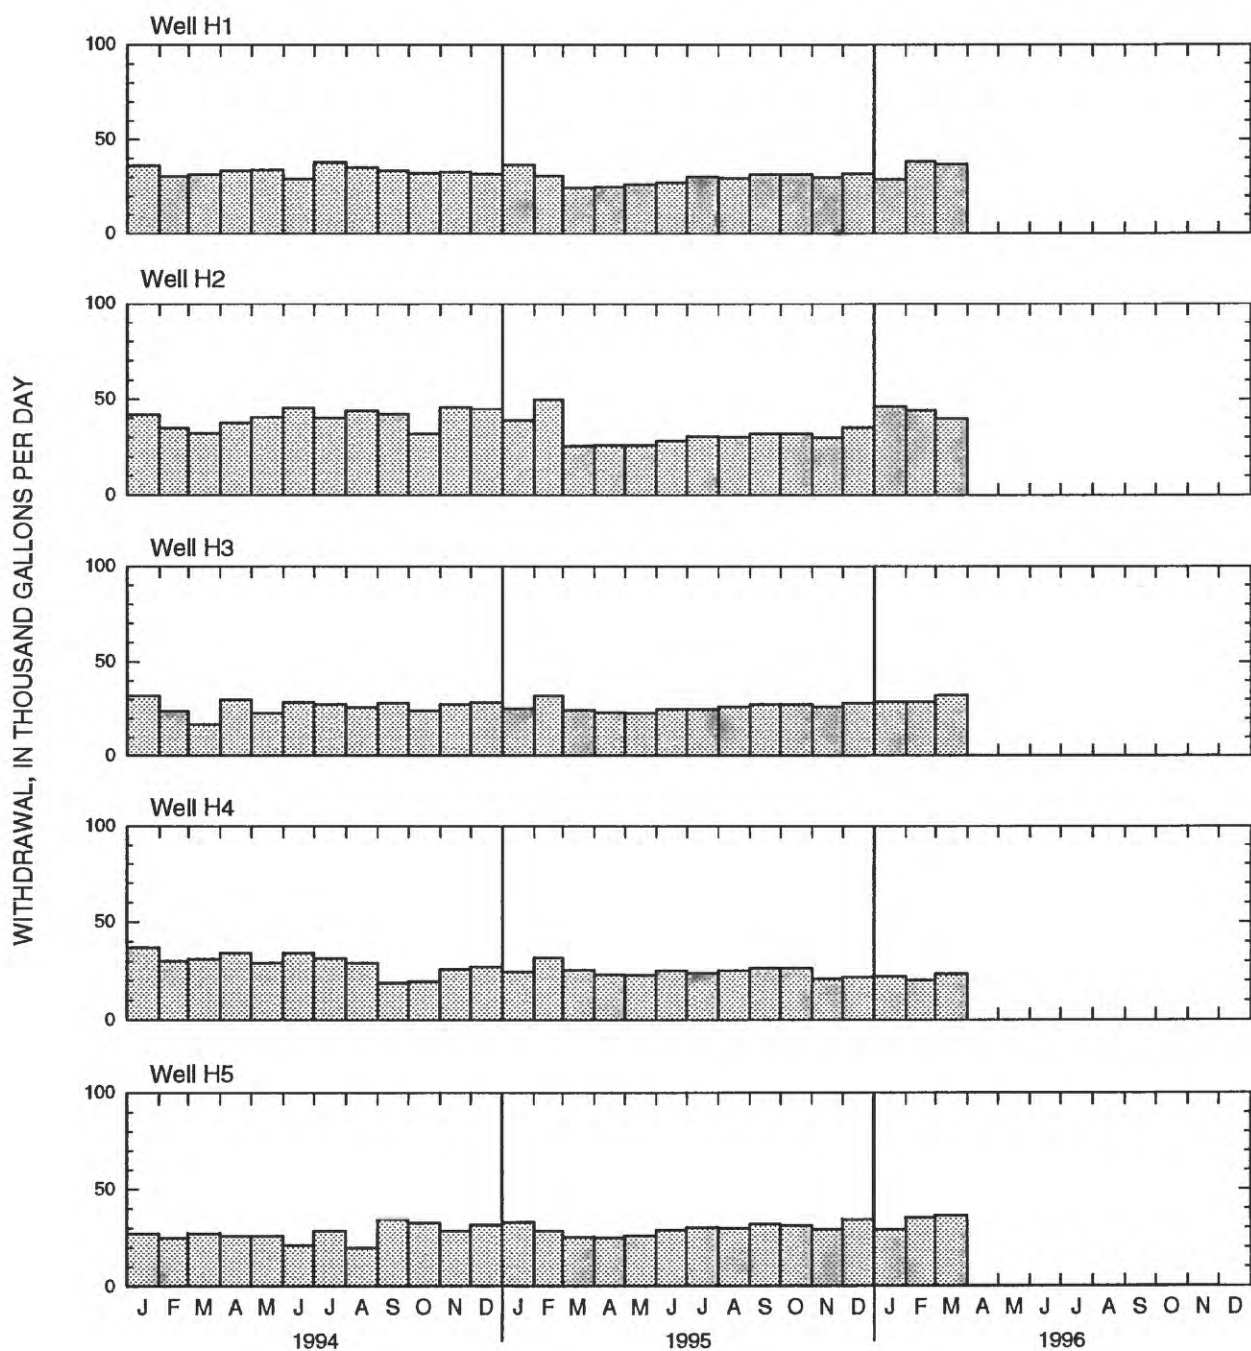


Figure B3. Monthly mean ground-water withdrawal at Horizontal wells H1 through H7 at Cantonment, Diego Garcia, January 1994 through March 1996.

WITHDRAWAL, IN THOUSAND GALLONS PER DAY

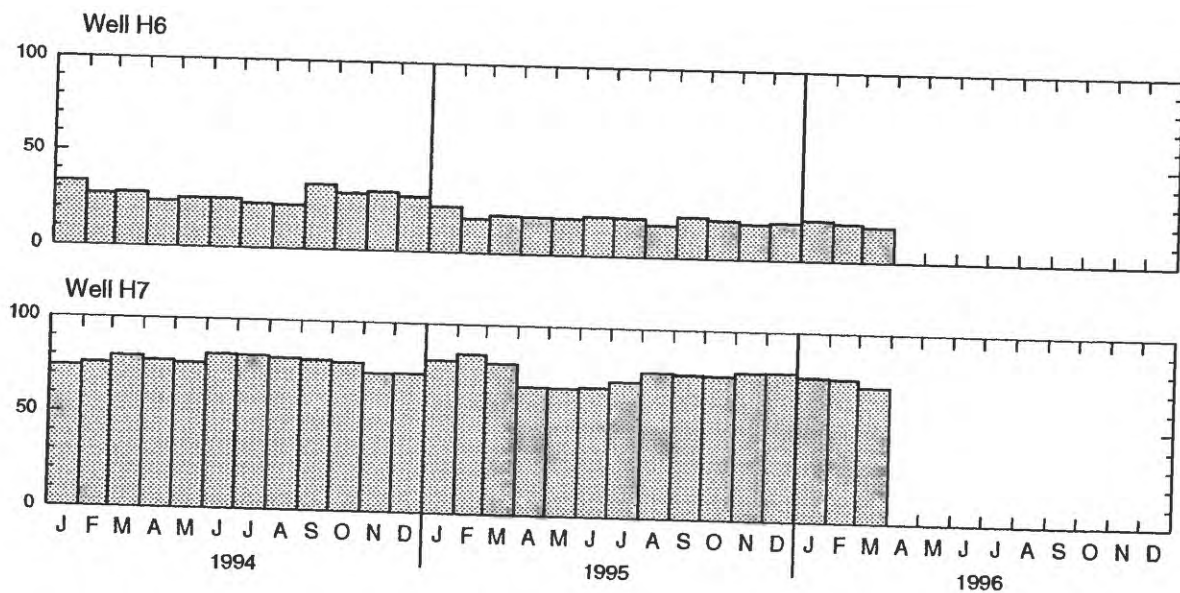


Figure B3. Monthly mean ground-water withdrawal at Horizontal wells H1 through H7 at Cantonment, Diego Garcia, January 1994 through March 1996--Continued.

WITHDRAWAL, IN THOUSAND GALLONS PER DAY

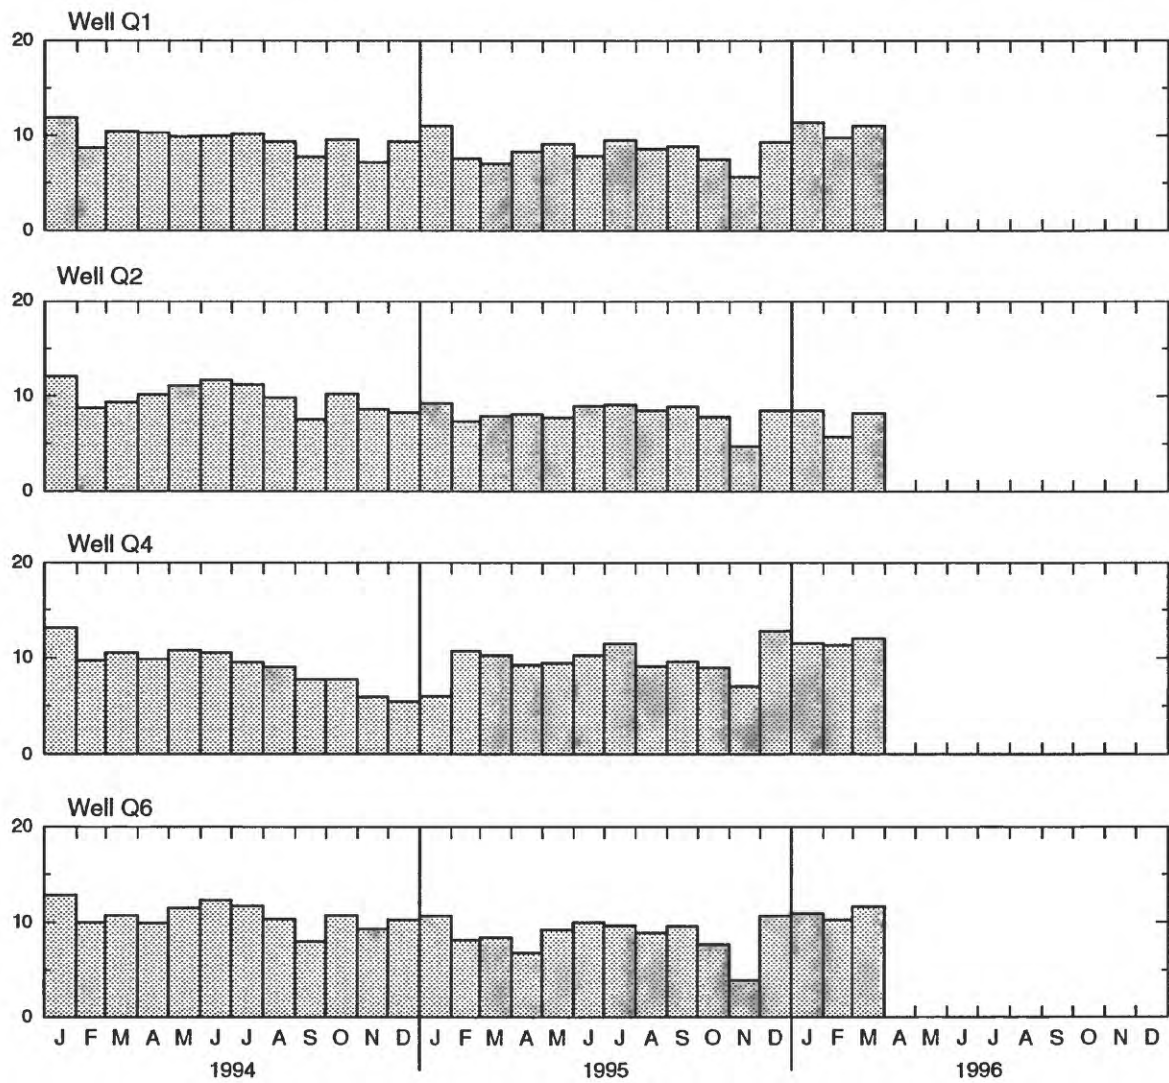


Figure B4. Monthly mean ground-water withdrawal at Quad wells Q1, Q2, Q4, and Q6 at Cantonment, Diego Garcia, January 1994 through March 1996.

WITHDRAWAL AND INJECTION, IN THOUSAND GALLONS PER DAY

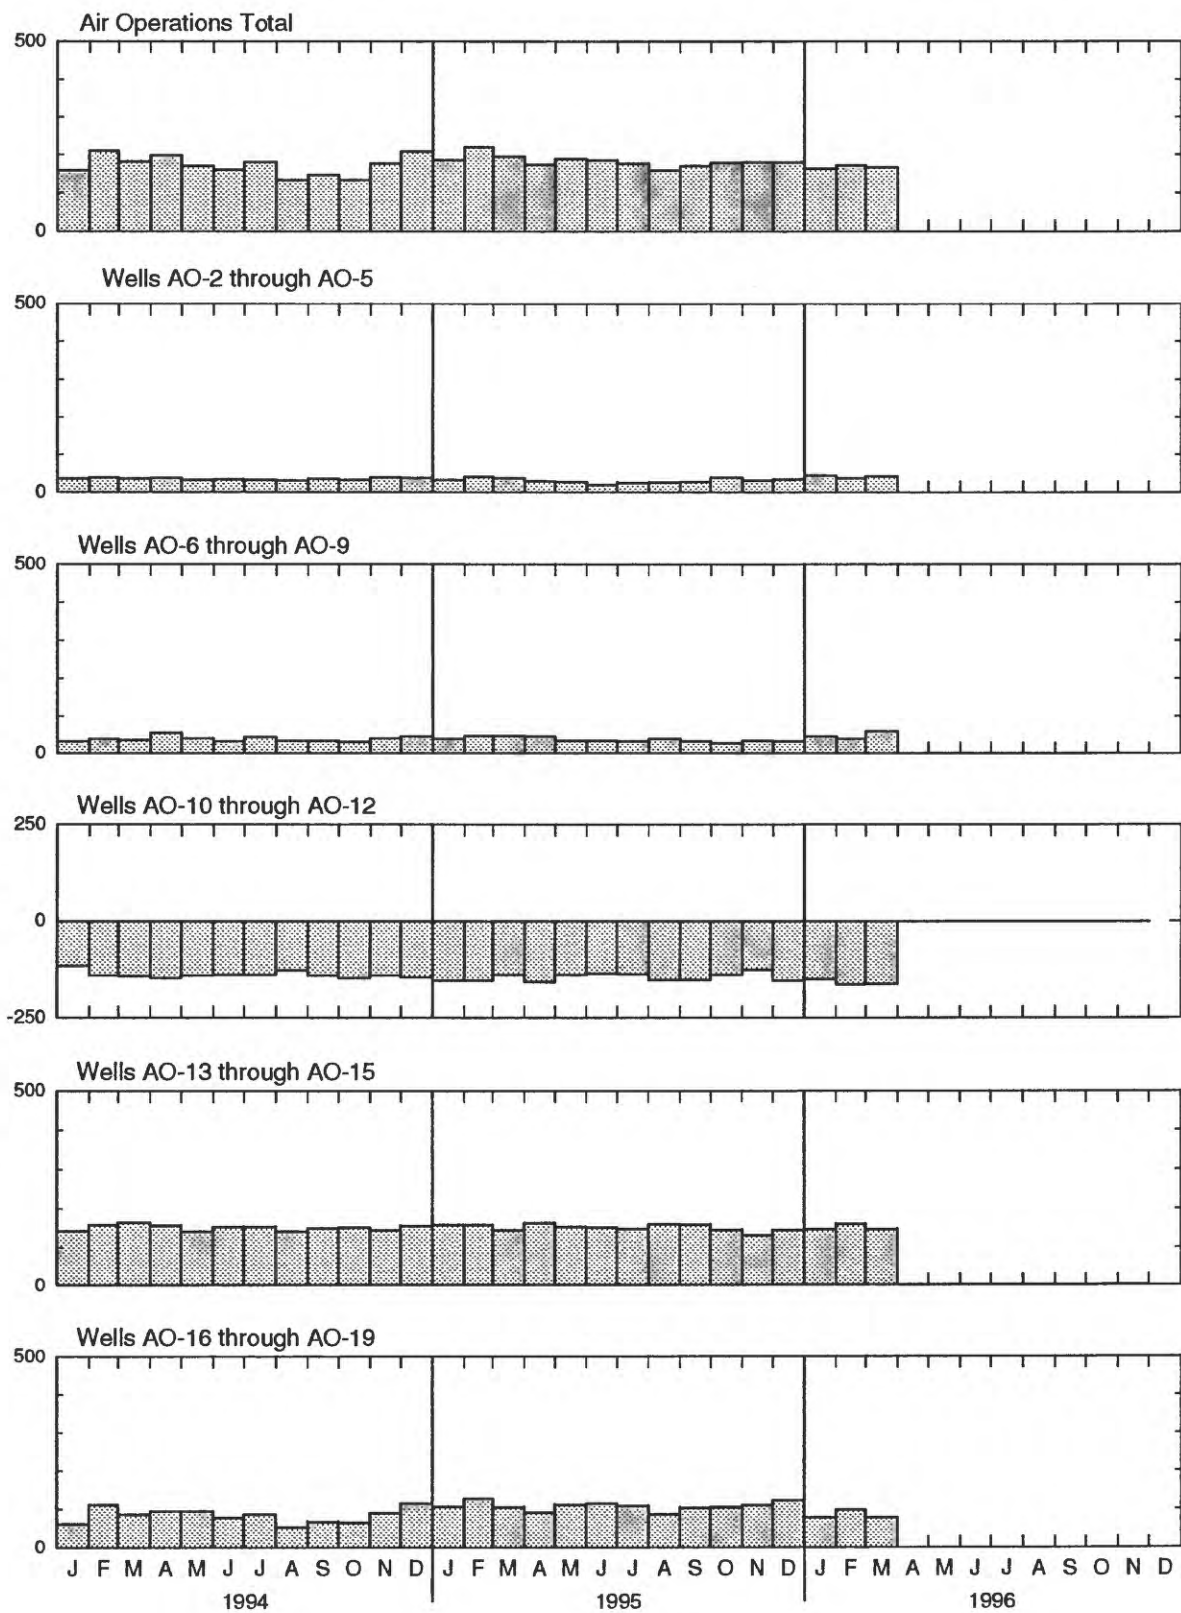


Figure B5. Monthly mean ground-water withdrawal and injection at Air Operations, Diego Garcia, January 1994 through March 1996. Injection is plotted as negative.

WITHDRAWAL AND INJECTION, IN THOUSAND GALLONS PER DAY

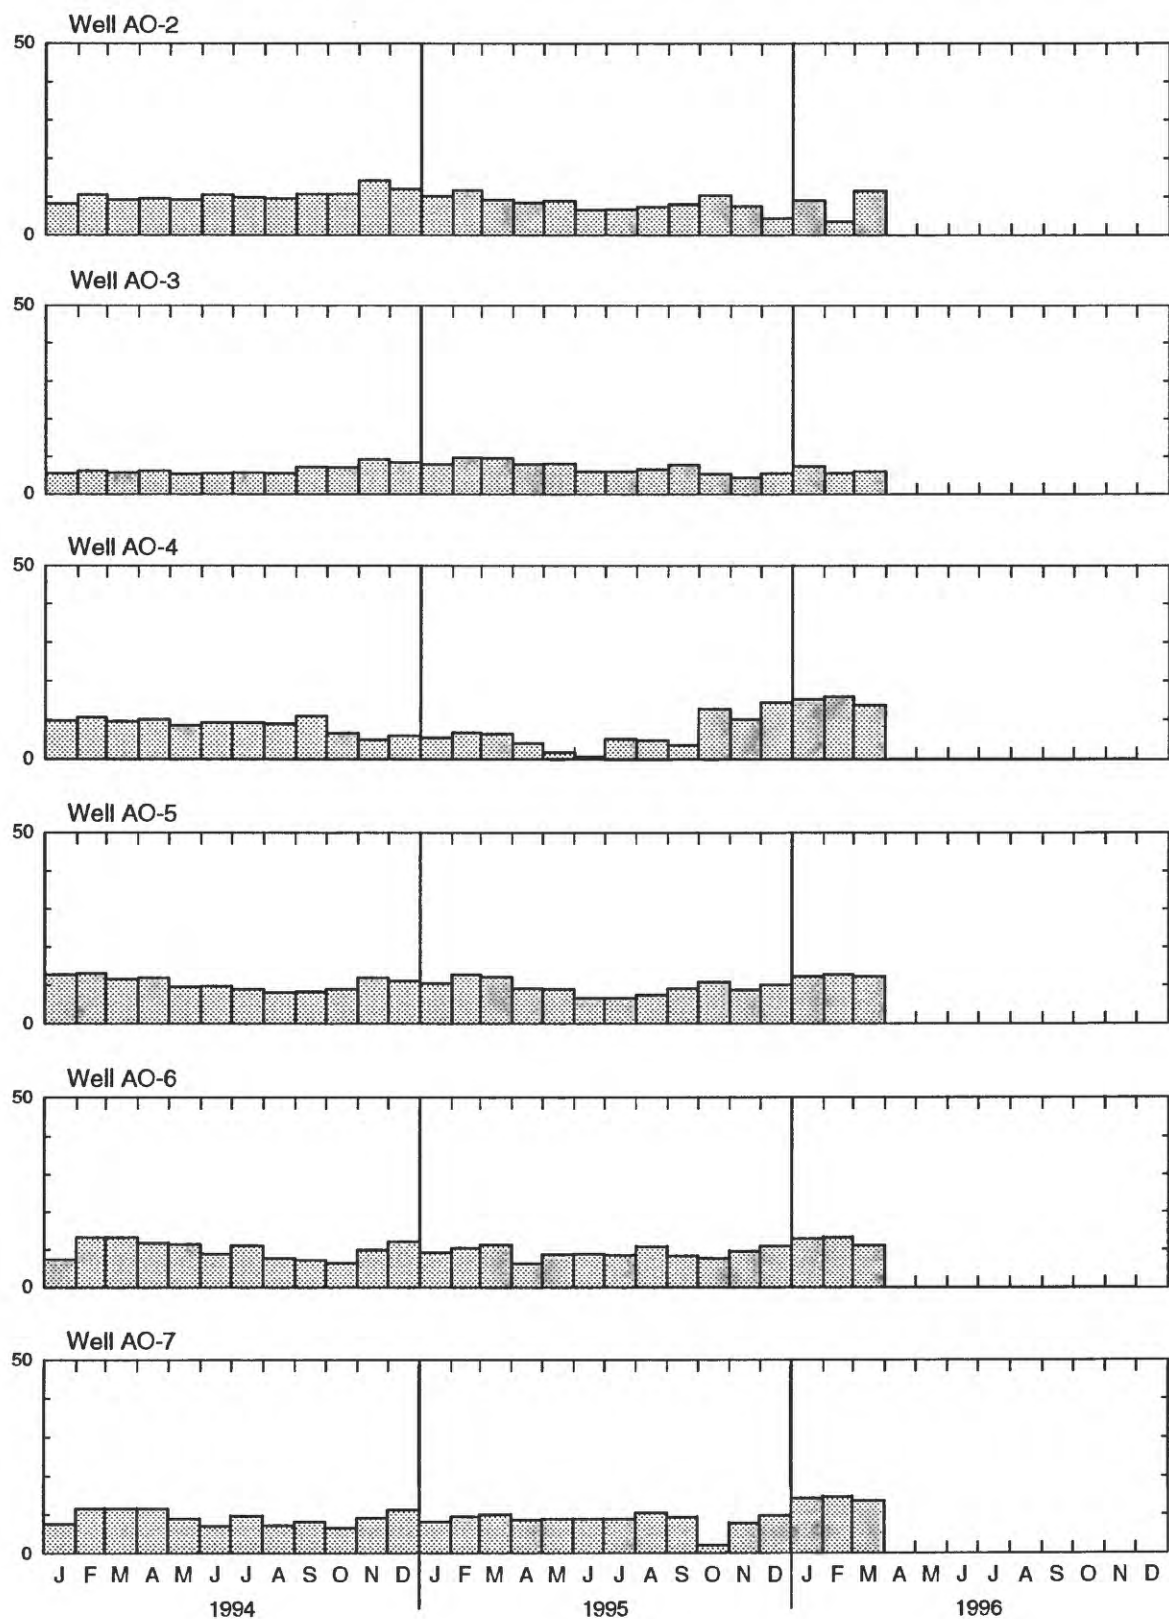


Figure B6. Monthly mean ground-water withdrawal and injection at wells AO-2 through AO-19 at Air Operations, Diego Garcia, January 1994 through March 1996. Injection is plotted as negative.

WITHDRAWAL AND INJECTION, IN THOUSAND GALLONS PER DAY

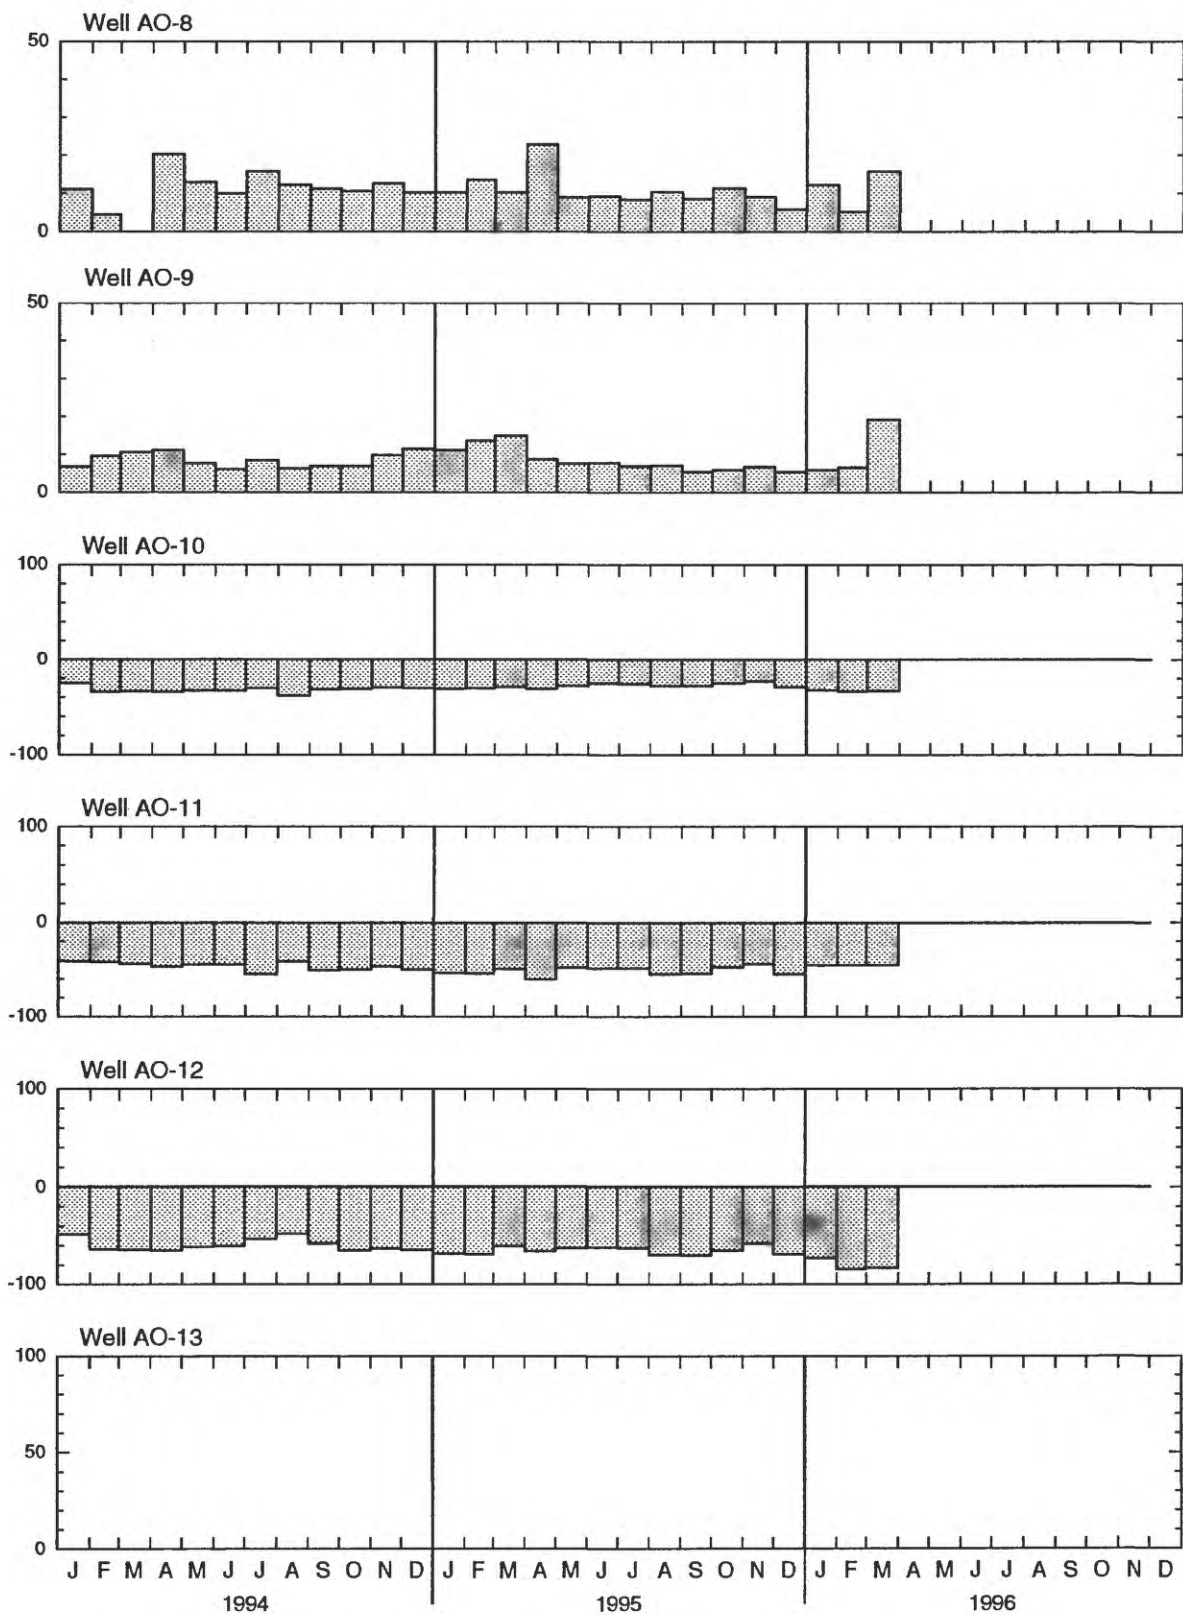


Figure B6. Monthly mean ground-water withdrawal and injection at wells AO-2 through AO-19 at Air Operations, Diego Garcia, January 1994 through March 1996. Injection is plotted as negative-- Continued.

SECTION C

**Graphs of chloride concentration of pumped water,
January 1994 through March 1996**

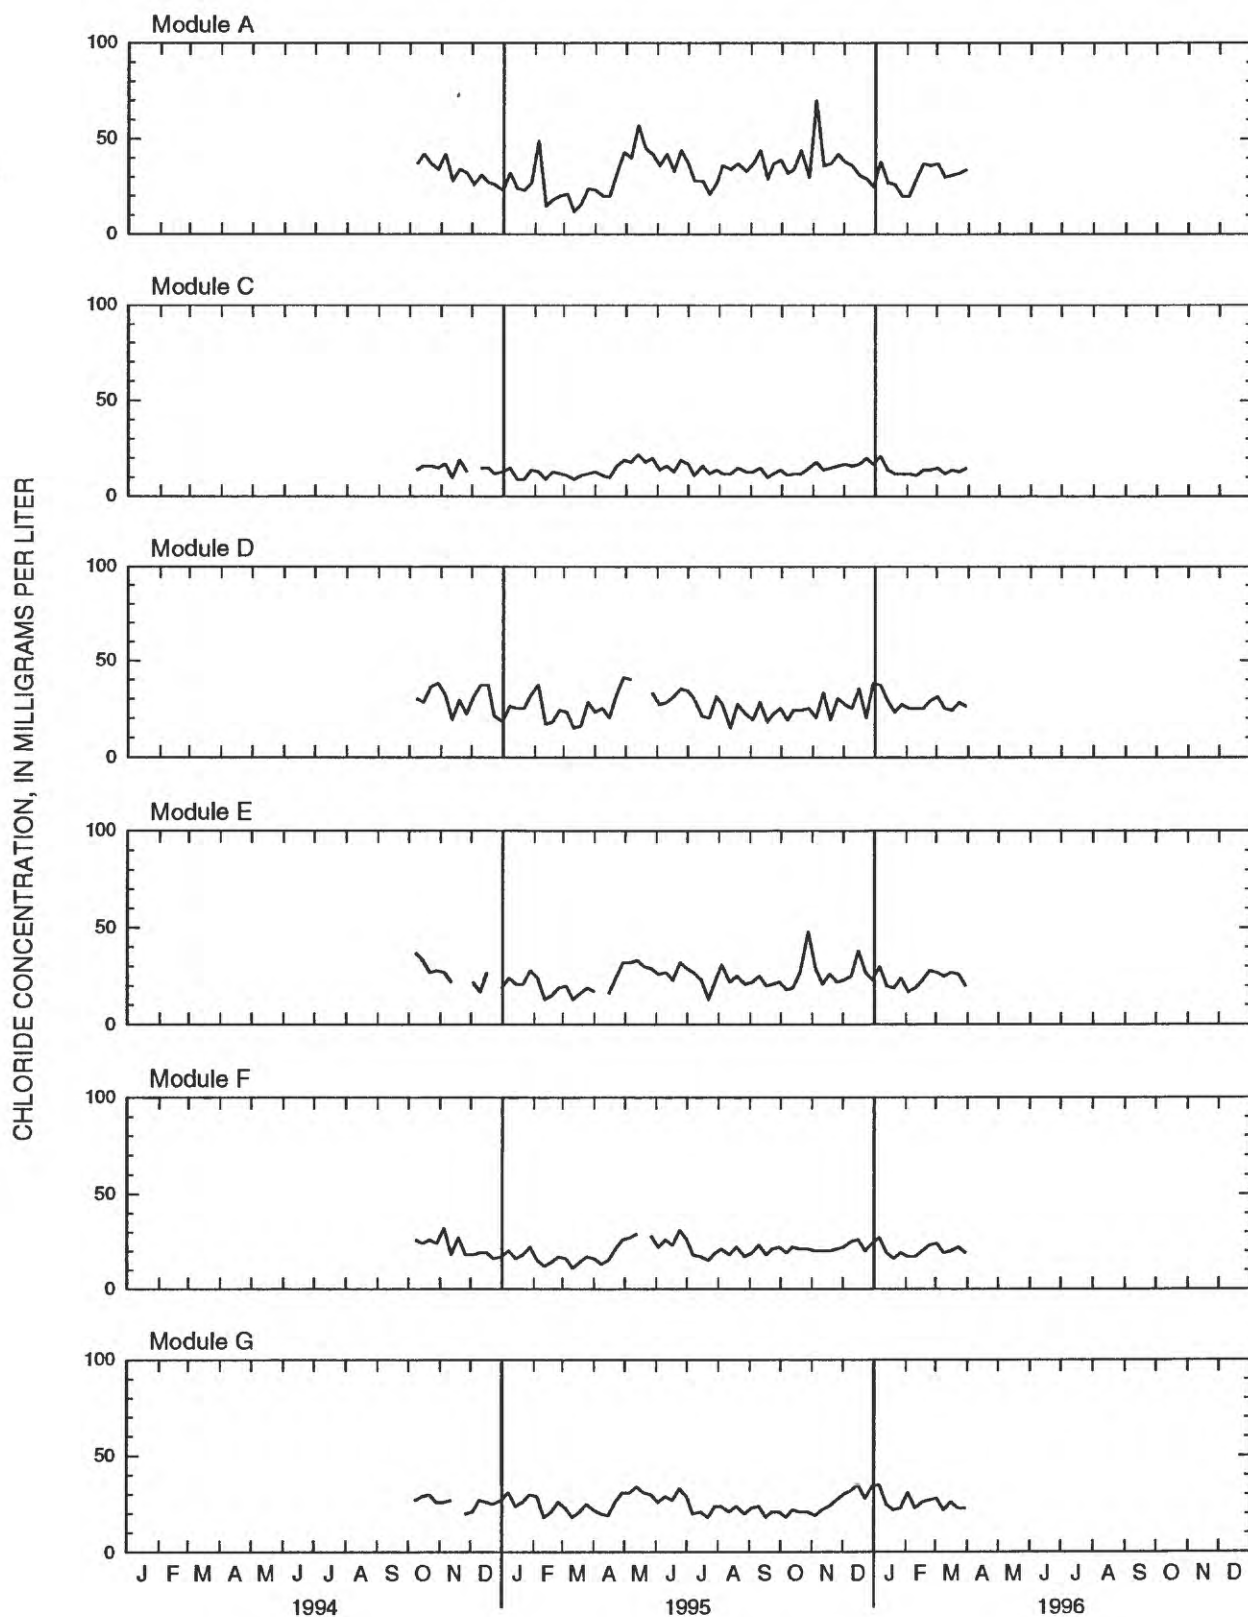


Figure C1. Chloride concentration of pumped water (sampled at weekly intervals) at Module A and Modules C through L at Cantonment, Diego Garcia, January 1994 through March 1996. Data not available for November 1993 through September 1994.

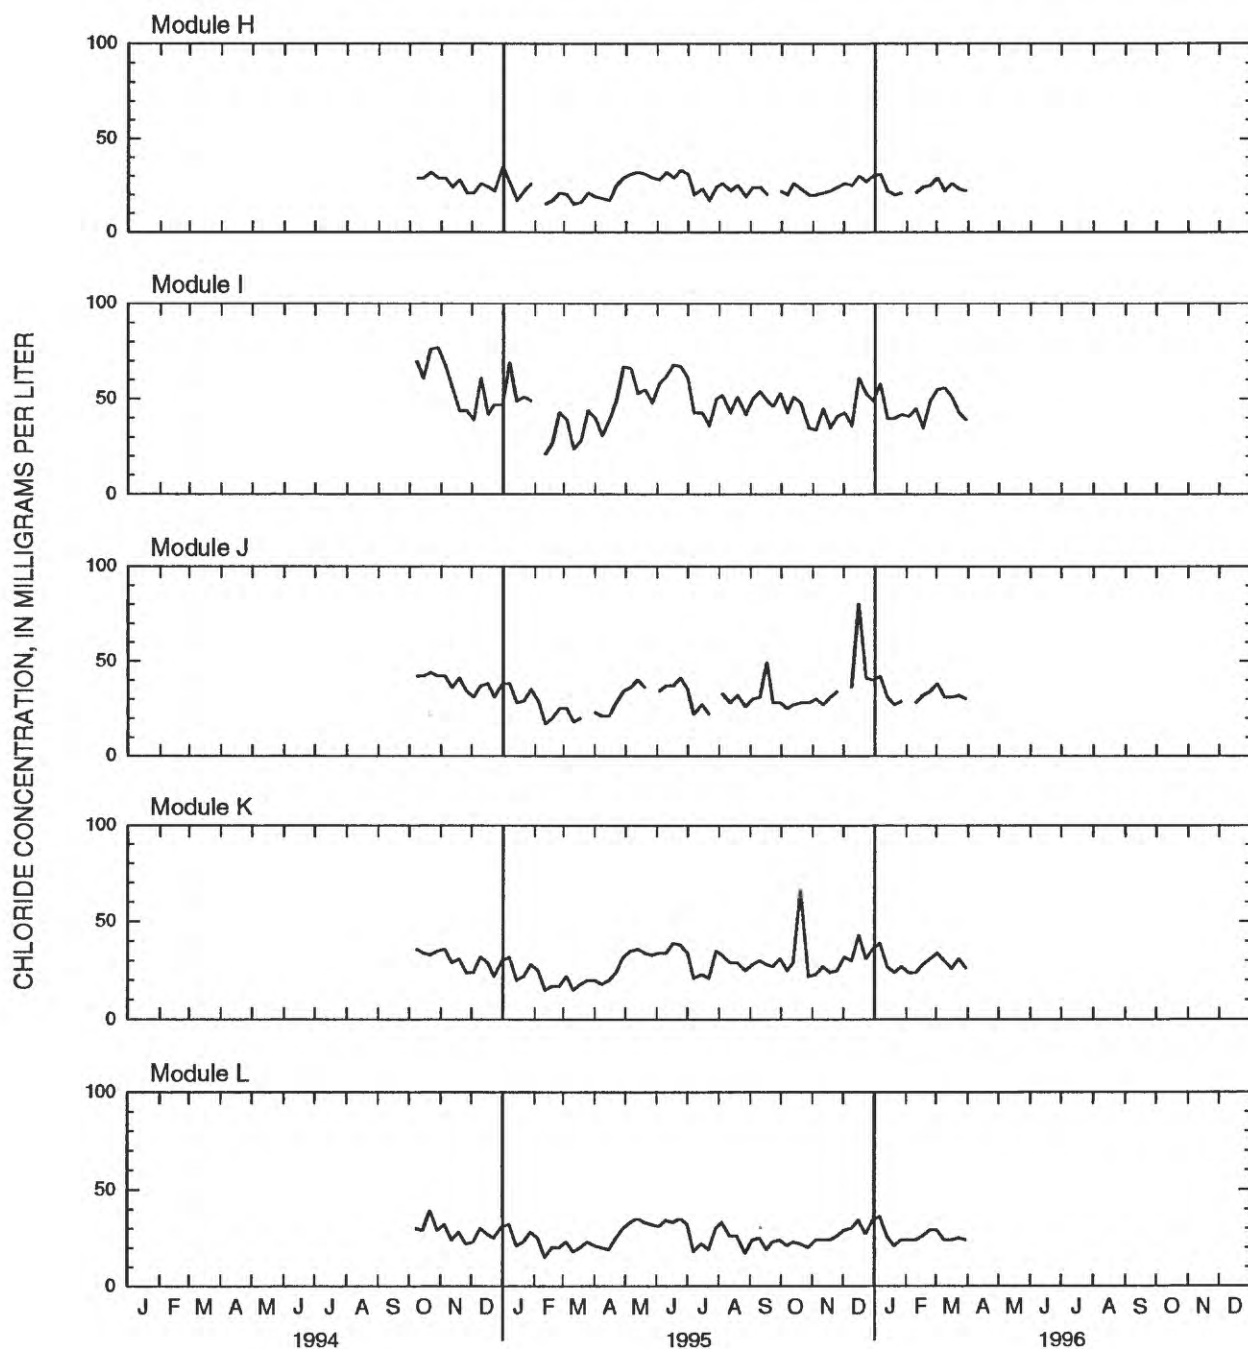


Figure C1. Chloride concentration of pumped water (sampled at weekly intervals) at Module A and Modules C through L at Cantonment, Diego Garcia, January 1994 through March 1996. Data not available for November 1993 through September 1994--Continued.

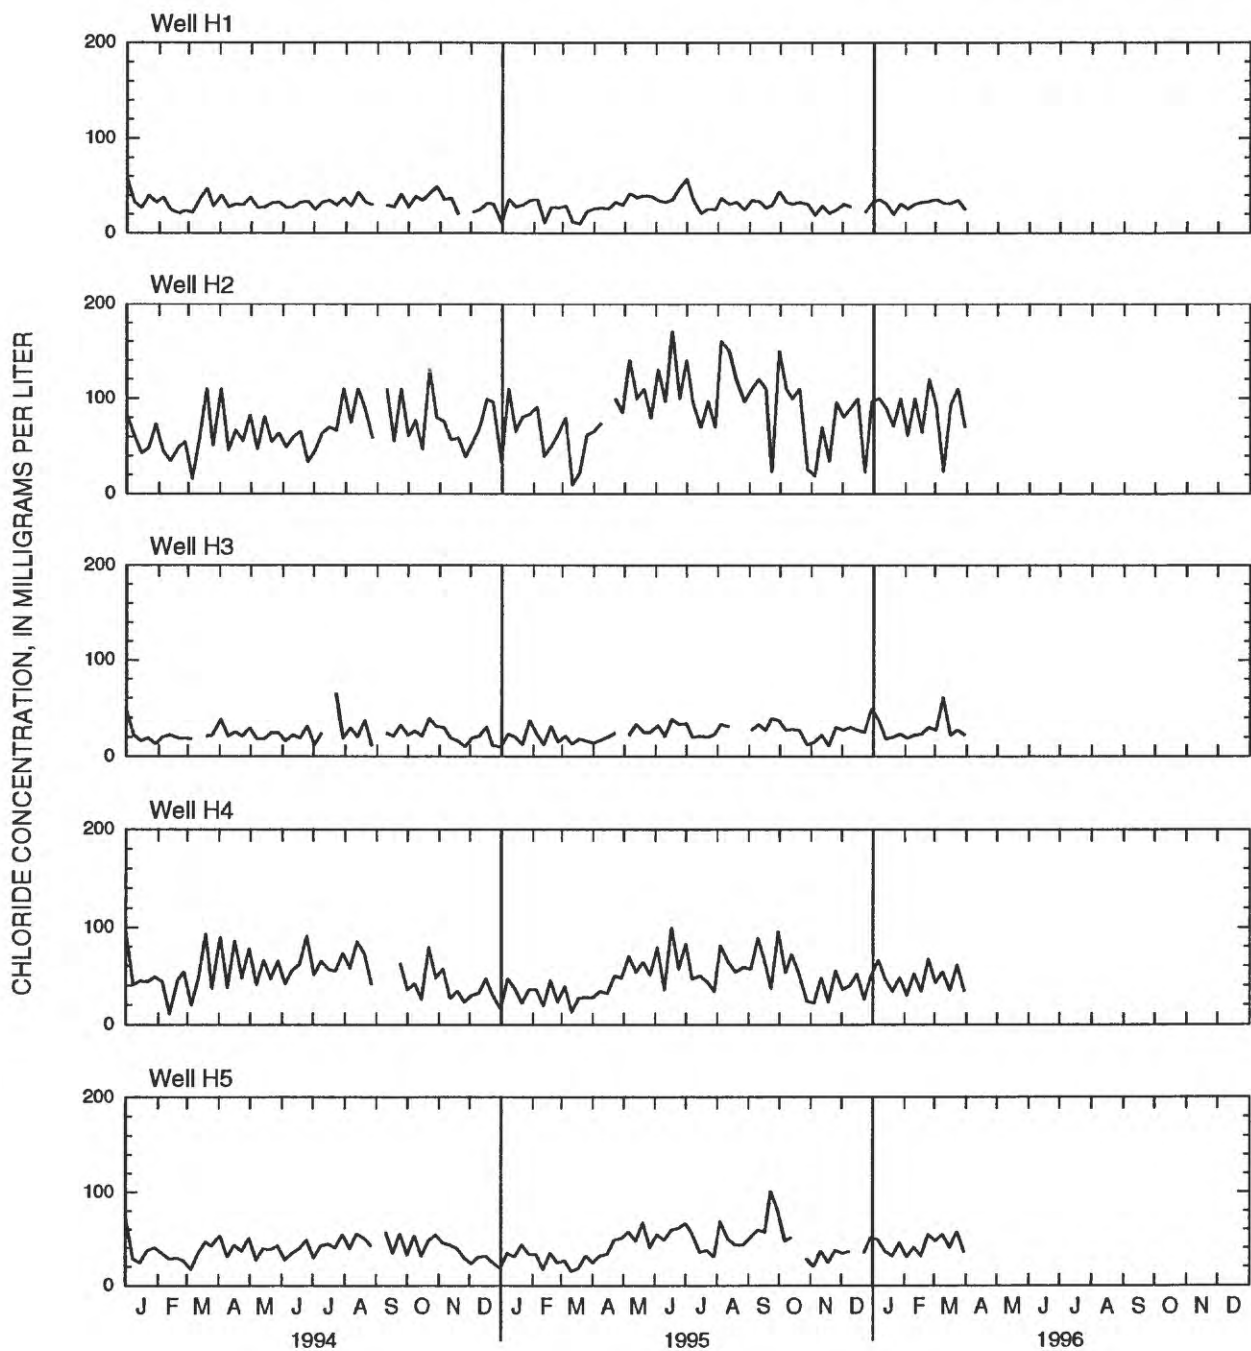


Figure C2. Chloride concentration of pumped water (sampled at weekly intervals) at Horizontal wells H1 through H7 at Cantonment, Diego Garcia, January 1994 through March 1996.

CHLORIDE CONCENTRATION, IN MILLIGRAMS PER LITER

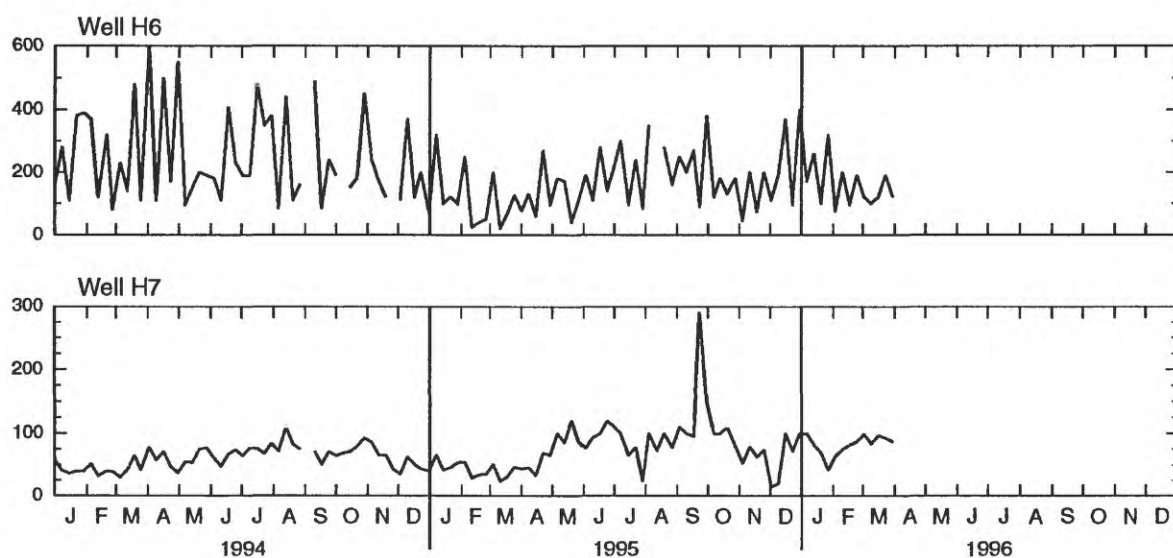


Figure C2. Chloride concentration of pumped water (sampled at weekly intervals) at Horizontal wells H1 through H7 at Cantonment, Diego Garcia, January 1994 through March 1996--Continued.

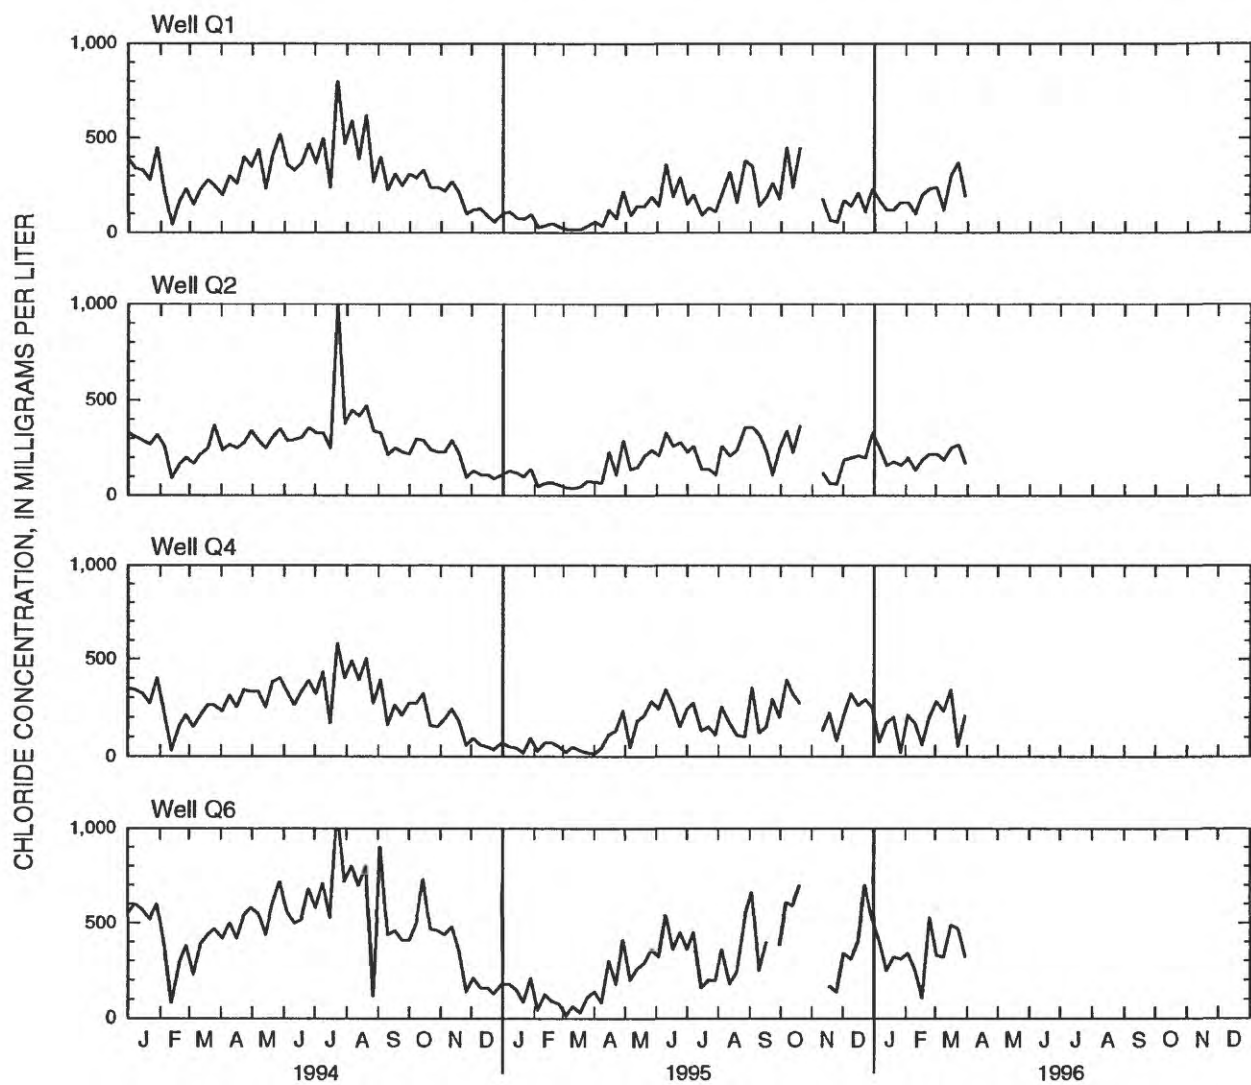


Figure C3. Chloride concentration of pumped water (sampled at weekly intervals) at Quad wells Q1, Q2, Q4, and Q6 at Cantonment, Diego Garcia, January 1994 through March 1996.

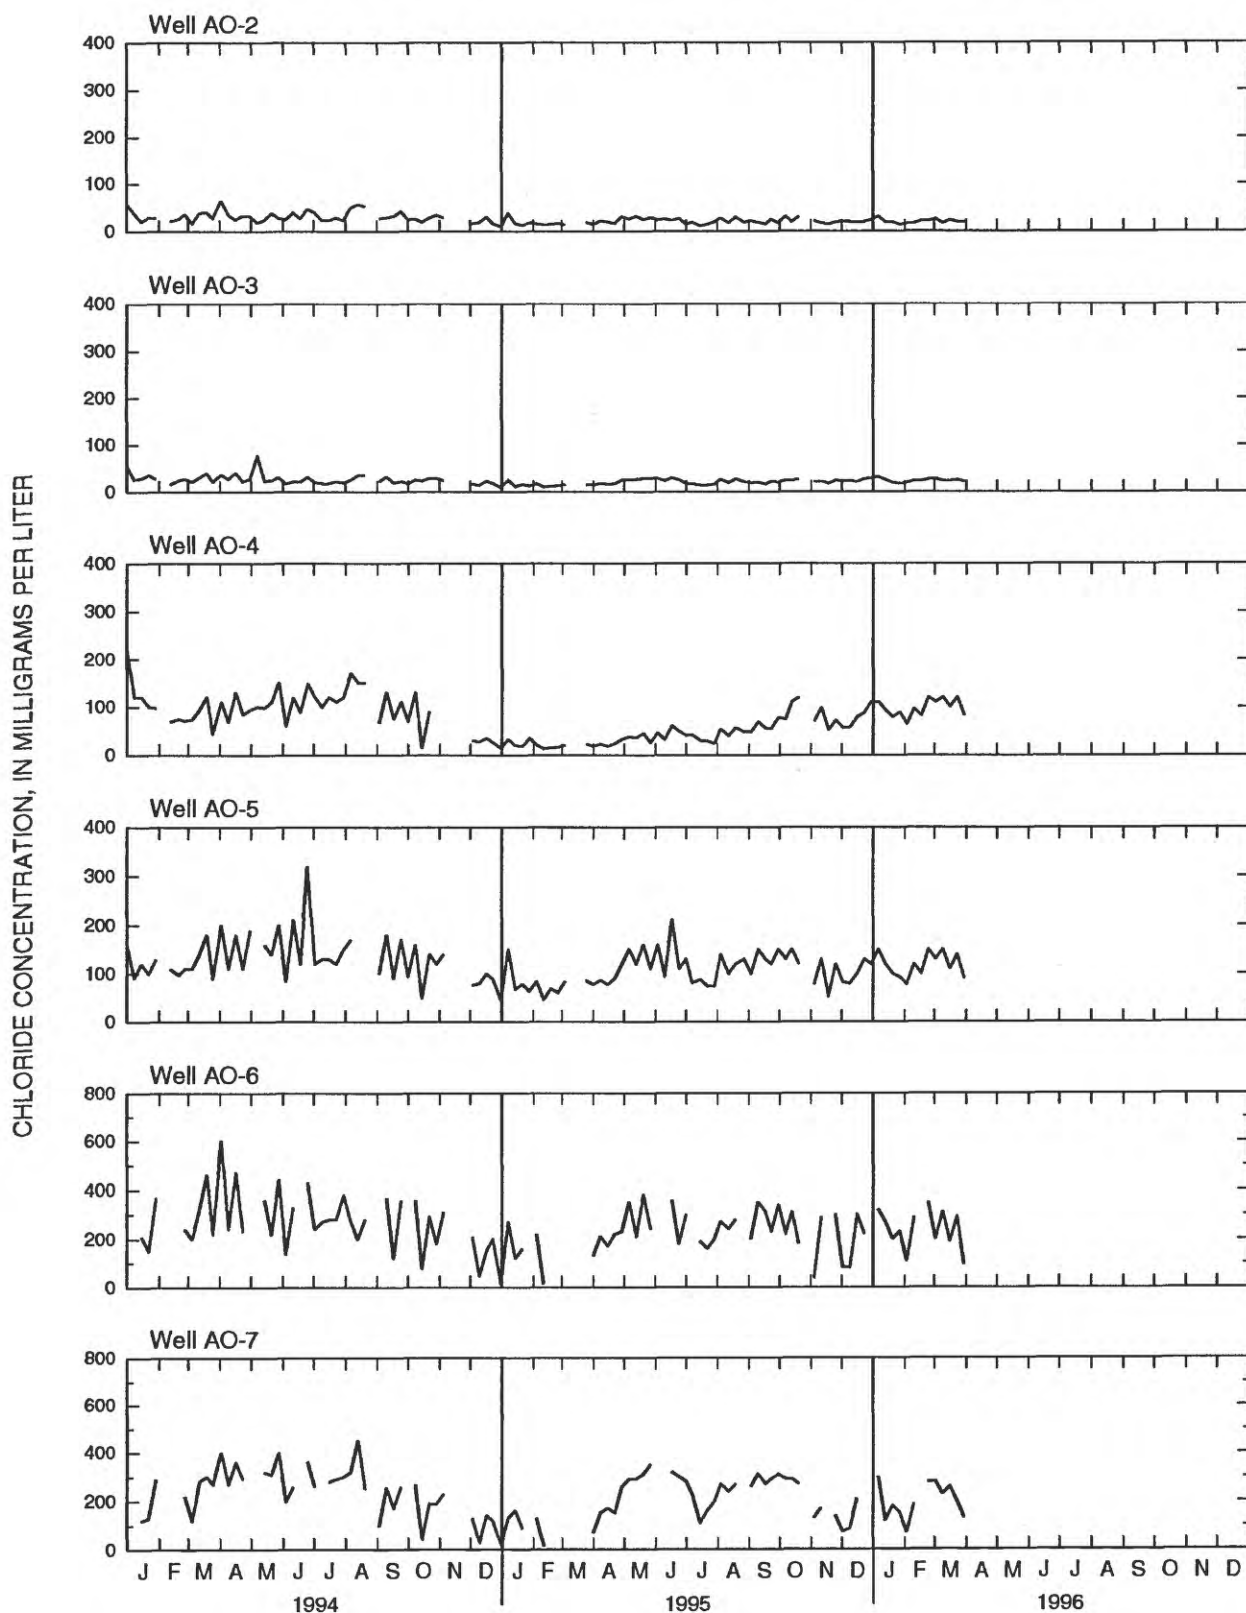


Figure C4. Chloride concentration of pumped water (sampled at weekly intervals) at wells AO-2 through AO-9 and wells AO-13 through AO-19 at Air Operations, Diego Garcia, January 1994 through March 1996. Water from well AO-13 has not been sampled since April 1993.

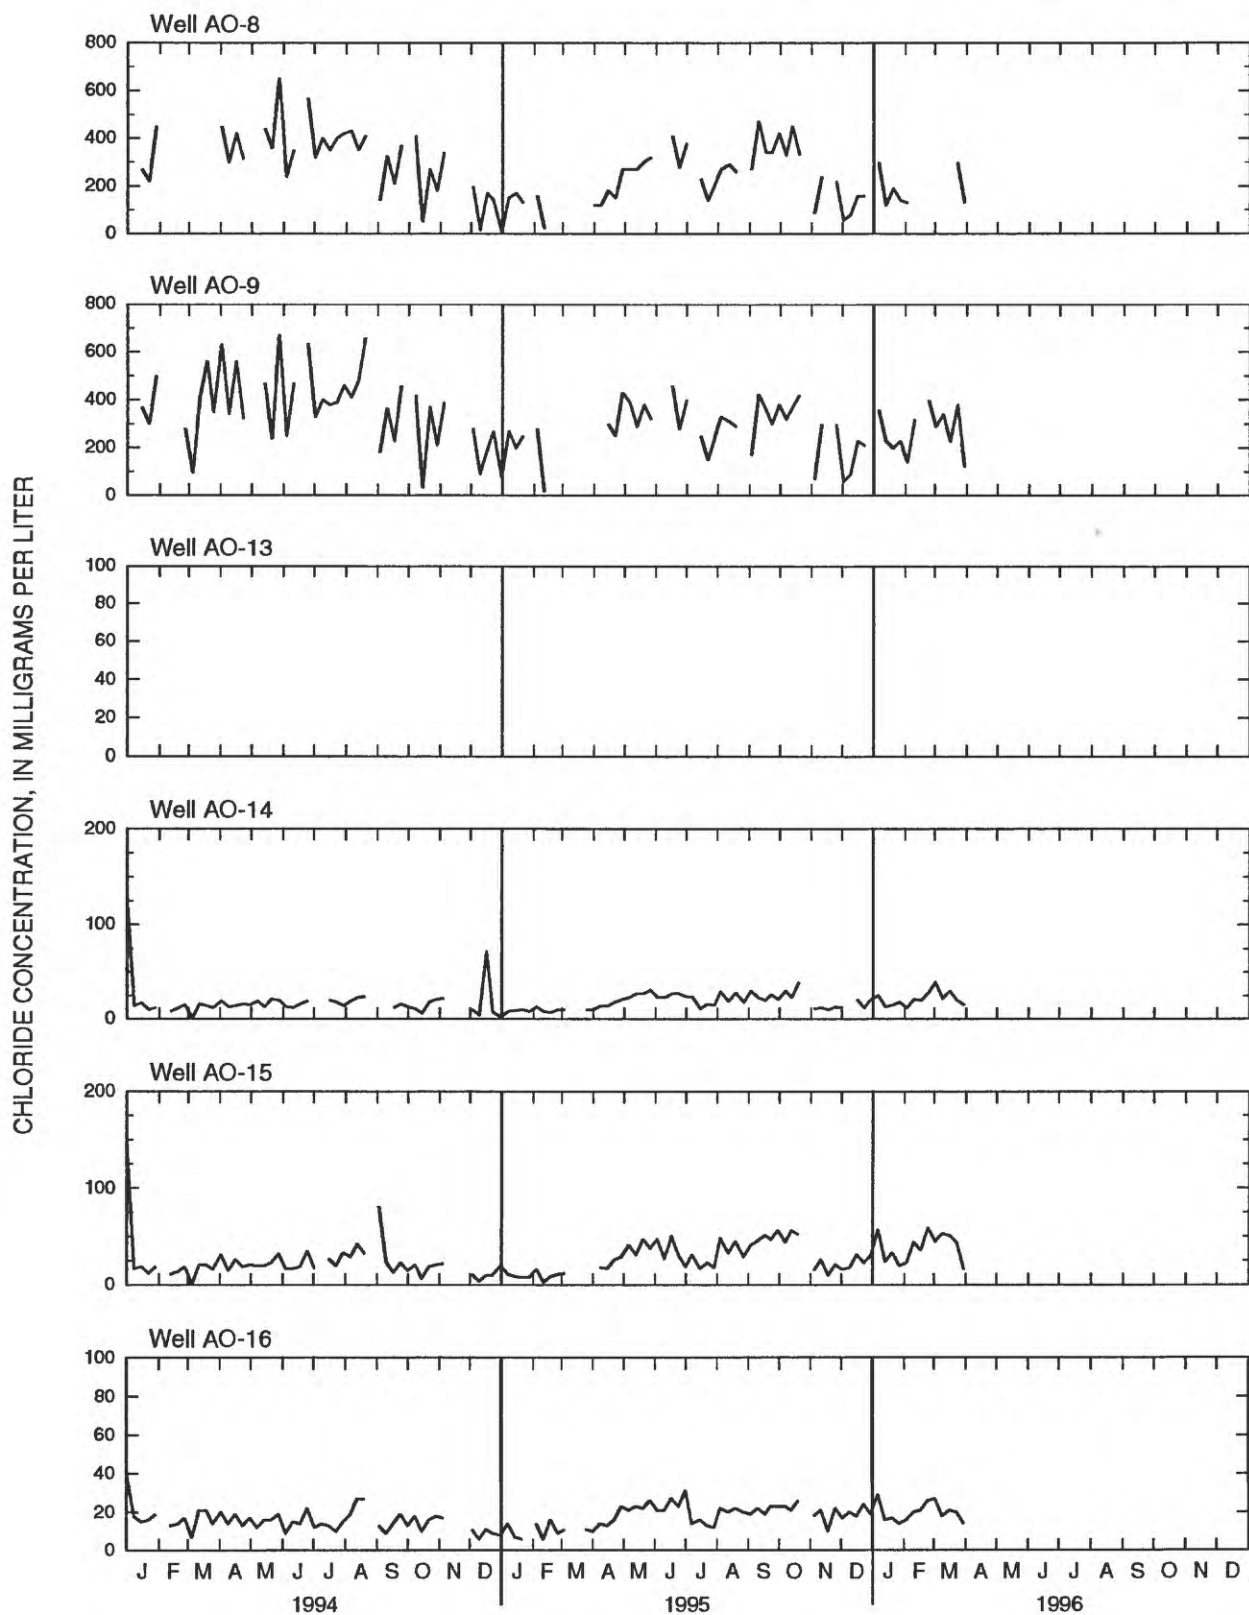


Figure C4. Chloride concentration of pumped water (sampled at weekly intervals) at wells AO-2 through AO-9 and wells AO-13 through AO-19 at Air Operations, Diego Garcia, January 1994 through March 1996. Water from well AO-13 has not been sampled since April 1993--Continued.

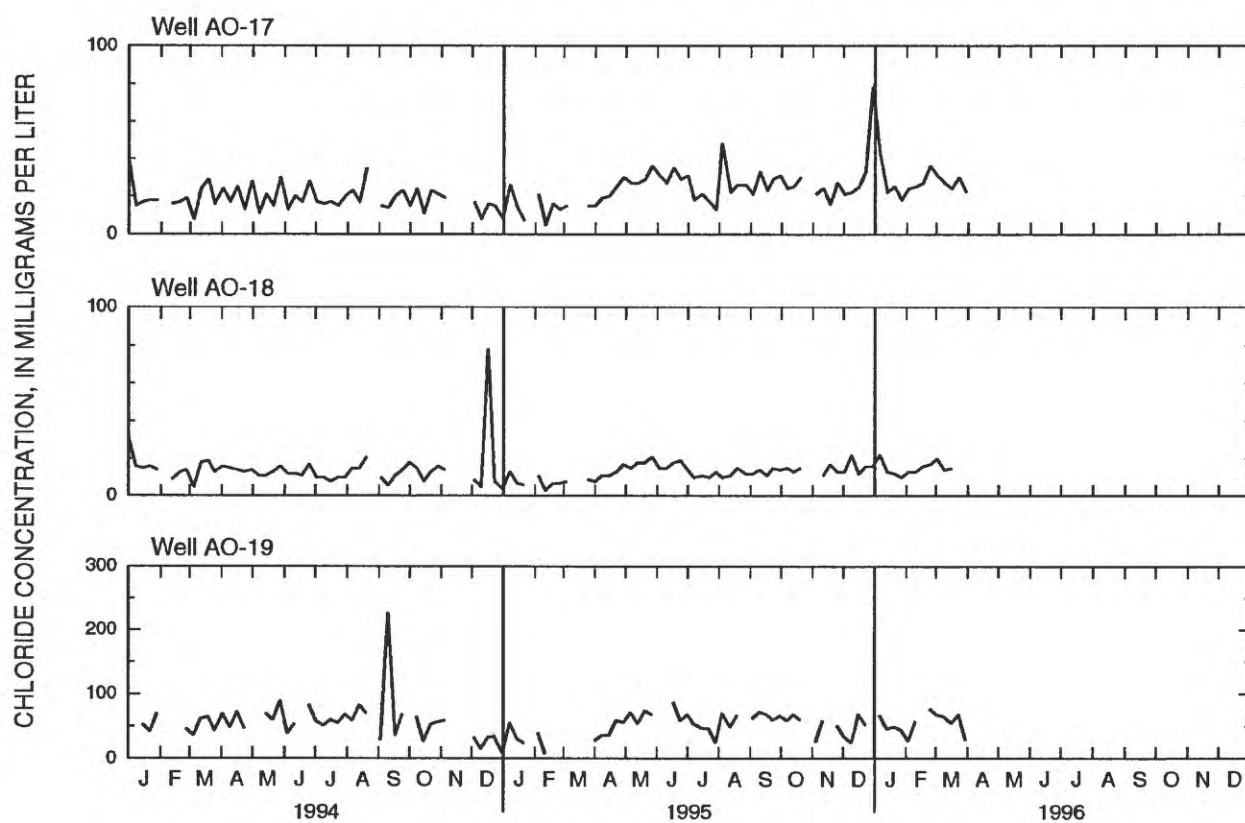


Figure C4. Chloride concentration of pumped water (sampled at weekly intervals) at wells AO-2 through AO-9 and wells AO-13 through AO-19 at Air Operations, Diego Garcia, January 1994 through March 1996. Water from well AO-13 has not been sampled since April 1993--Continued.

REFERENCES CITED

- Torikai, J.D., 1995, Status of ground-water resources at U.S. Navy Support Facility, Diego Garcia: Summary of hydrologic and climatic data through September 1993; U.S. Geological Survey Open-File Report 94-306, 51 p.
- U.S. Environmental Protection Agency, 1991, Secondary maximum contaminant levels (section 143.3 of part 143, National secondary drinking water regulations): U.S. Code of Federal Regulations, Title 40, Parts 100 to 149, revised through July 1, 1991.