


SPRINGFIELD WATER AND SEWER COMMISSION¹

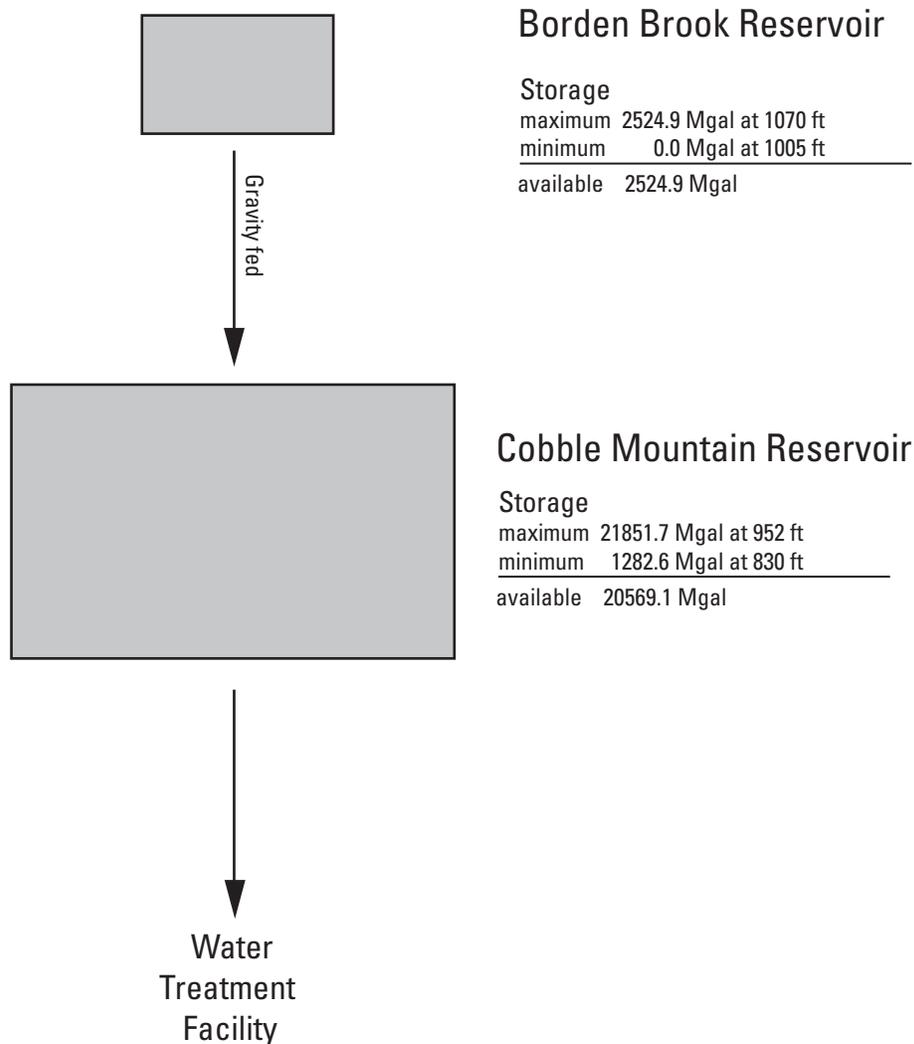

¹ System firm yield = 42.70 Mgal/d

Note: Mgal, million gallons; Mgal/d, million gallons per day; ft, feet; maximum and minimum measurements are in elevations relative to local vertical datum provided by Springfield Water and Sewer Commission, Springfield, MA

¹ System diagram and analysis do not include hydropower-station connections.