


LOCATIONS OF WELLS AT CAMP LEJEUNE, NORTH CAROLINA

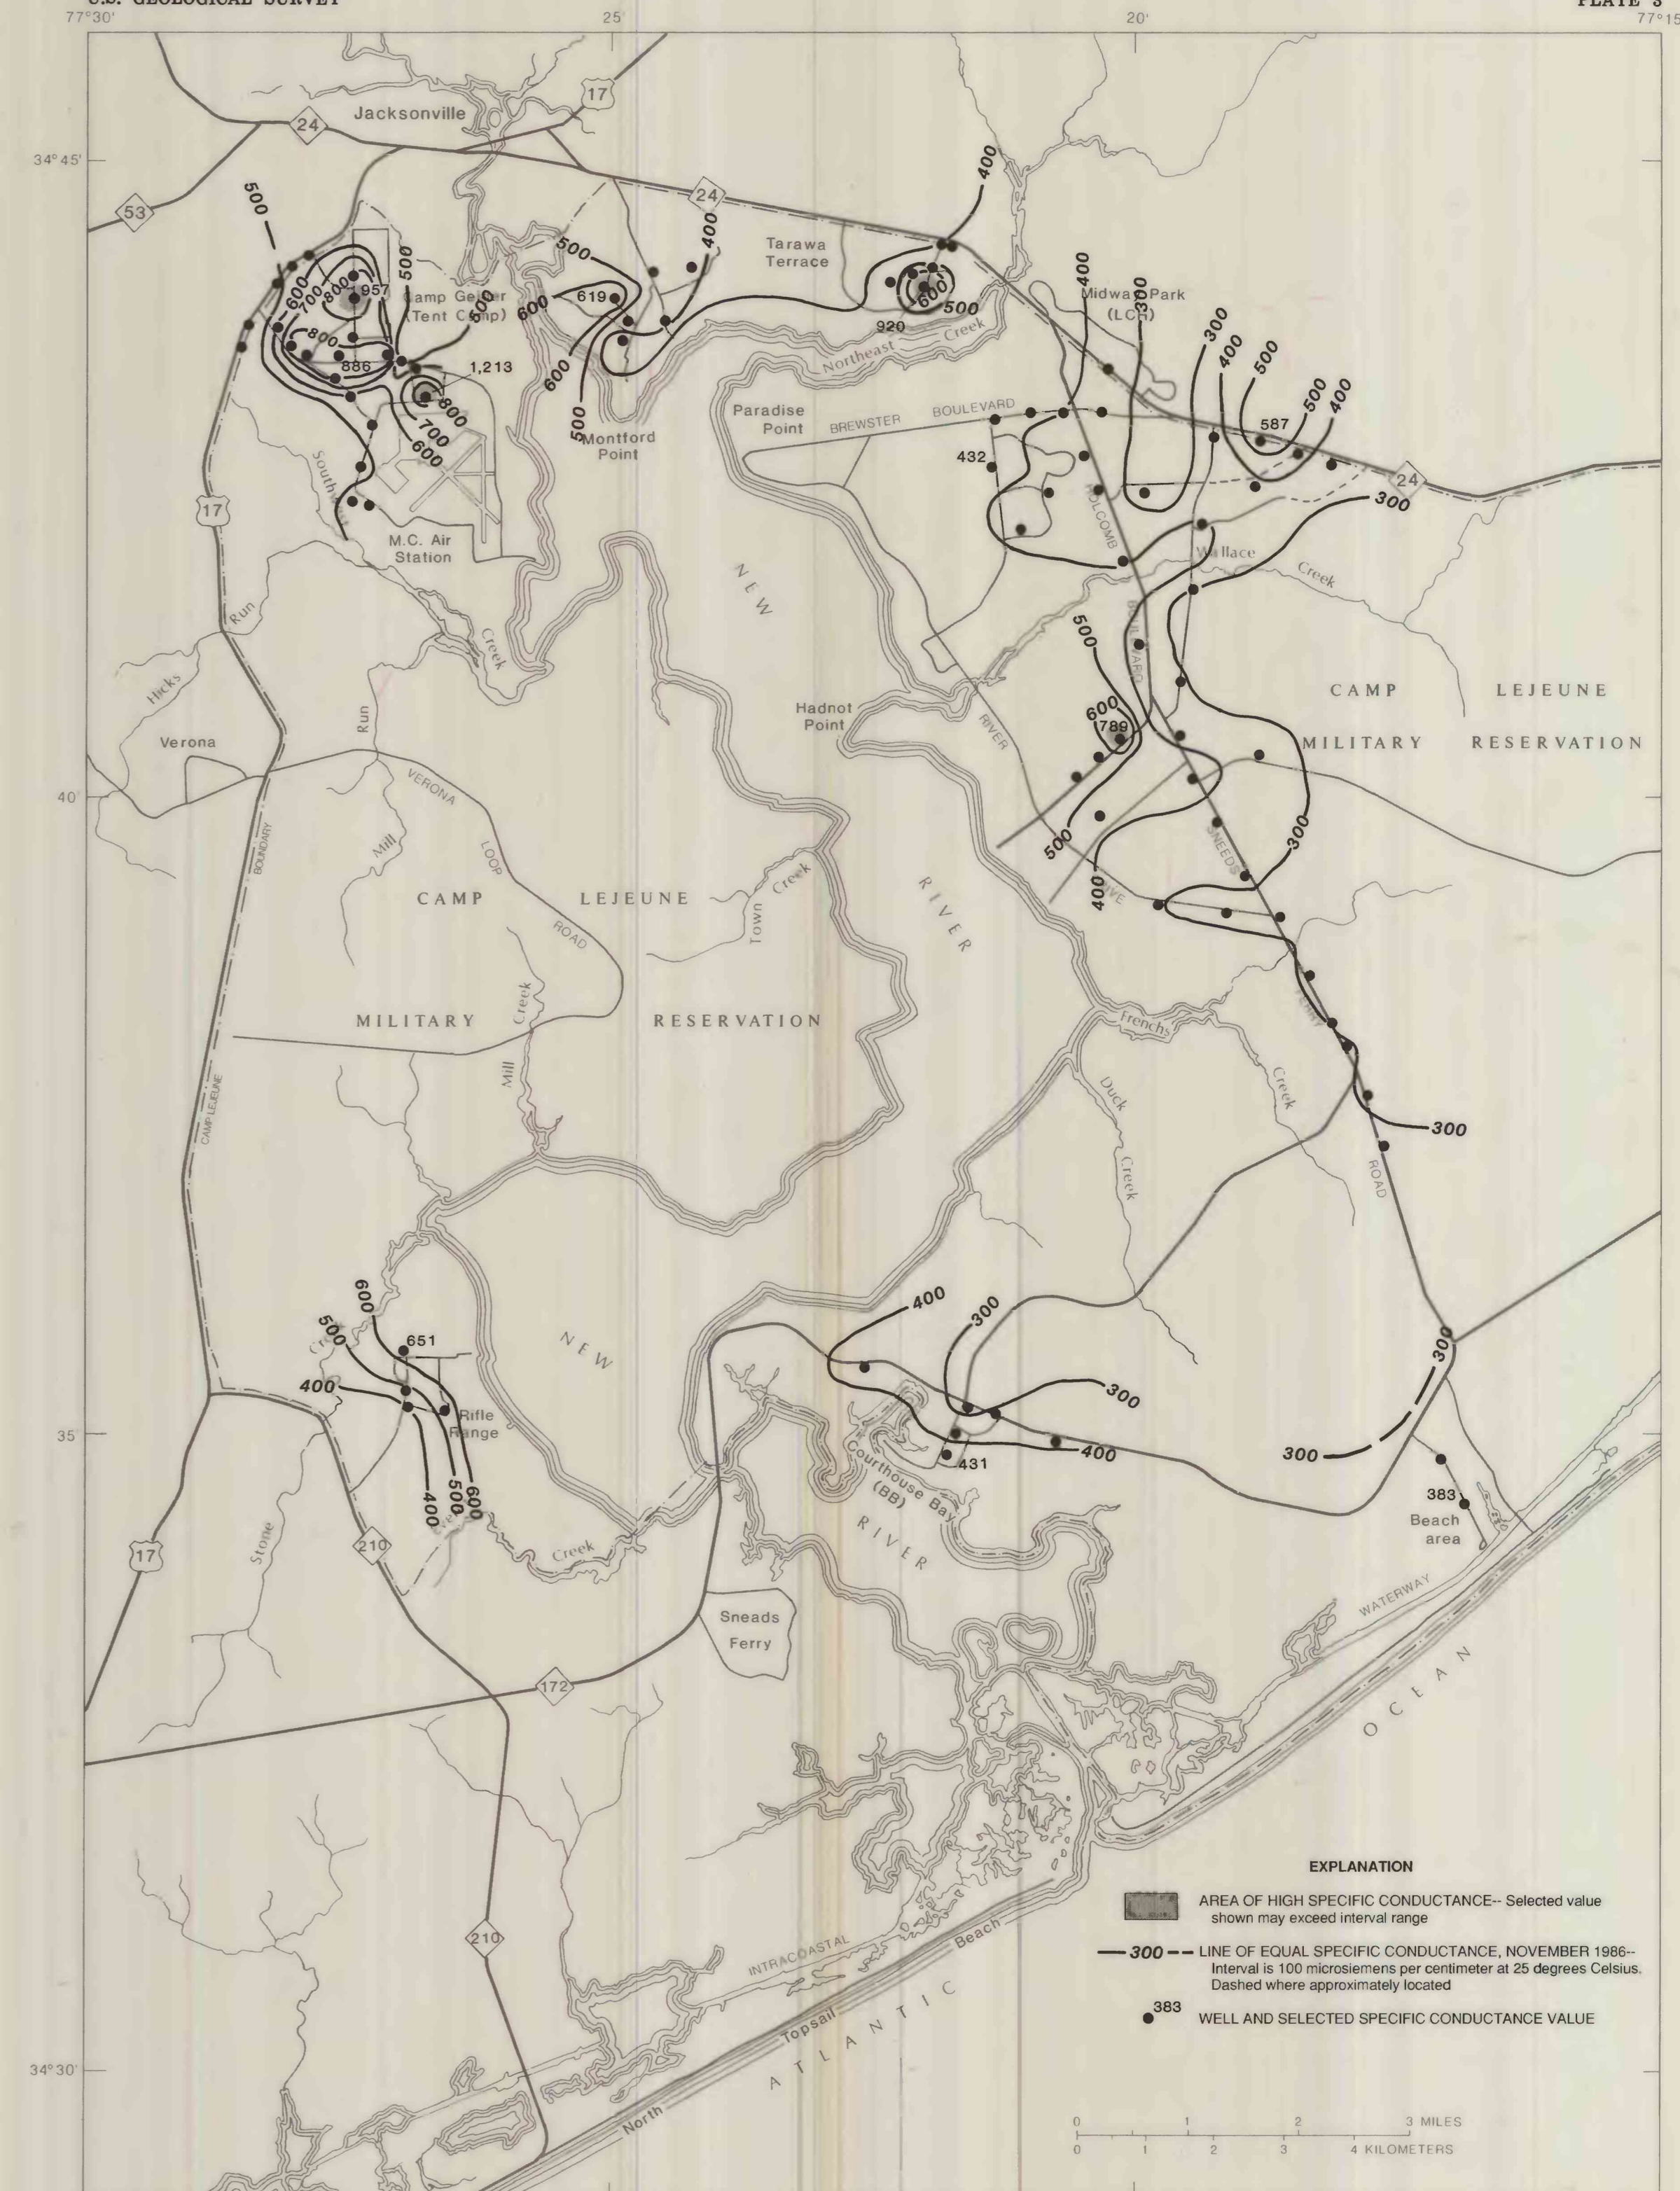

EXPLANATION

- AREA OF HIGH SPECIFIC CONDUCTANCE-- Selected value shown may exceed interval range
- 300 --- LINE OF EQUAL SPECIFIC CONDUCTANCE, NOVEMBER 1986-- Interval is 100 microsiemens per centimeter at 25 degrees Celsius. Dashed where approximately located
- 383 WELL AND SELECTED SPECIFIC CONDUCTANCE VALUE

Base taken from Defense Mapping Agency Hydrographic Center, Camp Lejeune Special Map, 1:50,000
SPECIFIC CONDUCTANCE OF WATER IN THE CASTLE HAYNE AQUIFER AT CAMP LEJEUNE, NORTH CAROLINA, NOVEMBER 1986