

B. Atrazine concentrations in diversion well water and ground water from Halstead recharge site

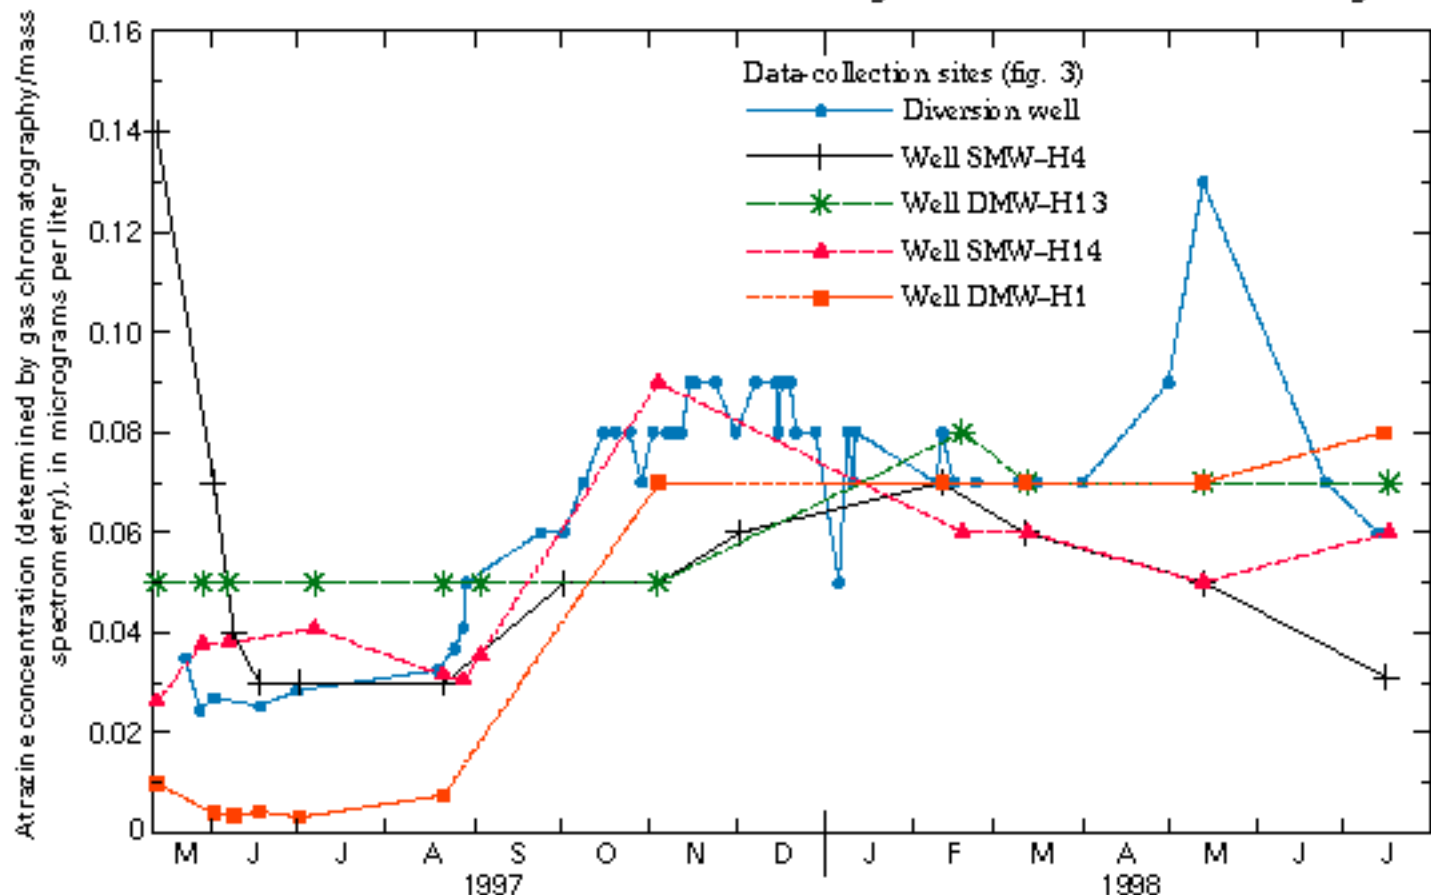


Figure 20b. Comparison of atrazine concentrations (A) in surface water and ground water from Halstead diversion well site, March 1995-July 1998, and (B) in diversion well water and ground water from Halstead recharge site, May 1997-July 1998. Maximum Contaminant Level from U.S. Environmental Protection Agency (1999)-Continued.