



Surface- and diverted-water samples

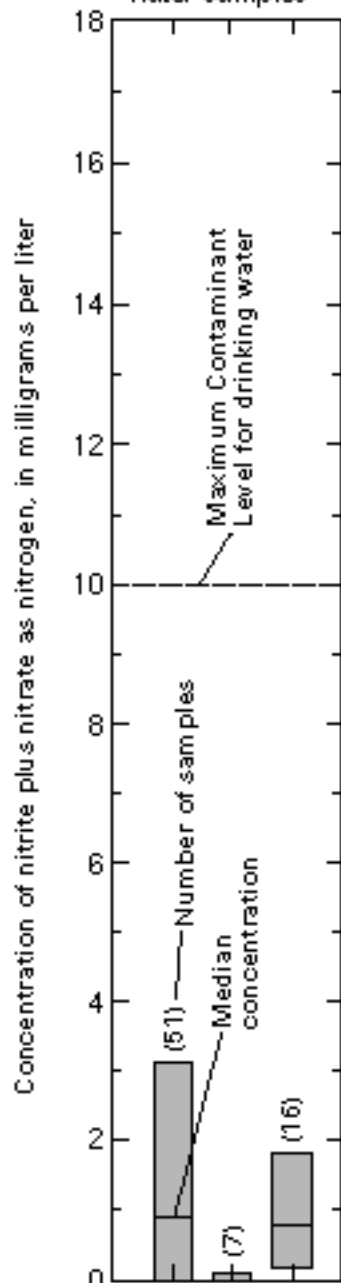

Ground-water samples

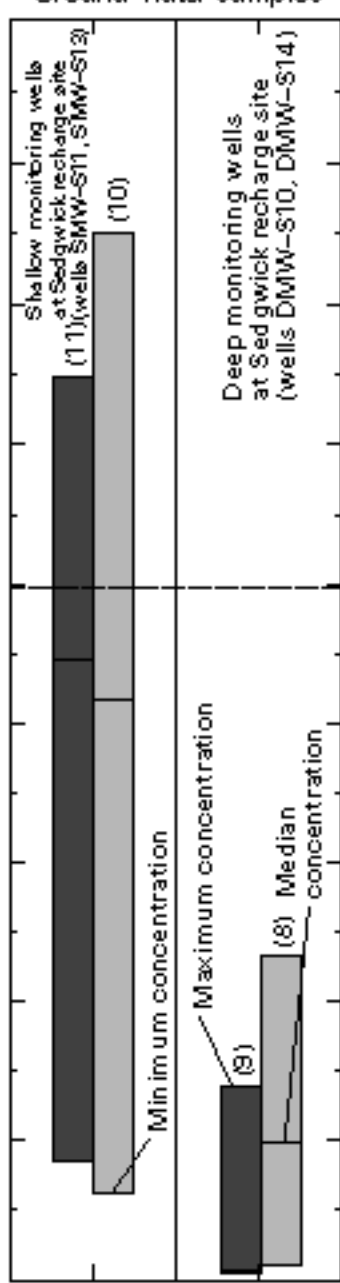

Little Arkansas River near Sedgwick (07144 100) Baseline conditions Feb. 1995-Sept. 1997
 Artificial recharge conditions Oct. 1997-July 1998
 Treated diverted water from Little Arkansas River near Sedgwick

Baseline conditions
 Artificial recharge conditions
 Baseline conditions
 Artificial recharge conditions

Figure 25. Ranges in nitrite plus nitrate concentrations in surface-, diverted-, and ground-water samples collected during baseline and recharge conditions. Maximum Contaminant Level from U.S. Environmental Protection Agency (1999).