


CALCULATED PERCENTAGE OF NATIVE FRESH WATER

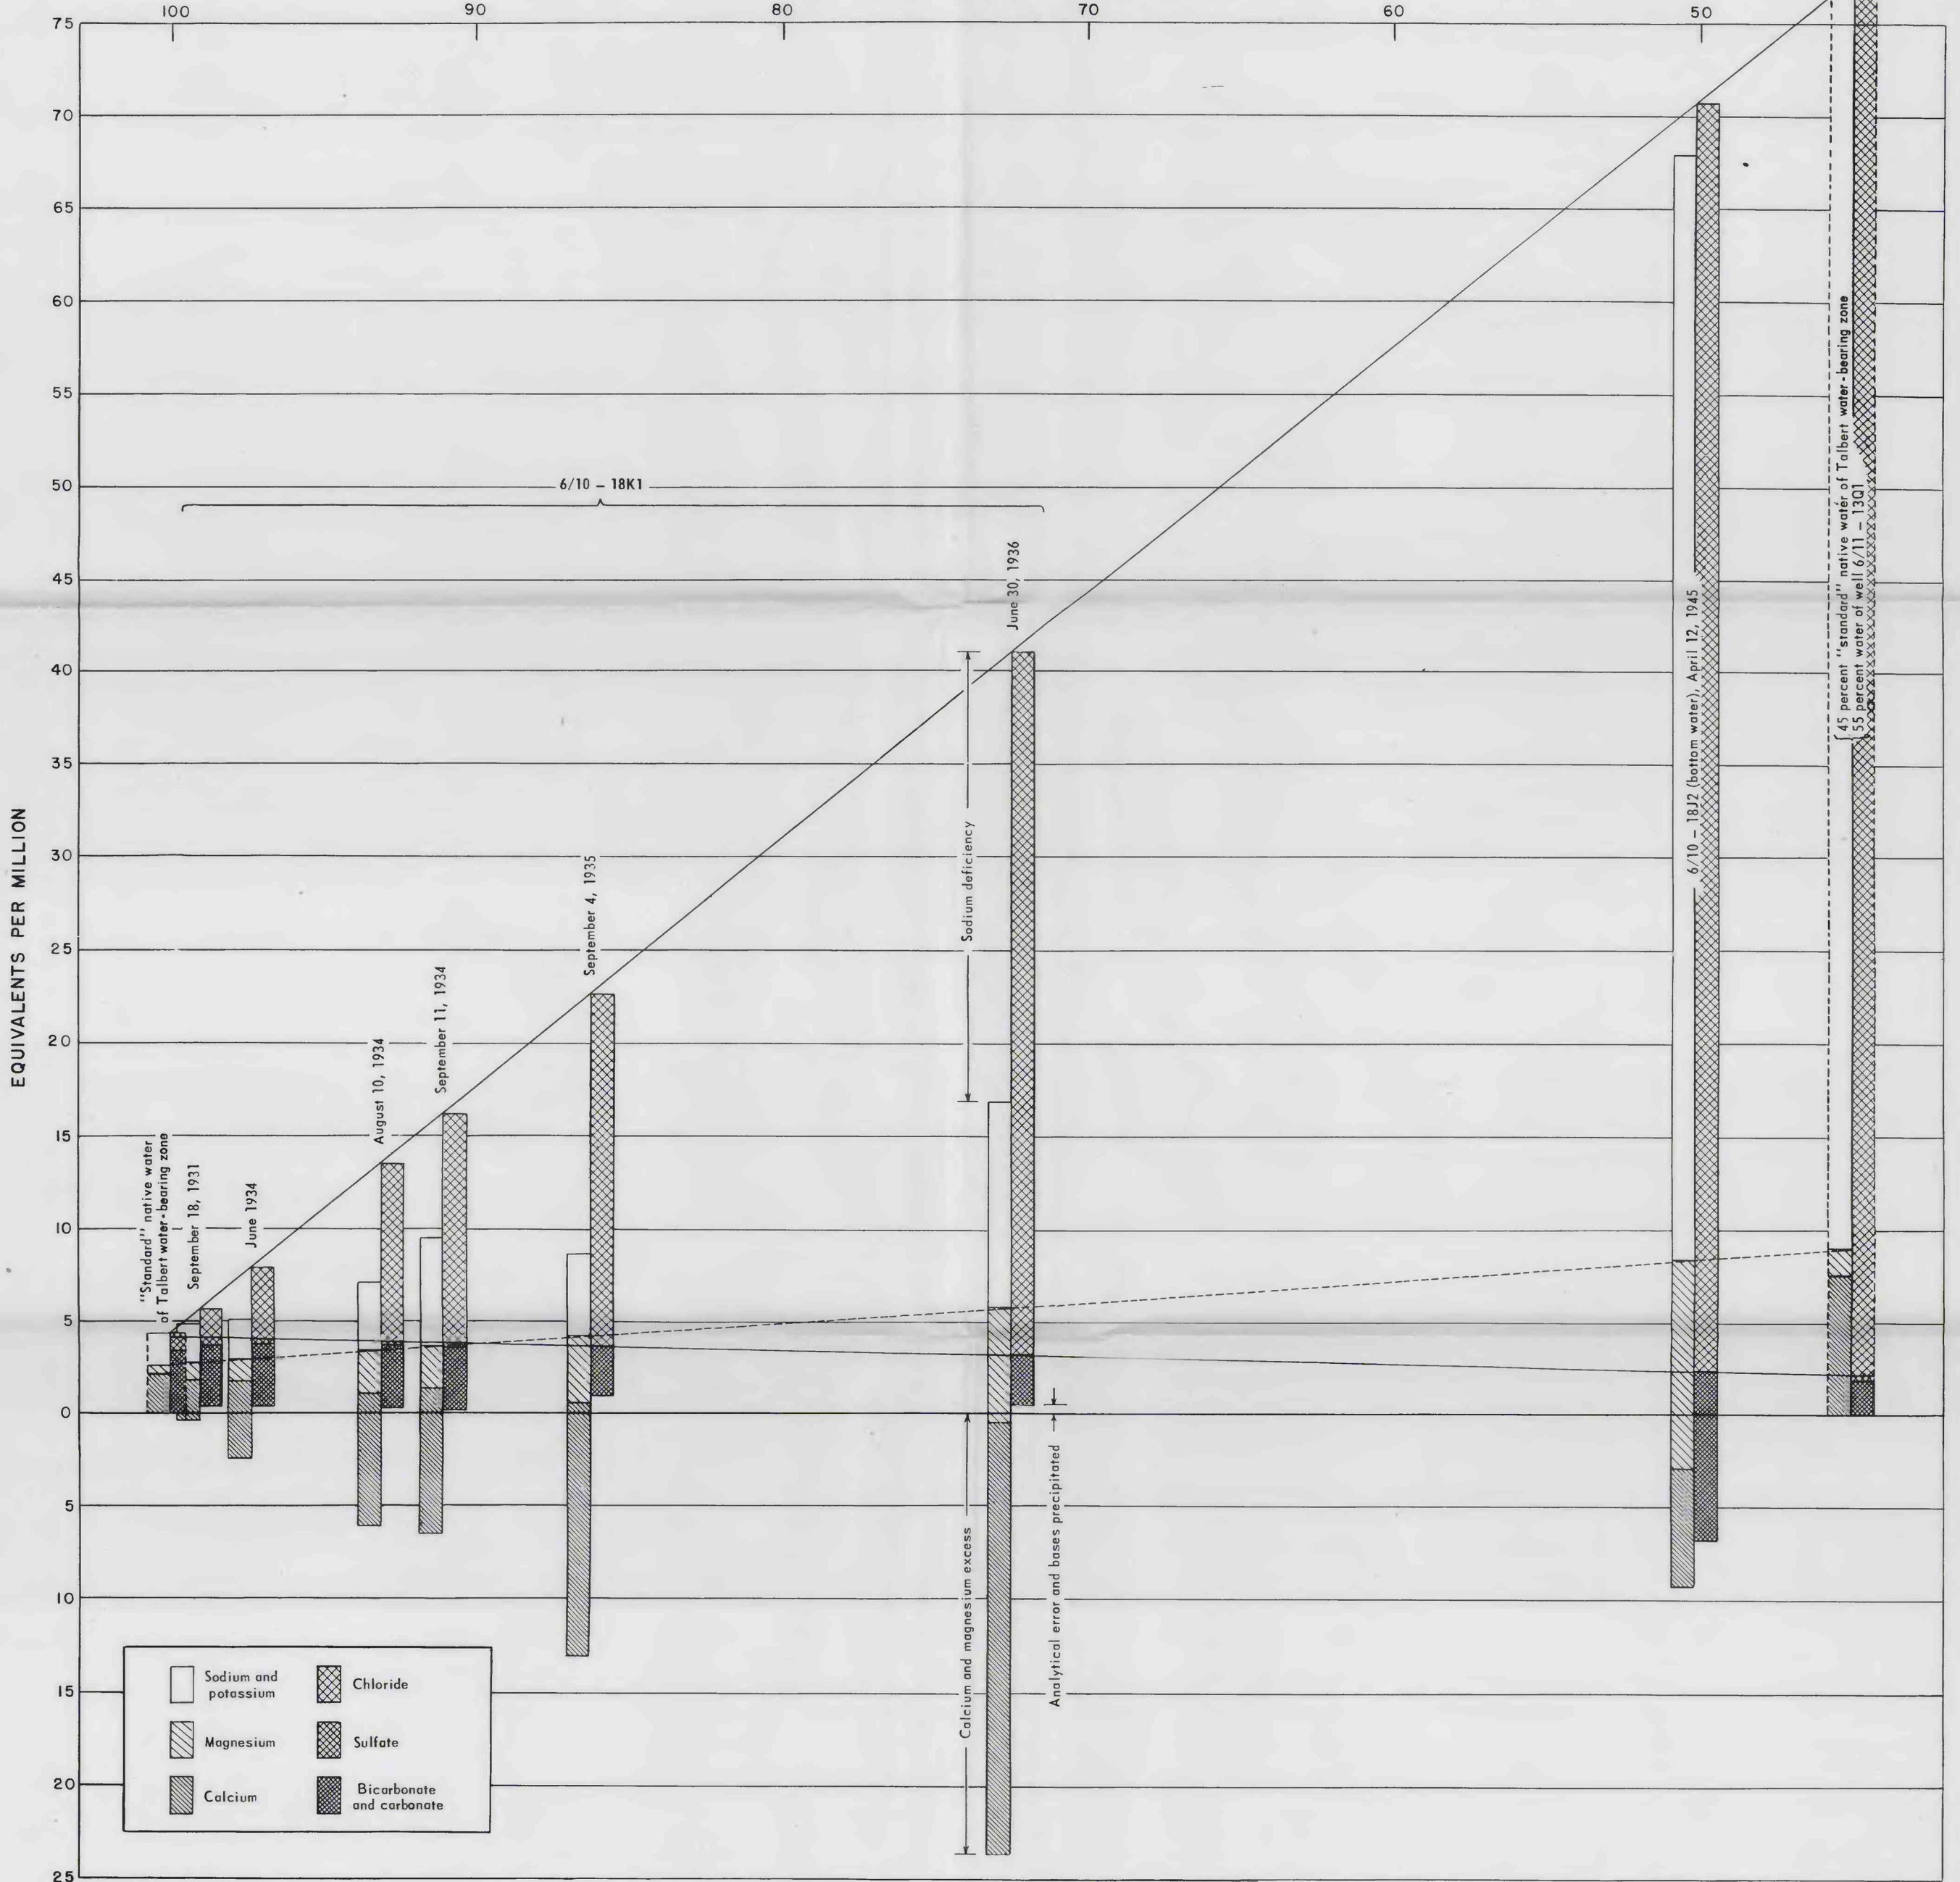

PROGRESSIVELY CONTAMINATED WATER FROM WELL 6/10-18K1 (NEWPORT BEACH, WELL 4), IN RELATION TO HYPOTHETICAL MIXTURE OF "STANDARD" NATIVE WATER FROM THAT WELL WITH BRINE FROM WELL 6/11-13Q1, ALSO IN RELATION TO BOTTOM WATER FROM WELL 6/10-18J2